

**Hans F. Ravn**

# **The Balmorel Model Structure**

**Version 2.11 (July 2004)**

**(This document revised 2004.07.02)**



# Contents

<b>1</b>	<b>Introduction</b>	<b>8</b>
1.1	This version . . . . .	8
1.2	Data structure, model and simulation . . . . .	8
1.3	A short introduction to GAMS terminology . . . . .	9
1.4	Naming conventions . . . . .	13
1.5	User interface . . . . .	15
1.6	Limitations and expected modifications . . . . .	15
<b>2</b>	<b>File Structure</b>	<b>15</b>
<b>3</b>	<b>Sets</b>	<b>19</b>
3.1	Geography . . . . .	19
3.1.1	Countries: C, CCC . . . . .	21
3.1.2	Regions: RRR . . . . .	21
3.1.3	Areas: AAA . . . . .	22
3.1.4	Urban and rural heat areas: AAAURBH, AAARURH . . . . .	22
3.1.5	Relations between C, R and A: RRRAAA, CCCRRR . . . . .	22
3.2	Time . . . . .	23
3.2.1	The years: YYY, Y . . . . .	23
3.2.2	Time segments within years: SSS, S, TTT, T . . . . .	24
3.2.3	Daytypes: workdays and weekend . . . . .	25
3.2.4	Ordered and unordered sets . . . . .	25
3.3	Generation technologies: GGG, G, GDATASET, GGCOMB . . . . .	26
3.3.1	Combination technologies . . . . .	27
3.4	Fuels: FFF, FDATASET, FKPOTSET . . . . .	29
3.5	New generation technology and area: AGKN . . . . .	30
3.6	Demand: DF_QP, DEF_..., DHF_... . . . .	30
3.7	Emission policies: MPOLSET . . . . .	32
3.8	Internal sets . . . . .	32
3.8.1	Static and dynamic sets . . . . .	33
3.8.2	Areas simulated: IA . . . . .	33
3.8.3	Rural and urban heat areas simulated: IARURH, IAURBH . . . . .	33
3.8.4	Country to area mapping: ICA . . . . .	33
3.8.5	Regions simulated: IR . . . . .	33
3.8.6	Electricity import-export: IRRRI, IRRRE, IRI, IRE . . . . .	33
3.8.7	Season and time duplication: ISALIAS, ITALIAS . . . . .	33
3.8.8	Season and time refinements: IST, ISTS, ISTT . . . . .	34
3.8.9	Generation technology types . . . . .	34
3.8.10	Investments in new technologies: IAGKN . . . . .	36
3.8.11	Equation feasibility: IPLUSMINUS . . . . .	36
3.9	Restrictions on sets . . . . .	36
<b>4</b>	<b>Parameters and scalars</b>	<b>38</b>
4.1	Scalars . . . . .	39
4.1.1	PENALTY . . . . .	39
4.2	Parameters on the set YYY . . . . .	39
4.2.1	YVALUE . . . . .	39
4.3	Parameters on the set SSS . . . . .	39
4.3.1	WEIGHT_S . . . . .	39
4.4	Parameters on the set TTT . . . . .	39
4.4.1	WEIGHT_T . . . . .	39
4.5	Parameters on the set CCC . . . . .	40
4.5.1	ANNUITYC . . . . .	40
4.5.2	TAX_DE . . . . .	40
4.5.3	TAX_DH . . . . .	40

4.6	Parameters on the set RRR . . . . .	40
4.6.1	DISLOSS_E . . . . .	40
4.6.2	DISCOST_E . . . . .	40
4.6.3	DEFP_BASE . . . . .	41
4.7	Parameters on the set AAA . . . . .	41
4.7.1	DISLOSS_H . . . . .	41
4.7.2	DISCOST_H . . . . .	41
4.7.3	DHFP_BASE . . . . .	41
4.7.4	WNDFLH . . . . .	41
4.7.5	SOLFLH . . . . .	41
4.7.6	WTRRRFLH . . . . .	41
4.7.7	WTRRSFLH . . . . .	41
4.8	Parameters on the set product (FFF,FDATASET) . . . . .	41
4.8.1	FDATA . . . . .	41
4.9	Parameters on the set product (FFF,CCC) . . . . .	42
4.9.1	TAX_F . . . . .	42
4.10	Parameters on the set product (GGG,AAA) . . . . .	42
4.10.1	GDINVCOST . . . . .	42
4.10.2	GDOMVCOST . . . . .	42
4.10.3	GDOMFCOST . . . . .	42
4.10.4	GEFFDERATE . . . . .	42
4.11	Parameters on the set product (YYY,RRR) . . . . .	42
4.11.1	X3FX . . . . .	42
4.11.2	DE . . . . .	43
4.12	Parameters on the set product (YYY,AAA) . . . . .	43
4.12.1	DH . . . . .	43
4.13	Parameters on the set product (GGG,GDATASET) . . . . .	43
4.13.1	GDATA . . . . .	43
4.14	Parameters on the set product (IRRRE,IRRRI) . . . . .	44
4.14.1	XKINI . . . . .	44
4.14.2	XINVCOST . . . . .	45
4.14.3	XCOST . . . . .	45
4.14.4	XLOSS . . . . .	45
4.15	Parameters on the set product (FKPOTSETA,AAA) . . . . .	45
4.15.1	FKPOTA . . . . .	45
4.16	Parameters on the set product (FKPOTSETR,RRR) . . . . .	45
4.16.1	FKPOTR . . . . .	45
4.17	Parameters on the set product (FKPOTSETC,CCC) . . . . .	46
4.17.1	FKPOTC . . . . .	46
4.18	Parameters on the set product (AAA,SSS) . . . . .	46
4.18.1	WTRRSVARS . . . . .	46
4.18.2	HYPPROFILS . . . . .	46
4.19	Parameters on the set product (AAA,SSS,TTT) . . . . .	46
4.19.1	DH_VAR_T . . . . .	46
4.19.2	SOL_VAR_T . . . . .	46
4.19.3	WND_VAR_T . . . . .	46
4.19.4	WTRRRVAR_T . . . . .	46
4.19.5	DHFP_CALIB . . . . .	46
4.20	Parameters on the set product (RRR,SSS,TTT) . . . . .	47
4.20.1	DE_VAR_T . . . . .	47
4.20.2	DEFP_CALIB . . . . .	47
4.20.3	X3FX_VAR_T . . . . .	47
4.21	Parameters on the set product (GGG,AAA,SSS) . . . . .	48
4.21.1	GKDERATE . . . . .	48
4.22	Parameters on the set product (YYY,AAA,GGG) . . . . .	48
4.22.1	GKFX . . . . .	48
4.23	Parameters on the set product (YYY,AAA,FFF) . . . . .	48

4.23.1	FUELPRICE . . . . .	48
4.24	Parameters on the set product (YYY,MPOLSET,CCC) . . . . .	48
4.24.1	M_POL . . . . .	48
4.25	Parameters on the set product (RRR,SSS,TTT,DF_QP,DEF) . . . . .	48
4.25.1	DEF_STEPS . . . . .	48
4.26	Parameters on the set product (AAA,SSS,TTT,DF_QP,DHF) . . . . .	49
4.26.1	DHF_STEPS . . . . .	49
4.27	Default values . . . . .	49
4.28	Restrictions on parameter values. . . . .	50
4.29	Internal parameters and scalars . . . . .	50
4.29.1	IBALVERSN . . . . .	50
4.29.2	ISCALAR1, ISCALAR2, IOF . . . . .	50
4.29.3	IANYSET . . . . .	50
4.29.4	IWEIGHSUMS . . . . .	51
4.29.5	IWEIGHSUMT . . . . .	51
4.29.6	IHOURSINST . . . . .	51
4.29.7	IDAYSIN_S . . . . .	51
4.29.8	IHOURSIN24 . . . . .	52
4.29.9	IDE_SUMST . . . . .	52
4.29.10	IDH_SUMST . . . . .	52
4.29.11	IWND_SUMST . . . . .	52
4.29.12	ISOL_SUMST . . . . .	52
4.29.13	IHYINF_S . . . . .	52
4.29.14	IWTRRRSUM . . . . .	53
4.29.15	IWTRRSSUM . . . . .	53
4.29.16	IX3FXSUMST . . . . .	53
4.29.17	IM_CO2 . . . . .	53
4.29.18	IM_SO2 . . . . .	53
4.29.19	IGKVACCTOY . . . . .	53
4.29.20	IGKFX_Y . . . . .	53
4.29.21	IXKINLY . . . . .	54
4.29.22	IXKN . . . . .	54
4.29.23	IFUELP_Y . . . . .	54
4.29.24	ITAX_CO2_Y . . . . .	54
4.29.25	ITAX_NOX_Y . . . . .	54
4.29.26	ITAX_SO2_Y . . . . .	54
4.29.27	ILIM_CO2_Y . . . . .	54
4.29.28	ILIM_SO2_Y . . . . .	54
4.29.29	ILIM_NOX_Y . . . . .	55
4.29.30	IDE_T_Y . . . . .	55
4.29.31	IDH_T_Y . . . . .	55
4.29.32	IDHFP_T . . . . .	55
4.29.33	IDAFP_T . . . . .	55
4.29.34	IX3FX_T_Y . . . . .	55
<b>5</b>	<b>Auxiliary parameters for outputs</b>	<b>56</b>
<b>6</b>	<b>Variables</b>	<b>56</b>
<b>7</b>	<b>Equations and constraints</b>	<b>58</b>
<b>8</b>	<b>Model and solve</b>	<b>60</b>

<b>9</b>	<b>Calibration</b>	<b>60</b>
9.1	Calibration of fuel consumption . . . . .	61
9.1.1	Calibration of GKDERATE . . . . .	61
9.1.2	Calibration of GEFFDERATE . . . . .	64
9.2	Calibration of demand functions . . . . .	66
9.2.1	Calibration of DEFP_CALIB and DHFP_CALIB . . . . .	66
<b>10</b>	<b>Output</b>	<b>67</b>
10.1	Automatically generated GAMS output . . . . .	67
10.2	Balmorel auxiliary output . . . . .	67
10.3	The compare facility . . . . .	69
<b>11</b>	<b>Errors and Log</b>	<b>72</b>
11.1	Errors automatically detected by GAMS . . . . .	72
11.2	Errors detected by Balmorel auxiliary parts . . . . .	72
11.3	Sequence of log and error observations . . . . .	72
<b>12</b>	<b>Model variants</b>	<b>73</b>
12.1	Why variants . . . . .	73
12.2	Types of changes . . . . .	73
12.3	Organising modifications . . . . .	74
12.4	No new investments . . . . .	75
12.5	No electricity transmission . . . . .	75
12.6	Price dependent electricity exchange with third countries . . . . .	76
12.7	Reserve generation capacity . . . . .	78
12.8	Finer subdivision of the year . . . . .	79
12.9	Making more parameters depend on the year . . . . .	79
12.10	Making more parameters depend on geography . . . . .	79
12.11	Market power . . . . .	79
12.12	Markets for emission, renewable energy and JI . . . . .	79
12.13	Investment costs depend on technical life time . . . . .	79
12.14	Version numbering and referencing . . . . .	80
<b>13</b>	<b>Overview of model structure components</b>	<b>81</b>



# 1 Introduction

This paper documents the Balmorel model structure and describes some of the technicalities in the model.

The Balmorel model was developed for the analysis of the power and CHP (combined heat and power) sectors in the Baltic Sea Region. The model is directed towards the analysis of policy questions to the extent that they contain substantial international aspects.

The model is implemented in the GAMS modelling language. For the present, we assume that the reader is familiar with this. An ultra short introduction is given in Section 1.3. The files that contain the model as specified in the GAMS language is in fact a good documentation of the model. In the present document we have aimed at presenting a documentation that is structured differently and which presents additional information and overview relative to that in the GAMS model files.

In particular note that emphasis in the present document is on the model structure. By this is meant that actual values of parameters are not given nor are the actual members of the sets used in the model. However, the names of the parameters and sets are specified and so is their functioning in the model.

Further note that the present document treats the GAMS part of the model. Various facilities are provided that permit working in a spreadsheet environment, however, this will not be treated here.

For the exact documentation of the model, input data and set members, see the model files.

This document is part of a series that together documents the Balmorel model:

Balmorel: A Model for Analyses of the Electricity and CHP Markets in the Baltic Sea Region (Main Report)

The Balmorel Model: Theoretical Background

The Balmorel Model Structure (this document)

Balmorel: Data and Calibration

Balmorel: Getting Started

These documents and further information, including application examples, may be found at the Balmorel homepage: [www.Balmorel.com](http://www.Balmorel.com).

## 1.1 This version

The description given here is for version 2.11 (July 2004) of the model.

There have been a number of changes in the Balmorel model structure from the first version (from 2001) to the present one. The changes will not be documented here, however you may contact us for further information, cf. the Balmorel homepage.

The changes from the previous version, 2.10 Alpha (May 2003), concern improvements in the functioning of the model, both in terms of new features and in terms of improvements in processing speed. Data is essentially the same as in the previous version; one exception is that all areas have been classified as urban heat areas.

The model is implemented in GAMS, Version 2.25, see further Section 1.3.

The model has been developed on PC/Windows, see further Section 1.3.

## 1.2 Data structure, model and simulation

We distinguish here between three concepts: that for which data structures exist, that which is modelled (i.e., that for which a meaningful data set has been entered into the data files), and that which is simulated.

When we refer to that for which data structure exist we have in mind what the data structures actually allow of data input, this could be seen as the potentials of the database. The restriction on this is the sets, parameters, etc. that are declared. For instance, the years for which demand may be given could be from 1995 to 2030. This set of years is given by the set YYY. Other triple letter sets, AAA, RRR, CCC, SSS, TTT, GGG and FFF have the same function.

When we refer to that which is simulated we refer to a specific simulation. Such a simulation will for instance only concern the subset Y of the above mentioned years, e.g. the years 1995 to 2010. The GAMS syntax requires that Y be a subset of YYY.

Further, in order to make a meaningful simulation, data must be available for the simulation. That for which data is available is referred to as that which is modeled (or that for which a data set exist).

Hence that which is simulated must be a subset of that which is modeled, and that again must be a subset of that for which data structures exist. Assuming that the user is reasonable, it is necessary only to distinguish between that which is simulated and that for which data structures exist.

Presently data structures cover the period 1995 to 2030, and for this period there has also been provided data. Hence, what is modeled is (as far as years are concerned) identical to that for which data structures related to years exist.

Observe that the aim of the present document is the description of the structure of the model. Therefore the actual parameter values and set members given here should be considered as examples, rather than that actually used. See further Section 12.14 for some specifications (and Sections 3.9 and 4.28 for exceptions).

### 1.3 A short introduction to GAMS terminology

GAMS is the acronym for General Algebraic Modeling System. The system is suitable for formulation, documentation and solution of large mathematical models.

Generally, we assume that the reader is sufficiently familiar with the GAMS language. A User's Guide, a Tutorial, and other relevant information about the GAMS modeling system may be found at [www.gams.com](http://www.gams.com).

For the purpose of the following description, we shall only point out a few basic things. The idea is therefore not to give a rounded presentation of the GAMS modeling language, implying e.g. that subjects that can be relatively easily understood by reading the model will not be explained.

#### GAMS version

The Balmorel model is implemented in version 2.25. This version has (minor) limitation relative to later versions. Version 2.25 was chosen to ensure compatibility with existing installations of GAMS. Later versions of GAMS have backwards compatibility such that Balmorel may execute on them.

The limitations following from restriction to version 2.25 as observed by us are (i) the length of identifiers and labels are restricted to ten characters, (ii) the use of WHILE is not possible, (iii) the use of FOR-TO and FOR-DOWNTO is not possible (see in Section 4.29.3 how this is circumvented), (iv) do not use tabulator. To check whether the syntax of version 2.25 is followed, a '\$use225' may be inserted in the first line of the program, with the \$ in the first position. (But we have observed that this feature unfortunately does not enforce limitation to ten characters.)

The model is developed on PC/Windows. GAMS will also run under Unix and Linux. In order to facilitate Unix and Linux applications of the Balmorel model, file and path names have all been written in lower case letters. Note that according to the documentation, GAMS under Windows should use backward slash (\) in path names while under Unix and Linux forward slash (/) should be used.

However, it seem that the style we adopted (see Balmorel.gms) works for all three operating systems.

## Sets

The GAMS language contains among other elements SETS, various parameter values (exogenously given) indicated by SCALAR or PARAMETER (and possibly entered in a TABLE), (endogenous) VARIABLES, and EQUATIONS. A set of EQUATIONS constitute a MODEL.

Sets are the basic building blocks of GAMS, corresponding to the indices in an algebraic representation of a model. The set is declared by SET or SETS, followed by the name (identifier) of the set. The definition of the set is the specification of the contents of the set, i.e., the elements or the members of the set. If for example the model contains three countries, this may be specified as

```
SET COUNTRIES / DENMARK, NORWAY, SWEDEN /;
```

where it is seen that slashes (/) are used as delimiters of the definition.

As seen, in the GAMS system the creation of entities like SETS (but also PARAMETERS etc.) involve two parts: a declaration and an assignment or definition. Declaration means declaring the existence of something and giving it a name. Assignment or definition means giving something a specific value or form. Declaration and definition may be done in separate statements or (except for EQUATIONS) in the same statement (as above).

Sets may be given as subsets of previously defined sets, e.g.,

```
SET HYDROCOUNT(COUNTRIES) / NORWAY, SWEDEN /;
```

Sets may have their membership explicitly defined (i.e., the labels are given between slashes) at the time the SET itself was declared (in which case the sets are called static sets), or the membership may be defined by assignment (dynamic sets), see further Section 3.8.1.

A shorthand asterisk notation like SET /S1\*S52/ may be used to indicate the labels S1, S2, ..., S52.

The entry order of the labels is the order in which the individual labels first appear in the program, either explicitly or as a result of using the shorthand asterisk notation. The entry order has implications for e.g. LOOP and DISPLAY statements. It also has implications in relation to ordered sets, see Section 3.2.4. Section 10.1 describes how a list describing the entry order may be obtained.

The ALIAS statement is used to define sets that are identical, but which have different identifiers (names). Hence, in relation to the above example, ALIAS (COUNTRIES,C) declares the set C and defines it to be identical to the set COUNTRIES.

Reference to individual members of sets may be given using quotation marks, thus in relation to the above set an individual country may be addressed as "DENMARK" or 'DENMARK'.

Sets may be one-dimensional or multi-dimensional and they may be ordered or unordered, see further Section 3.2.4.

## Scalars and Parameters

The parameters and scalars are used to specify exogenous values.

Parameters are specified for some or all elements in a set, or for cartesian products of sets. The parameter DH, for instance, specifies the annual heat demand in an area (e.g., a city). Therefore this parameter is declared as DH(YYY,AAA), and hence it is clear that it refers to all combinations of elements (also referred to as the set product or cartesian product) in the sets YYY (all years) and AAA (all areas).

Scalars are also used to specify exogenous values, however, scalars are not related to any sets.

Parameter and scalar values may be specified directly by the user, for parameters often in a TABLE, or they may be calculated in the model from other values. Parameters and scalars that are not explicitly assigned a value are automatically set to the default value zero.

## Variables

The variables of the model are endogenous, i.e., those entities that are determined internally in the model by solving the specified model. In the Balmorel model, a typical examples is the generation of electricity on a specific generation unit in a particular time period.

Variables are declared by the VARIABLE statement, and they may be declared to be e.g. POSITIVE (meaning that they can attain only non-negative values) or FREE (meaning that they can attain any real values).

The values of the variables are to be found according to the problem type specified, typically by optimisation. However, variables may have their values fixed (by appending .FX), or they may be bounded downwards and/or upwards (by appending .LO and/or .UP, respectively).

The numerical values of variables are referred to by the suffix .L. Marginal values to equations are referred to by the suffix .M.

## Naming restrictions

Identifiers are the names given to SETS, PARAMETERS, SCALARS, VARIABLES, EQUATIONS and MODELS. A label is the name of a set element. The types and number of characters of identifiers and labels are limited according to the GAMS syntax (page 9). In addition, conventions are applied in the Balmorel model (involving among other things the restriction to ten characters) (Section 1.4).

Obviously, words that have predefined meanings in the GAMS language (reserved words, key words) can not be used (e.g., MODEL, SET, INF, TABLE, LP).

And finally: GAMS is not case sensitive, thus e.g. the identifiers balmorel, Balmorel and BALMOREL are interpreted to be identical. (But observe, that the editor that the user applies may very well be case sensitive, and so may the operating system, cf. 1.3.)

## Arithmetic expressions

The language permits the formulation of arithmetic expressions in a form that is fairly easily understood. Thus, e.g. the expression SUM(T, X(T)) can be read to mean the sum over the elements in the set T of the quantities X(T), where X is a vector with one element for each member in the set T. Similarly, PROD, SMAX and SMIN means the product, maximum value and minimum value, respectively, over the specified set. In contrast, MIN and MAX operate on lists of arguments.

The interpretation of the arithmetic operators "+", "-", "\*" and "/" is straightforward. The traditional relational operators <, ≤, =, ≥, >, ≠ are specified as such, or as LT, LE, EQ, GE, GT, NE respectively, except in EQUATIONS, where ≤, = and ≥ are specified as =L=, =E= and =G=, respectively. The "=" is used in assignments, e.g. PI=22/7.

## Extended arithmetic

Extended arithmetic is allowed to include the value infinity, denoted INF. Thus, 6/INF is evaluated to zero, INF+INF is evaluated to INF, INF-100 is evaluated to INF, 8\*INF is evaluated to INF and -INF is minus infinity. The expressions 0\*INF

and INF-INF are illegal. Also related to the implementation of extended arithmetic are NA (not available: thus e.g. 7+NA evaluates to NA), UNDF (undefined) and EPS (a number very close to but different from zero).

### **Conditional, logical, dollar expressions, exceptions**

Various means may be used in order to formulate conditional expressions. Constructions using IF, ELSE and ELSEIF are similar to those found in common programming languages. Logical expressions may be made using NOT, AND, OR and XOR. Numerical values of parameters and scalars may be interpreted as logical values using the conventions that the value 0 means NO and other values means YES. GAMS further has the dollar (\$) operator to permit conditional operations, loosely speaking corresponding to a conventional IF condition. An expression like SUM(X\$MYPARM(X), ...) (where X is a set and MYPARM a parameter) is interpreted as summation of MYPARM over all those elements in X for which MYPARM(X) is not 0. (Due to the data representation used in GAMS, this is very efficient if MYPARM(X) is 0 for most elements in X.) Consult the GAMS User's Guide.

### **Sequence of statements, flow control**

The sequence of the statements in GAMS is important. The statements of the model are normally executed sequentially.

However, control of this flow may be performed by using LOOP, IF-ELSE (including extensions using ELSEIF). The LOOP statement causes the execution of the statements within the scope of the loop for each member of the driving set(s) in turn. Thus e.g. "LOOP(C, ... )" is similar to "for all elements in turn in set C do ...". The order of execution within the loop is the entry order (Section 3.2.4) of the labels. The construction using FOR-TO, FOR-DOWNTO and WHILE statements are avoided, see page 9.

### **Entry of numerical data**

Numerical data may be entered along with declaration of PARAMETERS or SCALARS or by assignment. For multi dimensional parameters, the TABLE is convenient. The layout of a TABLE is quite flexible. Thus, if a table has too many columns to fit nicely on a single line, then the columns that do not fit can be entered below (using the symbol "+" for continuation); thus, row labels, unlike column labels, may be duplicated. Data may be entered directly, or they may be calculated and assigned using "=" . Observe that declarations can not come after assignments, and an assignment overwrites previous assignments. The extended arithmetic symbols INF, NA and EPS (but not UNDF) may be used in input.

### **Default data**

It is very useful to note that if data are not entered for parameters or scalars then by default the value zero is assigned.

However, not all elements can be given by default, at least one must explicitly be given a value, otherwise it is considered an error.

### **Comments and explanations**

Comments may be entered in a line, if the line has a "\*" in the first column. In particular, this may be used for commenting out a command. Comments may also be inserted between "/\*" and "\*/" (provided it is preceded by "\$ONINLINE", preferably placed near the top of the BALMOREL.GMS file), or between "\$ONTEXT" and "\$OFFTEXT" (where the \$'s must be in the first position of a line).

It is possible to associate explicative text with set element, parameters etc. For example, "SET CCC All Countries" or "PARAMETER DE(YYY,RRR) Nominal annual electricity demand". The explicative text may be given between quotes (and must be so, if special characters are used). Such text may be displayed in output, see Section 10.

### **Include files**

In GAMS, the input may be split over several files. This is handled by include files. This means that the content of a file (typically with the extension "inc") may during compilation of the model be included in another file. Thus, for instance the contents of the file "TRANS.INC" is placed in this other file (e.g., BALMOREL.GMS) at the place where the statement "\$INCLUDE TRANS.INC" (or "\$INCLUDE "TRANS.INC";", but not "\$INCLUDE TRANS.INC;") is found.

### **Equations and Model**

See Section 8.

### **Solver**

For the solution of the model a solver has to be used. Thus, the GAMS system passes the model to the solver, which solves the problem and passes the solution and related information back to the GAMS system, which in turn permits presentation of the solution and related information in various forms. Also default and error information, e.g. if the problem does not have a solution, will be returned.

### **Output, Errors etc.**

See Section 10.

## **1.4 Naming conventions**

We have tried to select names for the various sets, parameters etc. to facilitate the recognition of the meaning from the name. Observe that names are limited to ten characters; this facilitates the printing of output and compatibility with older versions of GAMS, cf. page 9. The following conventions for names are used:

Single letters:

D: demand (e.g., DE: demand for electricity, DH: demand for heat)

E: electricity

F: fuel

F: flexible (e.g., DEF: flexible (i.e. elastic) electricity demand, DHF: flexible heat demand)

G: generation, or generation technologies (e.g., GE: generation of electricity, GDINVCOST: investment cost for generation technology)

H: heat

I: internal (set, scalar or parameter)

K: capacity

M: emission

N: new

O: related to output from simulations

Q: equation

V: variable (see also VQ)

X: electricity transmission

Suffixes:

\_T or T: the finest division of time is the subdivision of the season (e.g., one hour; or night-period, day-period, peak-hour) (and implicitly or explicitly also contains season and year index), cf. Section 3.2.2

\_S or S: the finest division of time is the subdivision of the year into seasons (e.g. summer, winter; or Jan, ... , Dec) (and implicitly or explicitly also contains year index), cf. Section 3.2.2

\_Y or Y: the year, annual

Further:

BPR: back pressure generating technology

CAL: calibration

CND: condensing generating technology

DIS: distribution

EXT: extraction generating technology

FLH: full load hours

FX: fixed, given, exogenous

HOB: heat only boiler generating technology

HY: hydro technology (GHYRS: with seasonal reservoir, GHYRR: run-of-river)

INI: initial

INV: investment

LIM: limit

OM: operation and maintenance (OMF: fixed, OMV: variable)

POL: policy (with respect to taxation, emission quota)

SOL: solar, sun

STO: storage (typically daily, HSTO: heat, ESTO: electricity)

VAR: variation over the time segments of the day and year

WND: wind

WTR: water (energy source)

VQ: variable that ensures feasibility in an equation

COMB: combination technologies

File extensions:

med: intermediate file (from one program to another)

gms: gams file, the main file

inc: include file

sim: simulation file

opt: option file

out: output file

cmp: compare

See also Section 10.2 concerning output files.

## 1.5 User interface

The GAMS program is contained in ascii files, hence any editor that can produce, read, modify and save such files may be used. Special editors suited for GAMS exist. Do not use tabulator, cf. page 9.

The user must make sure that the GAMS system is set up properly and in relation to the file structure described in Section 2.

For the Balmorel project, various spreadsheet interface facilities are available, cf. the home page.

## 1.6 Limitations and expected modifications

We are not aware of any errors in the present version, however, it includes elements that are not yet completely integrated:

- The set  $IST(S,T)$  is introduced, however, advantage can not be taken of it since the implementation is not complete. (Not yet:  $SET\ ISTT(T)$ ;  $SET\ ISTS(S)$ ; defined by  $LOOP((S,T)\ \$IST(S,T),ISTT(T)= YES)$ ;  $LOOP((S,T)\ \$IST(S,T),ISTS(S)= YES)$ ).  $ISTS$  is used to hold the subsets of  $S$  for which there is at least on  $T$  such that  $(S,T)$  is in  $IST(S,T)$ . Introduced to get more flexibility in definition of time segmentation of the year. Observe that it can not be used i definition of equations that involve lead or lags (typically i relation to storage)). Section 3.8.8.
- GDCH4 emission not fully implemented.
- FDN2O emission not fully implemented.
- GDLIFETIME not used (so for investments, the standard period implied by ANNUITYC is used).
- Minimum and maximum limits for hydro power storage works only correctly for problems without new investments permitted for this type.
- Heat storage only implemented with no new investments.

Version for handling hourly simulation throughout a year and for analysis of electricity market power are expected to become available during 2004.

## 2 File Structure

The model is distributed over a number of files. In this section we give an overview.

The files are ascii files, cf. Section 1.5.

In the base directory (e.g. taken from the home page [www.balmorel.com](http://www.balmorel.com) at the Internet or from a diskette) you should find the following subdirectories:

- Model
- LogError
- PrintInc
- PrintOut

This should be copied to the user's computer. The user may find it expedient to maintain this version unaltered, and therefore for an application a copy should be made, e.g. with the name "Balmorel-MyVersion1", containing the above mentioned subdirectory structure and the file structure mentioned in the sequel.

File and path names should not include special characters like æ, å, ö, ì, ß, œ, or similar, and should be limited to eight characters. Observe that file and path names will be case sensitive in Unix and Linux. Cf. Section 1.1.

The above mentioned subdirectories, Model, PrintInc, PrintOut and LogError are mandatory in order to run the model. Other subdirectories may exist, e.g. 'documentation', 'data-pre-inc', but are not required for the functioning of GAMS.

### Subdirectory Model

The Balmorel model is located in the subdirectory Model. Here the following files are found:

- BALMOREL.GMS: main model file (running this means running the model)
- SETS.INC: contains the declaration and definition of the static sets (see Section 3.8.1) in the model
- GEOGR.INC: contains most values specific for geographical entities
- FUEL.INC: contains values specific for the different fuel types
- TECH.INC: contains the parameters of the generation technologies in use
- TRANS.INC: contains the parameters related to electricity transmission between regions
- VAR.INC: contains daily and seasonal variations of all relevant parameters
- DE.INC: contains annual values of electricity demand
- DH.INC: contains annual values of heat demand
- FUELP.INC: contains annual values of fuel prices
- MPOL.INC: contains annual values of environmental policy
- GKFX.INC: contains annual values of exogenously specified generation capacities
- X3.INC: contains annual values of electricity exchange with countries (regions) not explicitly modelled
- balgams.opt: contains options for GAMS
- balbase1.sim: contains specification of the simulation/optimisation to be performed - balbase1 is without endogeneous investments.
- balbase2.sim: contains specification of the simulation/optimisation to be performed - balbase2 is with endogeneous investments..

These files together contain the model (balgams.opt does not hold any part of the real model). The BALMOREL.GMS file is the main file, while the others are include files (Section 1.3) which during compilation of the model automatically are inserted into the appropriate places in the BALMOREL.GMS file or elsewhere.

All user specified labels and numerical data are found in the include files.

The distribution of the different input data (sets, parameters etc.) over the files is done according to the following principles,

- SETS.INC contains declaration and definition of all static sets (see Section 3.8.1). Also the scalar PENALTY and the parameter YVALUE are in this file.
- TECH.INC contains global information about generation technologies, i.e., information that is not specific to geography. Therefore, all data structures that contain the index pair (GGG,GDATASET), and no other indexes are in this file.

- FUEL.INC contains global information about fuels, viz., information that is not specific to geography or time. Therefore, all data structures that contain the index pair (FFF,FDATASET) and no other indexes are in this file.
- TRANS.INC contains information about transmission conditions between pairs of regions. Therefore, all data structures that contain the index pair (IRRRE,IRRRI) and no other indexes are in this file.
- GEOGR.INC contains all information that is specific with respect to geography, except that which contains information relative to time (i.e. except that which contains indexes YYY, SSS or TTT), and except that which contains information about transmission between regions (i.e., except that which contains the index pair (IRRRE,IRRRI)).
- All data that depend on the year are placed in separate files:
  - DE.INC contains annual electricity demand for each year.
  - DH.INC contains annual heat demand for each the year.
  - GKFX.INC contains user specified installed generation capacity for each year.
  - X3.INC contains annual electricity exchange with third regions.
  - FUELP.INC contains fuel prices for each year.
  - MPOL.INC contains environmental policy data for each year.
- VAR.INC contains information about the variation of parameters within the year. Therefore, all data structures that contain indexes SSS and/or TTT are in this file.

See Section 13 for exact locations.

After running the model, GAMS will automatically have created two additional files that will be placed in the subdirectory Model (if the GAMS program has this directory as its base; if not, the files may be placed elsewhere):

- BALMOREL.LST
- BALMOREL.LOG

See Section 10 for more on this.

### **Subdirectory Data-pre-inc**

This optional subdirectory contains various data and facilities for preparing some of the include files found in subdirectory Model. The user may find it expedient to create subdirectories. This will not be described further in the present document.

### **Subdirectory PrintInc**

In addition to the files mentioned above there are in the subdirectory print auxiliary files that are not proper part of the model, but which provide various possibilities for generating output from successful model runs:

- PRINT1.INC: declares file names for predefined output and various parameters and sets that may be useful for creating output
- PRINT2.INC: declares parameter names for output that can be written for each year of the simulation
- prt3-bb1.inc: calculates the values of the parameters declared in PRINT2.INC relevant for model BALBASE1

- prt3-bb2.inc: like prt3-bb1.inc but for model BALBASE2
- prt4-bb1.inc: specifies for model BALBASE1 which output from the most recently simulated year to write to a file, by including files found in the subdirectory print
- prt4-bb2.inc: like prt4-bb1, but for model BALBASE2
- Several output generating files are found in the subdirectory print. They are all auxiliary include-files. They are controlled by the above PRINT\*.INC files. See Section 5 and Section 10.

These files may be omitted (commented out) in the BALMOREL.GMS file without effecting the model itself. However, if they are not commented out, they must exist. We refer to such additional components as auxiliary parts. See Section 10.

### Subdirectory LogError

This subdirectory contains auxiliary parts for checking the input data and monitoring the solution of the model.

- ERROR1.INC: declares file names for predefined output, ERRORS.OUT and LOGFILE.OUT
- ERROR2.INC: makes some simple checks of the input data and prints the conclusion to the file ERRORS.OUT. A summary is printed in the file LOGFILE.OUT.
- ERROR3.INC: makes some simple checks immediately before optimisation starts and prints the conclusion to the file ERRORS.OUT. A summary is printed in the file LOGFILE.OUT.
- ERROR4.INC: makes some simple checks immediately after optimisation starts and prints the conclusion to the file ERRORS.OUT. A summary is printed in the file LOGFILE.OUT.
- balbase1.mss: prints in the file LOGFILE.OUT a summary of the contents of the file ERRORS.OUT, and in addition model and solver status for model BALBASE1 (the extension 'mss' indicates 'model and solver status').
- balbase2.mss: like balbase1.mss, but for model BALBASE2.

These files may be omitted (commented out) in the BALMOREL.GMS file (or wherever they are included) without effecting the model itself. However, if they are not all commented out, at least ERROR1.INC must be included. See Section 10 and Section 11.

### Subdirectory Output

All the output specified by files in the print subdirectory is placed in the output subdirectory. The output generated from Error and Log files is placed in the LogError subdirectory.

Output generated automatically by the GAMS system will be placed in the Model subdirectory, cf. above.

In the output subdirectory additional facilities for presentation of output (e.g. in the form of spreadsheets) may be located. See Section 10.

Observe that by running GAMS any previous output in existing files may be overwritten. It is therefore recommended that the user creates a number of subdirectories (e.g. to the subdirectory Output) where output can be saved before the next GAMS run.

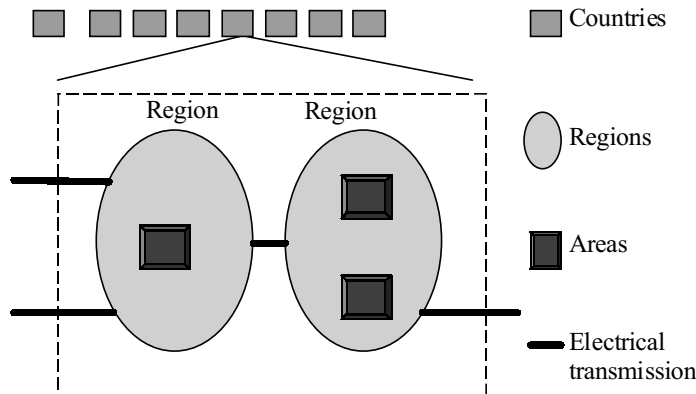


Figure 1: The geographical entities.

### Subdirectory Documentation

In this optional subdirectory various documentation files may be placed. Also here the user may find it expedient to create subdirectories.

## 3 Sets

In this section we describe the sets in the model. According to the distinctions in Section 1.2 we shall describe the sets in the data structure, and the subsets that may be used for specific simulations. The names of the sets in the first group usually have triple letters (e.g., CCC, TTT).

Most of the sets have their members (elements, labels) specified by the user. We refer to those sets as input sets. Some sets are derived automatically from previously given sets, we refer to such sets as internal sets, Section 3.8. Section 3.9 lists some restrictions.

All sets are declared and defined in the file SETS.INC, see Section 2, except for internal sets (Section 3.8) that are declared and defined in the file BALMOREL.GMS.

### 3.1 Geography

The model permits specification of geographically distinct entities. The types of geographical entities are Areas, Regions, and Countries. These entities are in relation to the data structure specified by the sets AAA, RRR and CCC, and for the subsets to be used for simulation by the subset C.

Each country is constituted of one or more regions while each region contains zero or more areas. Any area must be included in exactly one region, and any region must be included in exactly one country, see also Figure 1 and Section 3.1.5.

The areas are the building blocks with respect to the geographical dimension. Thus, for instance all generation and generation capacities are described at the level of areas, and so are all aspects of heat demand; see the list below.

Areas are classified and grouped in a number of ways. The collection of subsets of areas into regions was described above, and further examples are given in Section

### 3.8.3.

Electricity balances are given on a regional basis. For each element in RRR electricity generation comes from the elements of AAA located in RRR. Hence, for each region an electricity balance must be fulfilled, but unlike heat, electricity may be exchanged between regions. Such transmission, and their constraints, losses and costs, are the motivation for the concept of regions. In contrast to this, transmission of heat between areas is not possible.

A number of regions (i.e., a nonempty subset of RRR) constitute a country. The country does not have any generation or consumption apart from that which follows as the sum over the regions in the country. However, a number of characteristics may be identical for all entities (e.g. generation units, demands, prices and taxes) in a country. A country is constituted of more than one region when needed to represent bottlenecks in the electricity transmission system within the country.

The following entities are related to countries:

- annuity
- taxes
- environmental policy
- availability of certain fuels

The following entities are related to regions:

- related to electricity demand:
  - annual nominal electricity demand
  - variation within the year of the nominal electricity demand
  - deviation from nominal electricity demand
  - consumer price base for electricity
  - variation within the year of the consumer price base for electricity
- related to electricity transmission and distribution:
  - losses in electrical distribution
  - cost of electrical distribution
  - cost of electrical transmission
  - losses in electrical transmission
  - electricity export to third countries
  - variation within the year of the electricity export to third countries
  - initial capacity on electrical transmission
  - investment cost for new electrical transmission capacity
- related to energy and fuels:
  - availability of certain fuels

The following entities are related to areas:

- related to heat demand:
  - annual nominal heat consumption
  - variation within the year of the nominal heat demand
  - deviation from nominal heat demand
  - price base for heat

- variation within the year of the consumer price base for heat
- related to heat distribution:
  - losses in heat distribution
  - cost of heat distribution
- related to technologies:
  - operation and maintenance cost for technologies
  - capacity reduction factor for technologies
  - efficiency reduction factor for technologies
  - initial capacities of generation technologies
  - investment cost for new technology
- related to fuels:
  - fuel price
  - availability of certain fuels
  - annual quantity and variation between the seasons of water availability for dispatchable hydro generation
  - annual quantity and variation within the year of non-dispatchable hydro generation
  - annual quantity and variation within the year of wind power generation
  - annual quantity and variation within the year of solar voltaic generation

The specification in Section 4 is structured according to the sets on which parameters are defined, hence refer to the Section 4 part of the table of contents to get an overview of the precise dependencies on geographical entities.

### 3.1.1 Countries: C, CCC

SET CCC contains the countries in the data structure (cf. Section 1.2), e.g.:

```
SET CCC /DENMARK, NORWAY, SWEDEN / ;
```

SET C(CCC) is the subset used to define those countries that are simulated. Observe, that if C is a proper subset of CCC then automatically the regions in the countries not included in C are excluded from the model, see Section 3.1.2 (and similarly with the areas not in regions in the countries in C, see Section 3.1.3). (An obvious implication of exclusion of a region is that electricity exchange with that region is not possible (therefore variables VX\_T (Section 6) relative to the excluded region will not be included in the model).)

### 3.1.2 Regions: RRR

SET RRR contains the set of regions in the data structure, e.g.:

```
SET RRR / DK_E, DK_W, NO_R, SE_R / ;
```

As the choice of names indicates, Denmark is considered to consist of two regions, while Norway and Sweden each consists of one region.

If a restructuring of a country is desired, so that the number of regions is changed, this will involve restructuring of the associated data as well, see Section 12.

The simulated subset IR of RRR is described in Section 3.8.5 along with other variants of RRR.

### 3.1.3 Areas: AAA

SET AAA contains the set of all areas in the structure, e.g.:

```
SET AAA
/ DK_E_Copnh, DK_E_Other, DK_W_Odens, DK_W_Arhus, DK_W_Other,
NO_R_Oslo, NO_R_Other, SE_R_Sthlm, SE_R_Rural / ;
```

If a restructuring of a region is desired, so that the number of areas is changed, this will involve restructuring of the associated data as well, see Section 12.

The simulated subset of AAA is described in Section 3.8.2 and other subsets are described in Section 3.1.4.

### 3.1.4 Urban and rural heat areas: AAAURBH, AAARURH

The set AAA of areas is classified according to a variety of principles. This is done by definition of a number of subsets (that may be overlapping) of AAA or subsets of set products that involve AAA. In the following the classification according to heat demand is described. Further examples are given in Section 3.5 and Section 12.

With respect to satisfaction of heat demand the areas are of two kinds, urban and rural. In the urban heat areas there may be an economic dispatch (i.e., a distribution of generation among the units varying over time according to economic principles) of heat between generation units. This is not the case in the rural heat areas where heat production is proportional between the different production units. See also Table 4 page 36.

The set AAARURH of the rural heat areas in the data structure is defined as a subset of AAA as in the following example:

```
SET AAARURH(AAA) / DK_E_Other, DK_W_Other, SE_R_Rural / ;
```

The set AAAURBH of the urban heat areas in the data structure is defined similarly. Note, that the two sets AAARURH and AAAURBH should not be overlapping.

The subsets IARURH and IAURBH used in simulation are then found automatically, see Section 3.8.3.

### 3.1.5 Relations between C, R and A: RRRAAA, CCCRRR

Given the definitions of the sets CCC, RRR, and AAA above the sets (mappings) RRRAAA and CCCRRR are defined in order to specify the connection between the sets, i.e., RRRAAA specifies which areas that belong to which regions, and CCCRRR specifies which regions that belong to which countries. Thus, RRRAAA(RRR,AAA) specifies the relation between RRR and AAA and CCCRRR(CCC,RRR) specifies the relation between RRR and CCC, as the following example shows:

```
SET RRRAAA(RRR,AAA)
/ DK_E.(DK_E_Copnh,DK_E_Other)
DK_W.(DK_W_Odens, DK_W_Arhus, DK_W_Other)
NO_R.(NO_R_Oslo,NO_R_Other)
SE_R.(SE_R_Sthlm,SE_R_Rural) / ;

SET CCCRRR(CCC,RRR)
/ DENMARK .(DK_E,DK_W)
NORWAY .(NO_R)
SWEDEN .(SE_R) / ;
```

Observe the use of the dot and the parentheses.

The internal set ICA(C,AAA) specifies the relation between AAA and C, see Section 3.8.4.

## 3.2 Time

The description of the time dimension in the model may be divided into two parts: that which refers to the years and the relations between them, and that which refers to the aspects of time within the year.

The following entities are specified (exogenous) or found (endogenous) within a subdivision of the year:

- generation (exogenous and endogenous)
- relative weight of time segment
- capacity derating of generation units
- availability of hydro
- demands for electricity and heat
- calibration parameters relative to demands for electricity and heat
- flexible demands related parameters
- electricity exchange with third regions

The following entities are the same throughout each year, but may be different from one year to the next one:

- nominal generation capacities
- fuel prices
- emission limitations and taxes

The following entities are the same for all years in the data structure:

- characteristics of generation technologies (except that some may be available only from a certain year, and except for capacity derating)
- annuity
- distribution and transmission characteristics
- costs (except fuel costs)
- fuel potentials, including water availability
- taxes (except those related to emissions)
- variations within the year
- demand elasticities
- fuel characteristics (except prices)

The specification in Section 4 is structured according to the sets on which parameters are defined, hence refer to the Section 4 part of the table on contents to get an overview of the precise dependencies on geographical entities.

### 3.2.1 The years: YYY, Y

The years represented in the data structures are given by the SET YYY, e.g.:

SET YYY / 1995 \* 2030 / ;

where the asterisk notation using "\*" implies that the years from 1995 to 2030 are included.

The subset of years simulated is given by the SET Y(YYY).

Comment on naming conventions: The only labels consisting of digits only are those used for set elements YYY (and therefore also those in the subset Y(YYY)).

The sets YYY and Y are ordered, cf. the comments in Section 3.2.4 on ordered and unordered sets.

### 3.2.2 Time segments within years: SSS, S, TTT, T

The subdivision of the year into seasons is given by SET SSS specified e.g. as the following:

$$\text{SET SSS} / \text{S1} * \text{S4} / ;$$

and the subdivision of the time within the season of a season is given by SET TTT, e.g.,

$$\text{SET TTT} / \text{T1} * \text{T8} /$$

These examples mean that the year is divided into four seasons, and that each season has been subdivided into eight time segments (sub periods). We refer to the part of the year specified by (S,T) as a time segment (or more specifically as a time segment of the year) and to the part of the season specified by T as a time segment of the season.

(It is tempting to say that the set TTT represents a subdivision of the day - and we may actually do so sometimes. However, is not in general correct to say so, see Section 4.4.1.)

The extension - weight, duration - of each time segment in S and T is held in the parameters WEIGHT\_S and WEIGHT\_T, respectively, cf. Sections 4.3.1 and 4.4.1.

The seasons and time periods used in simulation are specified by the sets S(SSS) and T(TTT), respectively. S and T should be ordered, cf. Section 3.2.4.

Observe that all the descriptions of the subdivision of the year are the same for all the geographical entities (countries, regions, and areas, i.e., the sets CCC, RRR and AAA) and for all the years (the set YYY) in the model.

Comment on input data: It will be assumed that the year has 365 days and 8760 hours.

See also Section 4.29.7 and Section 4.29.8.

Comment on naming conventions: For chronological specifications of time segments the naming of the individual seasons will start from winter (i.e. the first season will include January 1st), and the naming of the time periods of the day will start at midnight, see also Sections 4.3.1 and 4.4.1. The labels should therefore be entered in such sequence, in particular in relation to application of ordered sets, cf. Section 3.2.4.

Obviously there are some interdependencies between the subdivision of the year into seasons and the further subdivision of the seasons, and this could expediently be reflected in the naming. The following convention may be used for naming the seasons: SET SSS may be defined as e.g.

$$\begin{aligned} &\text{SET SSS} / \text{S1} / ; \text{ or} \\ &\text{SET SSS} / \text{S2}_1, \text{S2}_2 / ; \text{ or} \\ &\text{SET SSS} / \text{S1} * \text{S4} / ; \text{ or} \\ &\text{SET SSS} / \text{S12}_01 * \text{S12}_12 / ; \text{ or} \\ &\text{SET SSS} / \text{S52}_01 * \text{S52}_52 / ; \end{aligned}$$

This gives the possibilities of representing the year with 1, 4, 12 or 52 seasons, respectively.

Similarly, SET TTT may be defined as e.g.

$$\begin{aligned} &\text{SET TTT} / \text{T1} / ; \text{ or} \\ &\text{SET TTT} / \text{T2}_1, \text{T2}_2 / ; \text{ or} \\ &\text{SET TTT} / \text{T8}_1 * \text{T8}_8 / ; \text{ or} \\ &\text{SET TTT} / \text{T168}_001 * \text{T168}_168 / ; \end{aligned}$$

giving the possibilities to represent the subdivision (the "day") of the season with 1, 2, 8 or 168 segments, respectively.

It is easy to aggregate time within the year such that the model uses only annual data, i.e., there is no subdivision into seasons nor any subdivision of the

	GMT	DK	EE	FI	DE	LV
Summer	0	2	2	3	2	2
Winter	0	1	1	2	1	1
	LT	NO	PL	RU (West)	RU (Kaliningrad)	SE
Summer	2	2	2	4	3	2
Winter	1	1	1	3	2	1

Table 1: Time zones in the Baltic Sea Region relative to GMT (based on <http://time.greenwich2000.com/>). Observe that these conventions seem to be quite unstable.

season into sub-periods. This is achieved by specifying the sets S and T to contain only one member each, e.g.: "SET S(SSS) /S1/" and "SET T(TTT) /T1/". It is also easy to use other subsets S and T. E.g., if SSS is defined as "SET /S12\_1 \* S12\_12/" to represent the twelve months of the year, then specifying SET S(SSS) / S12\_1, S12\_7 / means that only January and July will be used in the simulations to represent the whole year. With e.g.

```
SET SSS / S1 * S12/;
SET TTT / T1 * T12/;
```

a simulation with all 144 time segments will be specified as

```
SET S(SSS) / S1 * S12/;
SET T(TTT) / T1 *T12/;
```

and a simulation with the four time segments (S2,T1), (S2,T5), (S10,T1), (S10,T5), per year will be specified as

```
SET S(SSS) / S2, S10/;
SET T(TTT) / T1, T5/;
```

Further refinements are possible via the set IST, Section 3.8.8.

Comment on input data: Demand for electricity is specified for each region. If demand is not synchronous between the regions, this will motivate exchange between the regions. In particular, this may be relevant for regions far apart in the east - west direction, because in this case there may be a time zone difference. This is more outspoken the larger the difference in time zone is in relation to the length of the time segments in TTT. Table 1 illustrates for the Baltic Sea Region the local time zones relative to GMT.

### 3.2.3 Daytypes: workdays and weekend

The time segments T within a season S may be seen as representing a typical week. For some purposes it may be useful to distinguish between different types of days, e.g. working days (Sunday through Friday) and weekend days (Saturday - Sunday). This may be accomplished using the set DAYTYPE 'Types of days within the week' /WORKDAY, WEEKEND/.

The assignment of time segments T to the two types of days is done in TWORKDAY and TWEEKEND, e.g. SET TWORKDAY 'Time segments T in workdays' /T1\*T8/, and SET TWEEKEND 'Time segments T in weekends' /T9\*T12/.

### 3.2.4 Ordered and unordered sets

Sets in GAMS may be ordered or unordered. Ordered sets are static in the sense that they are initialised by having their elements specified between "/" and "/" at the time of declaration, and the sets are never changed afterwards. They are ordered in the sense that the order in which the labels appear in the GAMS

program is the same as the order in which they appear in the initialisation of the set (the entry order). See also Section 3.8.1.

For ordered sets, the elements have a sequence, viz., that given in the initialisation. Hence, for such sets it is possible to know if one element is "before" or "after" another one in the set, implying in relation to modelling that chronological phenomena may be represented. The operators '+' and '++' are used to indicate "the next" element, the latter further indicates a cyclical concept where "the first" is the successor to "the last".

The function ORD applied to an element in a one-dimensional static and ordered set returns the number of that element in the sequence. Thus for SET SEASONS /winter, spring, summer, autumn/, ORD("summer") attains the value 3. The function CARD returns the number of elements in a set (also for an unordered set), hence e.g. CARD(SEASONS) attains the value 4.

It is essential that the sets YYY, Y, SSS, S, TTT and T are ordered. For set S this may for instance be used for modelling of hydro power with reservoirs, where it is desired to represent that the contents of the reservoir at the beginning of a season equals the contents at the beginning of the previous season plus the inflow during the previous season, minus the water used for generation during the previous season. For set T this may similarly be used for modeling hydro power with reservoirs for shorter operation cycles (e.g. pumped storage suited for leveling of variations within the day or the week), or similarly for short-term heat storage. (See also Section 4.4.1.)

### 3.3 Generation technologies: GGG, G, GDATASET, GGCOMB

SET GGG is the set of generation technologies (i.e., hardware for transformation of energy) in the structure, given as e.g.

```
SET GGG
/CC-Cond1, ST-Cond1-G, ST-Cond1-O, CC-Co-B95,HO-Pump, HO-W-Old,
HO-CHP-G, HYDRO, GWIND1, GWIND2 /;
```

SET G(GGG) is the set of generation technologies simulated, e.g.

```
SET G(GGG) / ST-Cond1-O, HO-CHP-G, GWIND2 /;
```

Subsets of G are described in Section 3.8.9.

The set GDATASET is the set of attributes of generation technologies:

```
SET GDATASET / GDTYPE, GDFUEL, GDCB, GDCV, GDFE, GDES02,
GDNOX, GDCH4, GDAUXIL, GDINVCOST0, GDOMVCOST0, GDOM-
FCOST0, GDFROMYEAR, GDLIFETIME, GDKVARIABL, GDCOMB,
GDCOMBSK, GDCOMBSLO, GDCOMBSUP / ;
```

Descriptions are given in Section 3.8.9 and in Section 4.13.1.

Observe that the user should not change this set without proper knowledge of the functioning of the set. Thus, the set can not be reduced from that specified above since data will be needed in the model for each of the elements, see Section 4.13.1. The set may be enlarged with new elements, however then the user will have to specify in the model how these elements are to be used.

The data corresponding to the elements GDINVCOST0, GDOMVCOST0 and GDOMFCOST0 are considered as default values that may be overwritten, see Sections 4.13.1, 4.10.1, 4.10.2 and 4.10.3.

The data are further discussed in Section 4.13.1.

Comment on naming conventions: Observe that to distinguish technology from fuel (see Section 3.4) where similar labels (names) are tempting, the following is advocated: hydro power is called something indicating "hydro" as a technology, i.e., as an element in GGG, and something indicating "water" as a fuel, i.e., as an element in FFF (see Section 3.4). For all other ambiguous subjects, a prefixed

SET GGG	'All generation technologies'
/	
ST-Cx-CO	"Generic steam condensing coal - new"
ST-Cy-CO	"Generic steam condensing coal - old"
ST-G-NOS	"The proposed new natural gas - Norway South"
NU-BBackSE	"Swedish nuclear Barseback"
ST-B8-CO	"Generic CHP back pressure coal - old"
WI-L9	"Generic wind power - new"
WI-RS-DK	"New off shore wind - Roedsand, Denmark"
/;	

Table 2: Illustration of a convention permitting various levels of identification of generation units.

"G" is advocated for elements in GGG and no prefixed "G" for elements in FFF. E.g., a particular wind turbine could be e.g. "GWIND-2300" as an element in G but not as an element in FFF.

In the Balmorel the specification of a generation unit is done by referring to its name (according to the technology catalogue given by set GGG) and its geographical location (according to the area catalogue given by set AAA). Thus, a specific kind of technology may be represented in more than one area. The capacity GKFX (Section 4.22.1) of a particular generation unit must therefore be specified with indexes reflection this, i.e. GKFX(\*,AAA,G), where AAA represents geography and G represents technology kind.

The idea behind this is that for the geographical area considered (the Baltic Sea Region) it is not possible to get, nor sensible to use, precise information about all generation units. Therefore a limited number (approximately 50) of technology kinds have initially been specified in the set GGG. This moreover facilitates that aggregation of existing units into fewer but larger ones.

The expectation is, however, that with increased application of the model, some possibly with a national focus, more data will become available, and in specific applications there will be a desire to increase the level of detail in representation of technologies.

The GAMS syntax (Section 1.3) permits an explanatory text associated with (some or all) units in G. This identification is a possibility only, and therefore to use it systematically a convention is needed, and one such will now be described.

As illustrated in Table 2 the text associated with the label in the set GGG is used to describe the technology, and this description indicates how specific each technology is. The GAMS syntax permits up to 80 characters, all on the same line, preferable enclosed in (single or double) quotes. To provide nice single line printouts, at maximum of 50 characters is advocated.

Observe, though, that in the mechanisms of the Balmorel model this text is not used. Therefore the user must make sure that the data entered for each technology is consistent with the intention indicated in the text for that technology.

Thus, for a technology which is intended to be located in one area only, the user must make sure that this technology appears with positive capacity GKFX(\*,AAA,G) only in that area. If new investments are permitted the user must similarly make sure that the set AGKN(AAA,G) (Section 3.5) specifies that new capacity of the technology in question can only be established in the relevant area.

### 3.3.1 Combination technologies

The term combination technology will denote sets of two or more technology units that are combined. The purpose of this is to introduce the possibility to mix

linearly the properties of different technologies, in proportions that are results of the optimisation. Maximum and minimum shares on the proportion attained by each unit in a combination technology unit may be specified.

One example of an application is the combination of two technologies with different efficiencies but otherwise equal. In this case the optimisation will ensure that the less efficient technology will only be used if the more efficient one is already used at the specified maximum share. Another example is that one technology using coal is combined with one technology using gas. It may be specified that the production based on natural gas can be at most e.g. 0.8 (i.e., 80%) of total production while coal can be at most 0.5.

Application of combination technologies is assumed to be relevant only for technologies that traditionally are operated according to economic dispatch.

Here is the necessary input.

- The value in `GDATA(GGG,'GDCOMB')` is used to indicate combination technologies. The values are 0 (indicating that this is not a combination technology), 1 (indicating that this is a combination technology, and that it is the primary unit in a combination), 2 (indicating that this is a combination unit, and that it is a secondary unit in a combination (see below)).
- Define `GGCOMB(GGG,IGGGALIAS)` where the pair `(GGG,IGGGALIAS)` constitutes a combination technology combination, `GGG` must be a primary technology and `IGGGALIAS` must be a secondary technology. `GGG` and `IGGGALIAS` must be of the same technology type (as indicated in `GDATA(GGG,'GDTYPE')`). There can be more than one secondary technology to a primary technology, e.g., the definition `"SET GGCOMB(GGG,IGGGALIAS)/ Gex-prim.(Gex-secA, Gex-sec2, Gex-secS) /;"` is legal if the technologies `Gex-prim`, `Gex-secA`, `Gex-sec2`, `Gex-secS` are in `GGG`. A combination technology can be in only one combination technology combination.
- The technologies in a combination pair must be of the same type, specified in `GDATA('GDTYPE')`.
- Technologies can not be combination technologies if they are not dispatchable, and storage technologies can not be combination technologies. Hence, a combination technology in `G` must be in the set `(IGDISPATCH(G)- IGESTO(G) - IGHSTO(G))`.
- The value `GDATA(GGG,'GDCOMBSK')` specifies the maximum fraction (value between 0 and 1) of derated installed capacity of the combination technology that this technology can produce. This is used to assign upper bounds on the production variables. The fraction is defined with respect to `VGE_T` if `GGG` is in `IGKE`, `VGH_T` if `GGG` is in `IGHE`.
- The value `GDATA(GGG,'GDCOMBSLO')` specifies the minimum fraction (value between 0 and 1) that the production from technology `GGG` must constitute of total production from the combination technology combination of which `GGG` is part. The production in question is `VGE_T` if `GGG` is in `IGKE`, `VGH_T` if `GGG` is in `IGKH`.
- The value `GDATA(GGG,'GDCOMBSUP')` specifies the maximum fraction (value between 0 and 1) that the production from technology `GGG` must constitute of total production from the combination technology combination of which `GGG` is part. The production in question is `VGE_T` if `GGG` is in `IGKE`, `VGH_T` if `GGG` is in `IGKH`.
- Secondary technologies must have zero values in `GDATA(G,'GDINVCOST0')` and `GDATA(G,'GDOMFCOST')`. This may be interpreted to mean that all investment costs and fixed operations and maintenance cost are related to the primary technology.

- The values in GDATA for 'GDFROMYEAR', 'GDLIFETIME', 'GDKVARIABLE' must be the same for pairs of combination technologies in GGCOMB (GGG,IGGGALIAS).

Here are some details on the internal mechanisms.

- SET IGCORB1(G): The set of primary combination technologies in G. Defined as  $IGCORB1(G)=YES$(GDATA(G,'GDCORB') EQ 1)$ .
- SET IGCORB2(G): The set of secondary combination technologies in G. Defined as  $LOOP(IGCORB1, IGCORB2(G) = YES$((GDATA(G,'GDCORB') EQ 2) AND (GGCOMB(IGCORB1,G))))$ .
- IAGKN will automatically be set to true for secondary technologies with  $GDATA(G,'GKVARIABLE')$  equal to 1.
- The equation QECORBGKL(AAA,IGKE,S,T) secures that total electricity production from an existing combination unit in IGKE does not exceed total derated capacity. Similarly, the equation QHCORBGKL(AAA,IGKH,S,T) secures that total heat production from an existing combination unit in IGKH does not exceed total derated capacity. For new technologies the corresponding equations are QNECORBGKL and QNHCORBGKL.
- The equation QECORBSLO(AAA,G,S,T) secures that the share of electricity production from an existing combination unit is at least as specified in  $GDATA(GGG,'GDCORBSLO')$ . Similarly for equations QHCORBSLO, QNECORBSLO and QNHCORBSLO.
- The equation QECORBSUP(AAA,G,S,T) secures that the share of electricity production from an existing combination unit is at least as specified in  $GDATA(GGG,'GDCORBSLO')$ . Similarly for equations QHCORBSUP, QNECORBSUP and QNHCORBSUP.
- Observations, Possible errors:
  - Observation: In the print files the secondary units will not normally be identified as such.
  - Observation: Since secondary units have zero capacity it might be confusing that they may never the less have positive production.
  - Possible error: For combination units the capacity entered in GKFX, and possibly found endogeneously, refers to the primary combination technology. It is an error if secondary combination units have positive capacity in any area.
  - Possible error: Inconsistency between  $GGCOMB(GGG,IGGGALIAS)$  and  $GDATA(GGG,'GDCORB')$
  - Possible error: Check the values in  $GDATA(GGG,'GDCORBSK')$ ,  $GDATA(GGG,'GDCORBSLO')$ ,  $GDATA(GGG,'GDCORBSUP')$ .
  - Possible error: In the definition of  $GGCOMB(G,IGALIAS)$ , G must be a primary combination technology, and IGALIAS must be a secondary combination technology.
  - Possible error: The dollar control option \$ONEMPTY must be set.

### 3.4 Fuels: FFF, FDATASET, FKPOTSET

SET FFF is the set of fuels in the structure, given as e.g.

```
SET FFF /NUCLEAR, NGAS, COAL-HIGHS, COAL-LOWS, LIGNITE,
FUELOIL, SHALE, PEAT, WIND1800, WIND2300, WATER, BIO, SUN,
ELEC, GARBAGE /;
```

Observe that in all simulations the whole set FFF is used. If therefore a particular fuel is not desired, the technology that uses it could be excluded from GGG and G, or from G.

The set of fuels is divided into three subsets by definitions of SET FKPOTSETC(FFF), set FKPOTSETR(FFF) and SET FKPOTSETA(FFF). The subsets need not be mutually exclusive, nor need they together constitute FFF.

The subsets indicate whether the members have their potentials specified at the level of country, region or area, respectively.

The following could be the examples of definitions:

SET FKPOTSETC(FFF) / NUCLEAR, LIGNITE, SHALE, PEAT /;

SET FKPOTSETR(FFF) / WIND, WATER, SUN, BIO /;

SET FKPOTSETA(FFF) / NGAS, WASTE /;

Thus, if e.g. COAL and FUELOIL are included in the set FFF, no limit will be placed on the use of these fuels.

SET FDATASET is the set of attributes of fuels:

SET FDATASET / FDNB, FDCO2, FDSO2 , FDN2O /;

The FDNB contributes to the coupling between generation technology and fuel. In GDATASET (Section 3.3) the elements GDFUEL for each technology contains an integer that points to the FDNB for the fuel that the technology uses, cf. also Sections 4.8.1 and 4.13.1.

Observe that the user should not change the set FDATASET without proper knowledge of the functioning of the set. Thus, the set can not be reduced from that specified above since data will be needed in the model for each of the elements, see Section 4.8.1. The set may be enlarged with new elements, however then the user will have to specify in the model how these elements are to be used.

Comment on naming conventions: See page 26.

### 3.5 New generation technology and area: AGKN

Investment in new generation capacity may be determined endogenously. The specification of where new technology capacity of a particular type can be placed must therefore be determined. This is done by specifying the product set AGKN(AAA,G) that hold those combinations of areas and technologies that permit new investment.

Implicit restrictions on new investments, following from the information given in FKPOTC, FKPOTR, FKPOTA and GDATA(G,"GDKVARIABL"), Sections 4.17.1, 4.16.1, 4.15.1, 4.13.1, will automatically be used (through the derived set IAGKN, Section 3.8.10), therefore it is not necessary to specify AGKN(AAA,G)=NO for such (AAA,G).

See Section 3.8.9 concerning specification of capacity according to heat or electricity side.

Other possibilities are described in Section 12.

### 3.6 Demand: DF\_QP, DEF\_..., DHF\_....

Demand for electricity is specified for each region and demand for heat is specified for each area.

The specification may be considered to consist of three elements, see also Figure 2 and Figure 3:

- A nominal value, specified for each year in the simulation period as an annual quantity, parameters DE and DH, Sections 4.11.2 and 4.12.1.

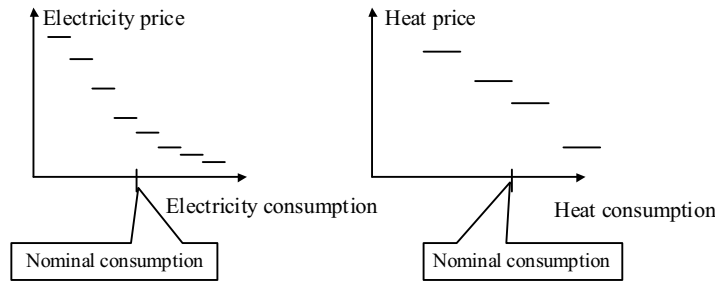


Figure 2: Elastic demand, illustration of price elasticities.

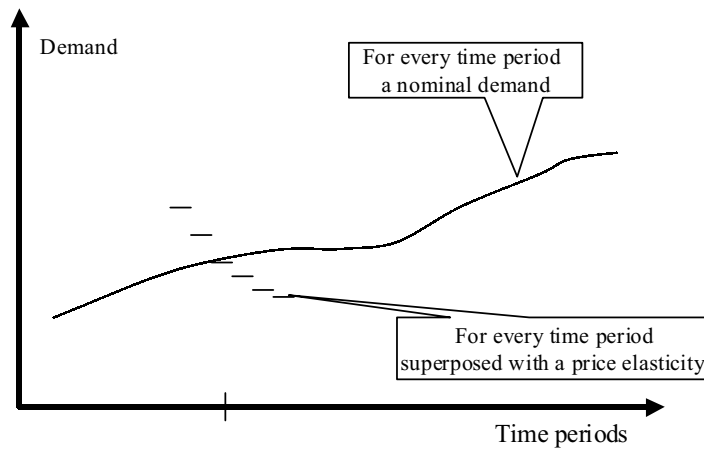


Figure 3: Elastic demand, illustration of development over time.

- A nominal profile, i.e., a distribution of the annual quantity over the time segments of the year, specified in `DE_VAR_T` and `DH_VAR_T`, see Sections 4.20.1 and 4.19.1.
- An elasticity function which specifies the relationship between quantity and price for deviations from the nominal profile. Parameter values for this are given as described in Sections 4.6.3, 4.7.3, 4.19.5, 4.20.2, 4.29.32, 4.29.33, while the related sets are specified in the following.

The sets related to elastic demands specify steps relating quantities and prices:

```
SET DF_QP /DF_QUANT, DF_PRICE /;
```

Observe that the user should not change this set without proper knowledge of the functioning of the set. Thus, the set can not be reduced from that specified above since data will be needed in the model for each of the elements, see below.

The individual steps in the electricity demand function are specified by SET DEF given as e.g.:

```
SET DEF / DEF_D1.4, DEF_D1.3, DEF_D1.2, DEF_D1.1, DEF_U1.1, DEF_U1.2,
DEF_U1.3 / ;
```

This example shows 7 steps.

The entry order (Section 3.2.4) of the labels in DEF is important, cf. Section 4.25.1.

SET DEF\_D1(DEF) and SET DEF\_U1(DEF) are subsets used to distinguish between steps for regulation downwards (decreased demand, in this example 4 steps) and upwards (increased demands, in this example 3 steps) of electricity demand relative to nominal demand:

```
SET DEF_D1(DEF) / DEF_D1.4, DEF_D1.3, DEF_D1.2, DEF_D1.1/ ;
```

```
SET DEF_U1(DEF) / DEF_U1.1, DEF_U1.2, DEF_U1.3 / ;
```

If the sets DEF\_D1(DEF) and DEF\_U1(DEF) are empty then the intention is that demand is inelastic, according to the interpretation relative to DEF\_STEPS, see Section 4.25.1.

Two other subsets of DEF are DEF\_D2(DEF) and DEF\_U2(DEF). The functioning of these sets is the same as for DEF\_D1(DEF) and DEF\_U1(DEF). The difference is the way the numerical values entered in DEF\_STEPS will be interpreted, see Section 4.25.1.

In order to permit empty sets in relations to inelastic demand, the dollar control option \$ONEMPTY must be set.

Similarly for the steps in the heat demand function (the example has 5 steps, of which 4 are down and 1 is up; set DHF\_U2 is empty):

```
SET DHF / DHF_D1.2, DHF_D2.1, DHF_U1.1, DHF_D2.1, DHF_U2.2 /;
```

```
SET DHF_D1(DHF) / DHF_D1.2, DHF_D1.1/ ;
```

```
SET DHF_U1(DHF) / DHF_U1.1 / ;
```

```
SET DHF_D2(DHF) / DHF_D2.1, DHF_U2.2 / ;
```

```
SET DHF_U2(DHF) / / ;
```

The same comments apply to DHF\_D1, DHF\_U1, DHF\_D2 and DHF\_U2 as to the similar sets for electricity.

### 3.7 Emission policies: MPOLSET

SET MPOLSET contains elements for specification of environmental policies,

```
TAX_CO2 "CO2 emission tax (Money/t CO2)"
```

```
TAX_SO2 "SO2 emission tax (Money/t SO2)"
```

```
TAX_NOx "NOx emission tax (Money/kg NOx)"
```

```
LIM_CO2 "Annual CO2 limit (t CO2/year)"
```

```
LIM_SO2 "Annual SO2 limit (t SO2/year)"
```

```
LIM_NOx "Annual NOx limit(kg NOx/year)"
```

Observe that the user should not change this set without proper knowledge of the functioning of the set. Thus, the set can not be reduced from that specified above since data will be needed in the model for each of the elements, see Section 4.24.1. The set may be enlarged with new elements, however then the user will have to specify in the model how these elements are to be used.

### 3.8 Internal sets

A number of sets are defined and their members defined automatically, i.e., they are not specified explicitly by the user. We refer to these as internal sets, in contrast to input sets. The names of these sets start with I, Section 1.4. The internal sets are dynamic sets in the sense explained next.

### 3.8.1 Static and dynamic sets

In the GAMS terminology, static sets are sets that have their membership declared as the SET itself was declared and the membership was never changed. In contrast, dynamic sets have their membership changed because of assignments. Hence, membership of dynamic sets may change during the execution of the program.

In assignments, constructions of sets may be done using the symbols "+", "-", "\*", and "NOT" to provide the set operations union, difference, intersection and complement, respectively. Constructions using YES and NO may be used, see below for examples.

Dynamic sets are not ordered, Section 3.2.4. They can not be used in declarations but can be used in definitions, see page 10.

### 3.8.2 Areas simulated: IA

SET IA(AAA) is the subset used to define those areas that are simulated. This subset is derived automatically as that subset of AAA that is relevant for the simulated countries C:

$$\text{SET IA(AAA)} = \text{YES}(\text{SUM}(\text{C}, \text{ICA}(\text{AAA}, \text{C})));$$

### 3.8.3 Rural and urban heat areas simulated: IARURH, IAURBH

The subset IARURH used in simulation is found automatically as that subset of AAARURH, Section 3.8.3, that is relevant for the simulated countries C:

$$\text{SET IARURH(AAARURH)} = \text{YES}(\text{SUM}(\text{C}, \text{ICA}(\text{AAARURH}, \text{C})));$$

The subset IAURBH of urban heat areas is similarly automatically defined as the set of the urban heat areas.

### 3.8.4 Country to area mapping: ICA

The internal set ICA(C,AAA) specifies the relation between AAA and C. It is derived automatically from the sets RRRAAA(RRR,AAA) and CCCRRR(C,RRR), to assign consistently the areas in AAA to the countries in C:

$$\text{ICA}(\text{C}, \text{AAA}) = \text{YES}(\text{SUM}(\text{RRR}, (\text{RRRAAA}(\text{RRR}, \text{AAA}) \text{ AND } \text{CCCRRR}(\text{C}, \text{RRR})));$$

### 3.8.5 Regions simulated: IR

SET IR(RRR) is the subset of regions that are simulated. This subset is derived automatically for the simulated countries C as:

$$\text{SET IR(RRR)} = \text{YES}(\text{SUM}(\text{C}, \text{CCCRRR}(\text{C}, \text{RRR})));$$

### 3.8.6 Electricity import-export: IRRRI, IRRRE, IRI, IRE

For description of transmission relations between pairs of regions copies of the sets are necessary. They are obtained by the ALIAS statement as:

$$\text{ALIAS}(\text{RRR}, \text{IRRRE}), \text{ALIAS}(\text{RRR}, \text{IRRRI}), \text{ALIAS}(\text{IR}, \text{IRE}), \text{ALIAS}(\text{IR}, \text{IRI})$$

This permits the reference to pairs of regions, e.g., (IRI,IRE). As seen, IRRRE and IRRRI are the sets of regions in the data structure, and IRE and IRI are the subsets of regions in the simulation. The final E and I are used to indicate exporting and importing regions, respectively.

### 3.8.7 Season and time duplication: ISALIAS, ITALIAS

Copies of the sets S and T are obtained as "ALIAS(S,ISALIAS)" and "ALIAS(T,ITALIAS)".

### 3.8.8 Season and time refinements: IST, ISTS, ISTT

The set IST(S,T) identifies the time segments selected. In the standard version IST(S,T) holds all combinations of elements in S and T, i.e., IST is defined as IST(S,T)=YES, but a subset of this may be defined. Combined with overwriting of the standard definition of IHOURSINST(S,T) (Section 4.29.6) this permits maximal flexibility with respect to the time structure.

The set ISTS(S) holds the time segments S for which there is at least one element T.

The set ISTT(T) holds the time segments T appearing in at least one seasons S.

### 3.8.9 Generation technology types

A number of convenient subsets of generation technology types have been defined. There are 11 basic types: Condensing, Back pressure (sometimes also called intermediate take out and condensing), Extraction, Heat-only boilers, Electric heaters/heatpumps, Heat storage technologies, Electricity storage technologies, Hydro power with storage, Hydro power without storage (run-of-river), Wind power, Solar power. Some technologies may be combined into one, see Section 3.3.1.

The above names of the technologies are only indicative, and indeed may be misleading. E.g., a gas turbine may also in this context be characterised as a "back pressure" technology type. From a functional point of view the characterisation below, as e.g. in Table 3, is more precise.

All technologies of each basic type is in a particular set. The names of these sets are, respectively, IGCND(G), IGBPR(G), IGEXT(G), IGHOB(G), IGETOH(G), IGHSTO(G), IGESTO(G), IGHYRS(G), IGHYRR(G), IGWND(G), IGSOL(G), IGCOMB1, IGCOMB2, IGNUC, IG2LEVEL.

Each technology is automatically allocated to one and only one of the sets according to the integer given in GDATA(GGG,'GDTYPE') or GDATA(G,'GDCOMB') as follows:

IGCND(G) = YES\$(GDATA(G,'GDTYPE') EQ 1);

IGBPR(G) = YES\$(GDATA(G,'GDTYPE') EQ 2);

IGEXT(G) = YES\$(GDATA(G,'GDTYPE') EQ 3);

IGHOB(G) = YES\$(GDATA(G,'GDTYPE') EQ 4);

IGETOH(G) = YES\$(GDATA(G,'GDTYPE') EQ 5);

IGHSTO(G) = YES\$(GDATA(G,'GDTYPE') EQ 6);

IGESTO(G) = YES\$(GDATA(G,'GDTYPE') EQ 7);

IGHYRS(G) = YES\$(GDATA(G,'GDTYPE') EQ 8);

IGHYRR(G) = YES\$(GDATA(G,'GDTYPE') EQ 9);

IGWND(G) = YES\$(GDATA(G,'GDTYPE') EQ 10);

IGSOL(G) = YES\$(GDATA(G,'GDTYPE') EQ 11);

IGCOMB1(G) = YES\$(GDATA(G,'GDCOMB') EQ 1);

LOOP(IGCOMB1, IGCOMB2(G) = YES\$((GDATA(G,'GDCOMB') EQ 2)  
AND (GGCOMB(IGCOMB1,G))));

IGNUC(G)

IG2LEVEL(G)

	C N D	B P R	E X T	H O B	E T O H	W N D	S O L	H Y S R	H Y R	E S T O	H S T O
GDATA(GGG,'GDTYPE')	1	2	3	4	5	10	11	8	9	6	7
Electricity output	x	x	x			x	x	x	x	x	
Electricity input					x						
Heat output		x	x	x	x						x
Storage										x	x
Dispatchable	x	x	x	x	x			x		x	x
Fixed electricity to heat relation		x			x						

Table 3: Functionality of the technology types.

Combination technologies are in sets IGCOMB1 and IGCOMB2, see Section 3.3.1.

Observe that the sets are defined as subsets of G, not GGG.

The technologies in each set has specific properties in the model. The relative characteristics of each of the technology types are described in Table 3. As seen, all types are functionally different, except WND and SOL. For these two the difference is only in the primary energy source (the wind and the sun, respectively), hence the reason for the difference is a matter of convenience in the distinction of input data like costs, production profiles over the day and the year, etc.

Since the allocation of the technologies to the sets is done according to the value of the integer in GDATA(GGG,'GDTYPE'), the user should not change the meaning associated with these integers without proper understanding of the model. These properties are expressed as equations and/or lower and/or upper bounds and/or fixed values on the individual variables describing the generation from the technology. See BALMOREL.GMS for details.

In addition, the technologies may be grouped into sets according to various characteristics. Some examples are: all technologies excluding electric heating; technologies for which the generation may be dispatched; technologies that produce electricity only i.e., not heat; technologies for which capacity is given with respect to electricity (IGKE) or heat (IGKH).

The identification of these technology sets are:

IGHH(G): producing only heat

IGEE(G): producing only electricity

IGE(G): producing electricity (with or without heat)

IGH(G): producing heat (with or without electricity)

IGEH(G): producing electricity and heat

IGHHNOSTO(G): type IGHH except heat storage

IGEENOSTO(G): type IGEE except electricity. storage

IGKH(G): capacity specified with respect to heat

IGKE(G): capacity specified with respect to electricity

IGKENOSTO(G): capacity given on electricity side, except el. storage

IGKHNOSTO(G): capacity given on heat side, except heat storage

IGNOTETOH(G): all except heat pumps

IGDISPATCH(G): dispatch may be made

	IARURH	IAURBH
Heat dispatch	Fixed	Free (in combination with el. dispatch)
El. dispatch	Fixed	Free (in combination with heat dispatch)

Table 4: Differences between urban and rural areas with respect to treatment of capacities and dispatch.

IGEOREH(G): producing electricity (with or without heat)

IGKKNOWN(G): capacity can not be found endogeneously

IGKFIND(G): capacity can be found endogeneously

IGHORHERUR(G): producing heat (with or without electricity), rural areas

Each technology is automatically allocated to these dynamic sets. For some of them, this is done according to the integer given in `GDATA(GGG,'GDTYPE')`, and/or using previously defined sets. Table 5 specifies the dynamic sets that are defined this way. The sets `IGKKNOWN` and `IGKFIND` are defined according to the values given in `GDATA(G,'GDKVARIABLE')`. Other ways may be used. See `BALMOREL.GMS` for details.

Table 4 indicates characteristics of urban and rural areas with respect to heat dispatch.

The set `IGGGALIAS` is a duplication of the set `GGG`.

### 3.8.10 Investments in new technologies: IAGKN

The set `AGKN`, Section 3.5, specifies where new technologies may be invested. This information, supplemented as described in Section 3.5, is transferred to set `IAGKN`.

### 3.8.11 Equation feasibility: IPLUSMINUS

It is not practically possible to ensure that a model will have a feasible solution. And if it does not, it may be difficult to find the explanation why. Therefore a mechanism is introduced to ensure that a model will always be feasible, and to provide some kind of indication that may help in searching for a reason. The SET `IPLUSMINUS /IPLUS, IMINUS/` is part of this, see further Section 4.1.1, Section 6. Note that the following convention is used: when placed on the left hand side of the relation sign (`=L=`, `=E=` or `=G=`) the sign to the 'IPLUS' and 'IMINUS' terms should be '+' and '-', respectively.

## 3.9 Restrictions on sets

Most of the sets have their members (elements, labels) specified by the user. The exceptions are:

- Some sets have their members derived automatically (they are the dynamic sets, or internal sets, Section 3.8.1); these sets are described in Section 3.8.
- For the sets `GDATASET`, `FDATASET`, `DF_QP`, `MPOLSET`, see Sections 3.3, 3.4, 3.6, 3.7, the members should not be changed without proper understanding of the functioning of these sets.
- For the sets `DEF`, `DEF_DINF`, `DEF_UINF`, `DHF`, `DHF_DINF` and `DHF_UINF` there are restriction such that some specific elements must be present, see Section 3.6.

Tech. type: GDTYPE no.:	IGCND 1	IGBPR 2	IGEXT 3	IGHONLY 4	IGETOH 5	IGHSTO 6
IGE	yes	yes	yes		yes	
IGH		yes	yes	yes	yes	yes
IGEH		yes	yes		yes	
IGEE	yes					
IGHH				yes		yes
IGHHNOSTO				yes		
IGEENOSTO	yes					
IGKH				yes		yes
IGKE	yes	yes	yes		yes	
IGKENOSTO	yes	yes	yes		yes	
IGKHNOSTO				yes		
IGEOREH	yes	yes	yes		yes	
IGNOTETOH	yes	yes	yes	yes		yes
IGDISPATCH	yes	yes	yes	yes	yes	yes
IGHORHERUR		yes	yes	yes	yes	
Tech. type: GDTYPE no.:	IGESTO 7	IGHYRS 8	IGHYRR 9	IGWND 10	IGSOL 11	
IGE	yes	yes	yes	yes	yes	
IGH						
IGEH						
IGEE		yes	yes	yes	yes	
IGHH						
IGHHNOSTO						
IGEENOSTO		yes	yes	yes	yes	
IGKH						
IGKE	yes	yes	yes	yes	yes	
IGKENOSTO		yes	yes	yes	yes	
IGKHNOSTO						
IGEOREH	yes	yes	yes	yes	yes	
IGNOTETOH	yes	yes	yes	yes	yes	
IGDISPATCH	yes	yes				
IGHORHERUR						

Table 5: Dynamic sets with relation to generation technology types, i.e., depending on GDTYPE.

The set members (labels) in relation to the two last items will be referred to as obligatory set members.

It is permitted that an element is member of more than one set. This is used e.g. in the declaration of subsets, and other examples are given in Section 3.8.9. However, apart from such intentional use, it should be avoided that elements are members of more than one set. Thus, it may be tempting to have e.g. a technology that is called HYDRO and also a fuel that is called HYDRO, but this should be avoided, see the discussion on naming conventions on page 26 in Section 3.3.

For similar reasons, the only labels consisting of digits only are those used for set elements indicating the years (i.e., in labels the sets YYY and Y).

Finally, as previously noted, the user should not change the internal sets, cf. Section 3.8.

## 4 Parameters and scalars

In this section we describe parameters and scalars that must be specified by the user while in Section 4.29 parameters that are automatically calculated will be treated. The former type will be referred to as input parameters while the latter type will be referred to as internal parameters.

Recall from Section 1.3 that parameters and scalars are used to specify exogenous values, and that parameters, unlike scalars, relate to sets.

Recall that the focus in the present document is on model structure and therefore the actual input data to be used is not in focus. However, occasionally some comments on input data will be given. To avoid confusion between what is logically required within the model structure and what may reasonable be expected concerning numerical values of input the comments on input data will be clearly identified as such.

The units used in parameters are: MW (megawatt), MWh (megawatthour), GJ, hours, days, kg (kilogram), t (ton), and Money where the latter may indicate e.g. Euro or USD. Prefixes like M (million), k (kilo) or m (milli) will also be used.

For entities like 'loss in electricity distribution' (which must be given as a fraction) or 'the number of hours per year' the unit has been indicated as '(none)'. For some entities the important thing is their proportions, in this case also '(none)' may be specified, however, an indication may be given as concerns between which entities the proportions should be taken; e.g. '(none~MW)' to signal that the proportions are between MW or similar, see Section 4.20.1.

The factor 3.6 indicates the usual relations between units using seconds and hours, respectively, e.g. between MWh and GJ. The meaning of the numbers 24, 365, 8760 are obvious.

Most data are entered using a list (for scalars) or a TABLE (for parameters with two or more dimensions). Observe that if entries are not given, or entry values are not filled in, the default value zero is automatically used. In some cases where individual data can not be found, or can not be found for all relevant entries, user specified default data may be entered by first giving a TABLE with those values that are known, and then filling all other entries with the user specified default data, see Section 4.27.

In general, the data in any model must be selected by the user to be consistent in the sense that model and data are, generally speaking, mutually dependent, and therefore the individual data elements are also interdependent. This topic will not be discussed in general terms here. However, in a few places it is crucial that there is a logical consistency between parameter values, this is discussed in Section 4.28.

## 4.1 Scalars

### 4.1.1 PENALTY

The scalar PENALTY is the penalty used in relation to securing feasibility in equations, it enters the equation QOBJ as coefficient to variables VQ..., cf. Section 6, Section 3.8.11.

## 4.2 Parameters on the set YYY

### 4.2.1 YVALUE

The parameter YVALUE(YYY) holds the numerical values related to the years in set YYY. Unit: (none). If e.g. set YYY is defined as /2001 \* 2003/ then YVALUE('2002') has the value 2002.

## 4.3 Parameters on the set SSS

### 4.3.1 WEIGHT\_S

PARAMETER WEIGHT\_S reflects how much of the year each season represents expressed relatively between the seasons. Unit: (none), see next.

One way of doing it is to state the number of days in each season (could sum up to 365). Another is to give percentages (summing up to 100), cf. Section 4.4.1.

The parameter WEIGHT\_S is used only in the calculation of the parameters IWEIGHSUMS and DAYSIN\_S, see Sections 4.29.4 and 4.29.7.

Comment on input data: The calculation of IDAYSIN\_S will involve a division. This will be unproblematic if the data entered in WEIGHT\_S contain no negative values and at least one positive value (which is natural).

(It is quite possible to specify the year to have 366 (or even 365.24) days. Just take the editor and replace 365 by 366 (or 365.24) in the BALMOREL.GMS file (and 8760 should be changed accordingly to 8784 etc.). This will make the numerical values change slightly while the interpretations will be harder.)

Comment on naming conventions: See Section 3.2.2.

Comment on input data: See the comments on input data in Section 4.4.1.

## 4.4 Parameters on the set TTT

### 4.4.1 WEIGHT\_T

PARAMETER WEIGHT\_T reflects how much of the season each time segment represents expressed relatively between the time segments. Unit: (none), see next.

One way of doing it is to state the number of hours that each period represents, another is to state it as percentages (summing up to 100), cf. Section 4.3.1.

The parameter WEIGHT\_T is used only in the calculation of the parameters IWEIGHSUMT and IHOURSIN24, see Sections 4.29.5 and 4.29.8.

It tempting to say that the set TTT represents a subdivision of the day - and we may actually do so sometimes. However, is not in general correct to say so. Thus, if for instance SSS contains four elements (wither, spring, summer, autumn) and TTT contains 24 segments, the time segments in TTT need not represent a typical day. Rather, TTT should represent not only the "typical day" but also the week-end days. See also Section 4.29.8

Comment on input data: The calculation of IHOURSIN24 will involve a division. This will be unproblematic if the data entered in WEIGHT\_T contain no negative values and at least one positive value (which is natural).

Comment on input data: The set T is ordered, cf. Section 3.2.4. If this is used in the model to represent chronological aspects then the sequence of numbers entered in TABLE WEIGHT\_T matters. This is the case e.g. if pumped hydro reservoirs or heat storage shall be modelled. However, if this is not so, WEIGHT\_T

	5%	6%	7%	8%	9%	10%	15%	20%
5	0.2310	0.2374	0.2439	0.2505	0.2571	0.2638	0.2983	0.3344
10	0.1295	0.1359	0.1424	0.1490	0.1558	0.1627	0.1993	0.2385
15	0.0963	0.1030	0.1098	0.1168	0.1241	0.1315	0.1710	0.2139
20	0.0802	0.0872	0.0944	0.1019	0.1095	0.1175	0.1598	0.2054
25	0.0710	0.0782	0.0858	0.0937	0.1018	0.1102	0.1547	0.2021
30	0.0651	0.0726	0.0806	0.0888	0.0973	0.1061	0.1523	0.2008

Table 6: Annuity as depending on interest rates and number of years (payment at the end of the year).

may be used to represent only the duration (weight) of the individual time segments. Then, if e.g. the electricity loads (demand) as expressed in PARAMETER DE.VAR.T appear in descending magnitude the load duration idea is applied. Similarly it is important that the set S is ordered if e.g. a hydro reservoir with seasonal storage capacity is to be modelled.

Comment on naming conventions: See Section 3.2.2.

## 4.5 Parameters on the set CCC

### 4.5.1 ANNUITYC

PARAMETER ANNUITYC indicates the transformation of an investment to an annual payment. Unit: (none).

Thus, for instance, an investment of 100, paid over 20 years, with payment at the end of each year, assuming an interest rate of 5%, will imply an annual payment of 8.02, hence, ANNUITYC should in this case have the value 0.0802.

For electrical transmission investments between regions in two different countries, the average annuity between the annuities for the two countries in question will be used.

Table 6 illustrates the dependence of the annuity on various combinations of interest rates, 5, 6, 7, 8, 9, 10, 15, 20% and number of years, 5, 10, 15, 20, 25, 30 years. See also Section 12.

### 4.5.2 TAX\_DE

PARAMETER TAX\_DE holds consumers' tax on electricity consumption. Unit: Money/MWh.

Comment on input data: Observe that the tax must be specified as the weighted average over all consumer groups.

### 4.5.3 TAX\_DH

PARAMETER TAX\_DH holds consumers' tax on heat consumption. Unit: Money/MWh.

Comment on input data: Observe that the tax must be specified as the weighted average over all consumer groups.

## 4.6 Parameters on the set RRR

### 4.6.1 DISLOSS\_E

PARAMETER DISLOSS\_E holds the loss in electricity distribution, as a fraction of the electricity entering the distribution network. Unit: (none).

### 4.6.2 DISCOST\_E

PARAMETER DISCOST\_E holds the cost of electricity distribution, given relative to end consumption. Unit: Money/MWh.

### 4.6.3 DEFP\_BASE

PARAMETER DEFP\_BASE holds the annual average consumer price of electricity (including taxes) in the base year. Unit: Money/MWh.

Comment on input data: Observe that the average is to be taken over the whole year and over all consumer groups, and that the price is including taxes (that may differ between the different consumer groups).

Comment on input data: Also in the case of inelastic demand a reasonable value must be given, as the value in DEFP\_BASE will be also in this case be taken as starting point for calculation of a "very high" price, used in case the demand can not be satisfied, see also Section 4.25.1.

## 4.7 Parameters on the set AAA

### 4.7.1 DISLOSS\_H

PARAMETER HDIS\_LOSS holds the loss in heat distribution, as a fraction of heat generated (identical to the heat entering the distribution network). Unit: (none).

### 4.7.2 DISCOST\_H

PARAMETER DISCOST\_H holds the cost of heat distribution, given relative to end consumption. Unit: Money/MWh.

### 4.7.3 DHFP\_BASE

PARAMETER DHFP\_BASE holds the annual average consumer price of heat (including taxes) in the base year. Unit: Money/MWh.

Comment on input data: Similar comments as in Section 4.6.3 apply.

### 4.7.4 WNDFLH

PARAMETER WNDFLH holds the full load hours for wind power, i.e., the annual wind power production divided by the wind power capacity. Unit: hours.

### 4.7.5 SOLFLH

PARAMETER SOLFLH holds the full load hours for solar power, i.e., the annual solar power production divided by the solar power capacity. Unit: hours.

### 4.7.6 WTRRRFLH

PARAMETER WTRRRFLH holds the full load hours for hydro run of river power, i.e., the annual hydro run of river power production divided by the hydro run of river power capacity. Unit: hours.

### 4.7.7 WTRRSFLH

PARAMETER WTRRSFLH holds the full load hours for hydro with storage power, i.e., the annual hydro with storage power production divided by the hydro with storage power capacity. Unit: hours.

## 4.8 Parameters on the set product (FFF,FDATASET)

### 4.8.1 FDATA

PARAMETER FDATA contains information about emission characteristics of fuels. In addition it contains an integer code FDNB identifying the individual fuels. Units: kg/GJ (for FDCO<sub>2</sub>), kg/GJ (for FDSO<sub>2</sub>), (none) for FDNB.

The FDNB contributes to the coupling between generation technology and fuel. In GDATASET (Section 3.3) the elements GDFUEL (Section 4.13.1) for each technology contains an integer that points to the FDNB for the fuel that the technology uses. Therefore two different fuels should not have identical FDNB.

## **4.9 Parameters on the set product (FFF,CCC)**

### **4.9.1 TAX\_F**

PARAMETER TAX\_F specifies fuel taxes on primary fuel types (i.e. neither electricity nor heat). This tax is applied on the fuel, IRRRespective of whether electricity, heat or both is produced. Unit: Money/GJ.

## **4.10 Parameters on the set product (GGG,AAA)**

### **4.10.1 GDINVCOST**

PARAMETER GDINVCOST holds the investment cost for new technology. Unit: MMoney/MW.

Observe the definition of the capacity (MW), Section 4.22.1.

Observe that if a zero or if nothing is specified for GDINVCOST in TABLE GDINVCOST (and therefore the default value zero is automatically assigned) then the value in table GDATA, Section 4.13.1, is used.

### **4.10.2 GDOMVCOST**

PARAMETER GDOMVCOST holds the variable operating and maintenance costs. Unit: Money/MWh.

Observe that if a zero or if nothing is specified for GDOMVCOST in TABLE GDOMVCOST (and therefore the default value zero is automatically assigned) then the value in table GDATA, Section 4.13.1, is used.

### **4.10.3 GDOMFCOST**

PARAMETER GDOMFCOST holds the annual fixed operating and maintenance costs. Unit: kMoney/MW.

Observe the definition of the capacity (MW), Section 4.22.1.

Observe that if a zero or if nothing is specified for GDOMFCOST in TABLE GDOMFCOST (and therefore the default value zero is automatically assigned) then the value in table GDATA, Section 4.13.1, is used.

### **4.10.4 GEFFDERATE**

PARAMETER GEFFDERATE represents an adjustment of efficiency. Unit: (none).

Comment on input data: This parameter is intended for catching some of the shortcomings in the modeling of the individual units. Thus, the information on efficiency given in GDATA may be seen as general information with validity irrespective of where the unit is located, this is then made geographically specific through GEFFDERATE. The value of GEFFDERATE will probably be slightly below unity (but despite the name it may also be above unity). See also Section 9.1.2.

## **4.11 Parameters on the set product (YYY,RRR)**

### **4.11.1 X3FX**

PARAMETER X3FX contains the annual net electricity export to third regions. Unit: MWh.

Comment on input data: Observe that the values in X3FX must be specified to be consistent with the values in X3FX\_VAR\_T, Section 4.20.3. X3FX is only used to calculate IX3FX\_T\_Y, see Section 4.29.34.

Observe that this exchange (intended to be positive for export, negative for import, but from Section 4.29.34 it follows that some care is necessary to get consistency) is specified by the user, and that there is no other exchange possibilities with regions or countries not in the model (i.e., not in the sets C or R). Also observe that no payment is associated with this exchange. No capacity is to be given for the transmission lines supposed to carry the exchange (and hence no interaction with e.g. XKINI, Section 4.14.1).

If the set C is a proper subset of the set CCC X3FX may be used to represent exchange between a region in C and a region which is in CCC but not in C.

Exchange between regions in the model (i.e., between members in the set IR) will be found during the simulation as the endogenous value of variable VX\_T, see Section 6.

Electricity exchange with regions not in IR, depending on import-export prices, is described in Section 12.6.

#### 4.11.2 DE

PARAMETER DE contains the nominal annual electricity consumption. Unit: MWh.

The value should be the end consumption, since distribution and transmission losses are accounted for separately.

The nominal annual consumption will be distributed over the time segments over the year, see Section 3.2. If demand is elastic, there may be deviation from this nominal value, see Section 3.6.

### 4.12 Parameters on the set product (YYY,AAA)

#### 4.12.1 DH

PARAMETER DH contains the nominal annual heat consumption in those areas that are heat areas, Section 3.1.4. Unit: MWh.

The value should be the end consumption, since distribution losses are accounted for separately.

The nominal annual consumption will be distributed over the time segments over the year, see Section 3.6. If demand is elastic, there may be deviation from this nominal value, see Section 3.6.

### 4.13 Parameters on the set product (GGG,GDATASET)

#### 4.13.1 GDATA

PARAMETER GDATA contains information about the individual generation technologies.

**GDTYPE:** This is an integer. According to the value of this integer, the technology is uniquely placed in one of the internal sets specified in Section 3.8.9. According to the value of the integer (and hence according to which of those sets the technology belongs), the technology has specific properties, see Section 3.8.9.

**GDFUEL:** This is an integer indicating which fuel the technology uses, corresponding to the fuel number FDNB given in FDATA (Section 4.8.1).

**GDCB:** This value specifies the C<sub>b</sub>-value for back pressure and extraction type technologies.

GDCV: This value specifies the isofuel constant  $C_v$  for extraction type technologies

GDFE: Fuel efficiency

GDESO2: Degree of desulphuring

GDNOX: NO<sub>x</sub>-factor (mg/MJ)

GDAUXIL: Used for various additional information. For CHP it denotes central (urban) or decentral (rural) technology

GDINVCOST0: Default investment cost (M<sub>Money</sub>/MW) (default value). Will be used, if nothing is specified for GDINVCOST, Section 4.10.1. Observe the definition of capacity, Section 3.8.9

GDOMVCOST0: Default variable operating and maintenance costs (Money/MWh) (default value). The cost is specified with respect to the total energy (electricity plus heat) Will be used, if nothing is specified for GDOMVCOST, Section 4.10.2.

GDOMFCOST0: Default annual operating and maintenance costs (k<sub>Money</sub>/MW) (default value). Observe the definition of capacity, Section 3.8.9 Will be used, if nothing is specified for GDOMFCOST, Section 4.10.3.

GDFROMYEAR: technology available from the beginning of this year

GDKVARIABLE: Capacity is a variable to be found for each year (0: no, 1: yes)

GCOMB: the technology is a combination technology, see Section 3.3.1.

GDCOMBSK: relevant for a combination technology, see Section 3.3.1.

GDCOMBSLO: relevant for a combination technology, see Section 3.3.1.

GDCOMBSUP: relevant for a combination technology, see Section 3.3.1.

The data corresponding to the elements GDINVCOST0, GDOMVCOST0 and GDOMFCOST0 are considered as default values that may be overwritten, see Sections 4.10.1, 4.10.2 and 4.10.3.

Observe that the following will be specified automatically in the model:

```
GDATA(IGBPR,'GDCV')=1;
```

```
GDATA(IGHOB,'GDCV')=1;
```

This ensures homogeneous ways of calculating fuel consumption. Therefore these obligatory values should not be given by the user (i.e., the corresponding entries in TABLE GDATA should be left blank).

## 4.14 Parameters on the set product (IRRRE,IRRRI)

### 4.14.1 XKINI

PARAMETER XKINI contains the initial electrical transmission capacities between pairs of regions. Unit: MW.

The electrical transmission capacity is the capacity disregarding an eventual loss (see XLOSS, Section 4.14.4). Thus, if there is a loss XLOSS, a maximum of XKINI MW may be sent into the transmission line, but at most  $(XKINI \cdot (1 - XLOSS))$  MW may be extracted.

Observe that the initial transmission capacity between two regions need not be the same in both directions. (But new transmission capacity will be symmetric.)

#### 4.14.2 XINVCOST

PARAMETER XINVCOST contains information about the investment cost in new electrical transmission capacity between pairs of regions. It also contains information about where it will at all be possible to establish new transmission lines. Unit: Money/MW.

Observe the definition of transmission capacity, Section 4.14.1.

If INF is entered in the table, this means that no transmission capacity can be established between the two associated regions.

The information in XINVCOST must be given only for the lower triangle of the table, and not for diagonal entries, i.e. only for (ORD(IRRRE) GT ORD(IRRRI)).

Note: in most cases the intention will be that no investment will be possible.

Compare the tables providing the other information relating to transmission (XKINI, XCOST, XLOSS).

#### 4.14.3 XCOST

PARAMETER XCOST contains information about the electrical transmission cost between pairs of regions. Unit: Money/MWh.

The electrical transmission cost is applied to the electricity entering the transmission line, cf. Section 4.14.1.

Observe that the cost need not be the same in both directions.

Comment on input data: Unreasonable results may be found if there are neither cost nor loss associated with electrical transmission. Therefore for all non-diagonal entries the user must enter a positive number in either TABLE XCOST or in TABLE XLOSS, Section 4.14.4.

#### 4.14.4 XLOSS

PARAMETER XLOSS contains the loss in transmission expressed as a fraction of the electricity entering the transmission line. Unit: (none).

Observe that the loss need not be the same in both directions, Section 4.14.1.

Comment on input data: Unreasonable results may be found if there are neither cost nor loss associated with electrical transmission. Therefore for all non-diagonal entries the user must enter a positive number in either XLOSS or in XCOST, Section 4.14.3.

### 4.15 Parameters on the set product (FKPOTSETA,AAA)

#### 4.15.1 FKPOTA

PARAMETER FKPOTA holds the fuel potentials specified at area level. Unit: MW.

The potential is specified as an upper limit on the area's installed generation capacity relative to the individual fuel type.

Comment on input data: The specification of the fuel potential as an upper limit on generation capacity is obviously a simplification. However, in many cases the fuel potential, defined in energy terms, is not known with precision and this motivates the simplification. See Section 12.

### 4.16 Parameters on the set product (FKPOTSETR,RRR)

#### 4.16.1 FKPOTR

PARAMETER FKPOTR holds the fuel potentials specified at regional level. Unit: MW.

The potential is specified as an upper limit on the regions' installed generation capacity relative to the individual fuel type.

Comment on input data: The same comments as in Section 4.15.1 apply.

## **4.17 Parameters on the set product (FKPOTSETC,CCC)**

### **4.17.1 FKPOTC**

PARAMETER FKPOTC holds the fuel potentials specified at country level. Unit: MW.

The potential is specified as an upper limit on the countries' installed generation capacity relative to the individual fuel type.

Comment on input data: The same comments as in Section 4.15.1 apply.

## **4.18 Parameters on the set product (AAA,SSS)**

### **4.18.1 WTRRSVARS**

PARAMETER WTRRSVARS contains the description of the seasonal variation of the amount of water inflow to the hydro reservoirs with storage. Unit: (none~MW).

The water is assumed available at the beginning of each season.

### **4.18.2 HYPPROFILS**

PARAMETER HYPPROFILS contains the description of the seasonal variation of prices in relation to production of electricity from hydro power with storage. Unit: Money/MWh.

## **4.19 Parameters on the set product (AAA,SSS,TTT)**

### **4.19.1 DH\_VAR\_T**

PARAMETER DH\_VAR\_T contains the description of seasonal and daily variation of the heat demand Unit: (none~MW) (see description in relation to DE\_VAR\_T, Section 4.20.1).

### **4.19.2 SOL\_VAR\_T**

PARAMETER SOL\_VAR\_T contains the description of seasonal and daily variation of the solar power generation. Unit: (none~MW) (see description in relation to DE\_VAR\_T, Section 4.20.1).

### **4.19.3 WND\_VAR\_T**

PARAMETER WND\_VAR\_T contains the description of seasonal and daily variation of the wind power generation. Unit: (none~MW) (see description in relation to DE\_VAR\_T, Section 4.20.1).

### **4.19.4 WTRRRVAR\_T**

PARAMETER WTRRRVAR\_T contains the description of the seasonal and daily variation of the amount of water inflow to the hydro electricity generation without storage (run of river). Unit: (none~MW) (see description in relation to DE\_VAR\_T, Section 4.20.1).

### **4.19.5 DHFP\_CALIB**

PARAMETER DHFP\_CALIB is used to calibrate the price side of the demand function for heat in order to get demand consistent for a base year. Unit: Money/MWh.

The intention with this parameter is the following. Balance between supply and demand is obtained as a consequence of the costs on the supply side and the demand function. The demand function is exogenously specified, and the supply function is found in the model (in the sense that supply costs may be calculated). However, it may be unlikely that the model and data will reproduce accurately the

situation in a base years, such that the simulated demand need not correspond to that observed in the base year. The parameter DHFP\_CALIB may then be given a value different from zero to obtain such correspondence.

The parameter is used in the calculation of IDHFP\_T, Section 4.29.32 and Section 9.

## 4.20 Parameters on the set product (RRR,SSS,TTT)

### 4.20.1 DE\_VAR\_T

PARAMETER DE\_VAR\_T contains the description of seasonal and daily variation of the electricity demand. Unit: (none) (see below).

DE\_VAR\_T is used to calculate IDE\_SUMST (Section 4.29.9) and DE\_VAR\_T and IDE\_SUMST in combination with DE are used to calculate IDE\_T\_Y (Section 4.29.30).

The values in DE\_VAR\_T are interpreted to be specified relatively (i.e. the values for each day or for all time segments do not have to sum up to something specific, only the relative values are important) within each region. One way to do this is to specify each season/time period value as a percentage of the yearly maximum power load. Another option is to specify the MW-loads for each combinations.

In any case it is important to note that the values must be derived from data given with the dimension of power, i.e., energy per time unit, e.g. MW, GW, J/s MJ/s, and not with dimension of energy, e.g. MWh or MJ.

Comment on input data: The calculation of parameter IDE\_T\_Y, Section 4.29.30, involves a division. This will be unproblematic if the data entered in DE\_VAR\_T contain no negative values and at least one positive value (which is natural).

Observe that parameters DE\_VAR\_T, DH\_VAR\_T, WND\_VAR\_T, SOL\_VAR\_T, X3FX\_VAR\_T will be handled in similar ways as DE\_VAR\_T (special care should be taken with X3FX\_VAR\_T, see Section 4.20.3).

### 4.20.2 DEFP\_CALIB

PARAMETER DEFP\_CALIB is used to calibrate the price side of the demand function for electricity in order to get demand consistent for a base year. Unit: Money/MWh.

See the explanation in relation to DHFP\_CALIB, Section 4.19.5.

The parameter is used in the calculation of IDEFP\_T, Section 4.29.33 and Section 9.

### 4.20.3 X3FX\_VAR\_T

PARAMETER X3FX\_VAR\_T contains the description of seasonal and daily variation in the fixed exchange with third regions. Unit: (none~MW) (see description in relation to DE\_VAR\_T, Section 4.20.1).

A positive number is intended to indicate net export from the region in the set RRR, a negative number indicates net import to the region in the set RRR for the given time segment (S,T), however see Section 4.29.34 about consistency. The values are seen from the country in the set CCC, i.e., any losses are disregarded.

X3FX\_VAR\_T is only used to calculate X3FX\_T\_Y, see Section 4.29.34.

Comment on input data: Observe that the values in X3FX\_VAR\_T must be specified to be consistent with the values in X3FX, Section 4.11.1, cf. Section 4.29.34.

## **4.21 Parameters on the set product (GGG,AAA,SSS)**

### **4.21.1 GKDERATE**

PARAMETER GKDERATE represents a reduction in capacity. Unit: (none).

This reduction may represent e.g. forced and scheduled outages. It is used to reduce the capacity of each unit type in each area.

Observe that for all technology types the specification of GKDERATE has implication for capacity of both electricity and heat (if both are relevant).

Comment on input data: If GKDERATE is set ot zero for some paricular combination (G,A,S) then this represents an outage for the whole season, typically a planned outage.

To represent stochastic outages for thermal units a reasonable value will probably be close to but smaller than 1. For other types of units (e.g., wind, hydro, solar, heatpumps) the value should probably be equal to 1; however, this will depend on a number of factors, e.g. the data source. See also Section 9.1.1.

## **4.22 Parameters on the set product (YYY,AAA,GGG)**

### **4.22.1 GKFX**

PARAMETER GKFX holds the exogenously specified generation capacities. Unit: MW.

For electricity generation plants and co-generation plants capacity must be specified with respect to electricity generation. For heat only boilers and electrical heating units the capacity must be specified with respect to heat generation. See Section 3.8.9, in particular the sets IGKH and IGKE.

Observe that generation capacities are considered specified as net capacity, i.e., the generation unit is assumed to be able to deliver such amount to the network (distribution or transmission network for electricity, distribution network for heat). On the other hand, the delivery may be modified by GKDERATE, see Section 4.21.1.

For electricity generation plants and co-generation plants this must be specified with respect to electricity generation. For heat only boilers and electrical heating units the capacity must be specified with respect to heat generation. See Section 3.8.9.

## **4.23 Parameters on the set product (YYY,AAA,FFF)**

### **4.23.1 FUELPRICE**

PARAMETER FUELPRICE contains fuel prices. Unit: Money/GJ.

Comment on input data: Fuels like wind, water, sun or electricity are not expected to be given a positive value (and hence if no value is assigned the default value zero will be used).

## **4.24 Parameters on the set product (YYY,MPOLSET,CCC)**

### **4.24.1 M\_POL**

PARAMETER M\_POL contains emissions policy data. Unit: See Section 3.7.

For each year in the simulation the data is transferred to internal parameters, see Sections 4.29.24 ff.

## **4.25 Parameters on the set product (RRR,SSS,TTT,DF\_QP,DEF)**

### **4.25.1 DEF\_STEPS**

PARAMETER DEF\_STEPS describes the elastic electricity demands in relative terms, by quantifying the steps. Units: (none), or MW and Money/MWh. See

	DEF_D1_3	DEF_D1_2	DEF_D1_1	DEF_U1_1	..	DEF_U1_9
..DF_QUANT	0.94	0.96	0.97	1.02	..	1.40
..DF_PRICE	1.29	1.18	1.10	0.90	..	0.81

Table 7: Illustration of TABLE DEF\_STEPS

below.

The numerical values may be specified in two ways. Each way is associated with particular subsets of DEF.

In the subsets DEF\_D1 and DEF\_U1 the values are specified relative to 1.0. Thus, with e.g. quantity values of 0.97 and 0.96 for DEF\_D2 and DEF\_D1, respectively, this means that the first step in decrease of demand has a magnitude of 3% of demand (relative to demand DE) and the second step has a magnitude of 1%, adding up to 4%. See Table 7. Corresponding to these quantity steps the price steps have to be specified, e.g. as 1.18 and 1.10, respectively. Thus the 3% decrease in consumption is the result of a 10% increase in price (relative to DEFP\_BASE). Similar ideas apply to increasing demand and decreasing price.

Observe that the sequence of quantities should be increasing and the sequence of prices should be decreasing.

It should be obvious that the sequence of the labels in DEF (which determine the 'real' sequence (i.e., the ORD of a label) of the labels in DEF\_D1 and DEF\_U1) is important, since differences between values corresponding to neighboring labels will be used (using the ORD operator).

In the subsets DEF\_D2 and DEF\_U2 the numerical values are specified in absolute terms. Hence, quantities are specified in MW and prices are specified in Money/MWh.

## 4.26 Parameters on the set product (AAA,SSS,TTT,DF\_QP,DHF)

### 4.26.1 DHF\_STEPS

PARAMETER DHF\_STEPS describes the elastic heat demands in relative terms, by quantifying the steps. Units: (none).

See the description of the similar construction for electricity demand, Section 4.25.1.

For rural areas only the elasticity for the first time segment of the year (ORD(S)=1 and ORD(T)=1) will be used.

### 4.27 Default values

If no data is assigned to a parameter or scalar the default value zero is automatically assigned. Unless zero incidentally is a suitable value another method of assigning default values therefore has to be used.

The following construction may be applied, indicated by an example. As seen, a default value 0.9 is used and assigned unless where non-zero values have been assigned in the TABLE:

```
TABLE GEFFDERATE(GGG,AAA)
      DK_E_Urban  LT_R_Urban
CC-Cond1      0.94      0.99
ST-BP-2-C                0.87      ;

GEFFDERATE(G,A)$ (GEFFDERATE(G,A) EQ 0)=0.9;
```

(Observe that not all elements in a parameter can be given by default, at least one must explicitly be given a value (in a TABLE or by assignment), otherwise it is considered an error.)

## 4.28 Restrictions on parameter values.

To ensure the basic functioning of the model, some parameter values must be consistent or attain some obligatory values:

- The pointer GDFUEL from technology type to fuel type FDNB must be correct, cf. Section 4.8.1. Hence, if the user changes the set of fuels, and therefore also the FDNB to some or all of the individual fuels, this must be carefully checked.
- For some parameters undesirable consequences will be encountered for certain values. Thus, leaving certain values unspecified, such that the default values zero is assigned, will result in a division-by-zero error, eg. Sections 4.29.30, 4.29.31, 4.20.3.
- The values in DEF\_STEPS relative to DEF\_DINF and DEF\_UINF, and the values in DHF\_STEPS relative to DHF\_DINF and DHF\_UINF are subject to restrictions, see Section 4.25.1 and Section 4.26.1. Associated with this are requirements to DEFP\_BASE and DHFP\_BASE, Sections 4.6.3, 4.7.3.
- GDATA(IGBPR,'GDCV') and GDATA(IGHONLY,'GDCV') must attain unity value (assigned automatically), Section 4.13.1.

## 4.29 Internal parameters and scalars

A number of scalars and parameters have been defined as part of the model. In this section we describe those scalars and parameters, called internal parameters, for which the values are derived from other input data, i.e. the user is not supposed to specify the values of these internal parameters. The names of these internal parameters all start with the letter I.

Another group of internal parameters is used to hold values for printing output, see Section 5. These parameters are not part of the model in the sense that they influence model results, hence they are referred to as auxiliary parameters. The names of these auxiliary parameters all start with the letter O.

### 4.29.1 IBALVERSN

The scalar IBALVERSN holds the version number of the Balmorel model. The value 211.20040305 indicates version 2.11 from March 5th. 2004, etc.

### 4.29.2 ISCALAR1, ISCALAR2, IOF

The scalars ISCALAR1, ISCALAR2 etc. may be used to hold intermediate values of various kind, their meanings and units therefore being context dependent. They should be reset to zero or whatever relevant value where they are used. They shall not be used for transferring values between files.

A number of scalars have been defined, intended for holding the most common multipliers. The names start with the text string 'IOF' ('internal or output related factor'), this permits a convenient search for any of these constants in the editor. Some examples are: " SCALAR IOF1000 'Multiplier 1000' /1000/; SCALAR IOF1000000 'Multiplier 1000000' /1E6/; SCALAR IOF0001 'Multiplier 0.001' /0.001/; SCALAR IOF0000001 'Multiplier 0.000001' /0.000001/; SCALAR IOF3P6 'Multiplier 3.6' /3.6/; SCALAR IOF24 'Multiplier 24' /24/; SCALAR IOF8760 'Multiplier 8760' /8760/; SCALAR IOF365 'Multiplier 365' /365/.

### 4.29.3 IANYSET

The set IANYSET may be used for any purpose, its meanings therefore being context dependent.

A particular use of IANYSET is for construction of loops backwards through sets. Newer versions of GAMS permit the use of the constructions "for(c=1 to 5, ...)" and "for(c=1 downto 5, ...)". In accordance with the principle on application of GAMS versions, cf. Section 1.3, the core part of the Balmorel model will not use these constructions. The loop backwards through a set (e.g., S) will in stead be coded as follows:

```
loop(IANYSET$(ord(IANYSET) le card(S)),
loop(S$(ord(S) eq (card(S)-ord(IANYSET)+1)),
...
));
```

#### 4.29.4 IWEIGHSUMS

The internal parameter IWEIGHSUMS is used to hold the total weight of the time of each season in S, hence it is calculated from WEIGHT\_S(S), Section 4.3.1, as

$$\text{IWEIGHSUMS} = \text{SUM}(\text{S}, \text{WEIGHT\_S}(\text{S}))$$

Observe that the sum must be over set S, not SSS. Unit: (none), cf. Section 4.3.1.

#### 4.29.5 IWEIGHSUMT

The internal parameter IWEIGHSUMT is used to hold the total weight of the time of each time period in T, hence it is calculated from WEIGHT\_T(T), Section 4.4.1, as

$$\text{IWEIGHSUMT} = \text{SUM}(\text{T}, \text{WEIGHT\_T}(\text{T}))$$

Observe that the sum must be over set T, not TTT. Unit: (none), cf. Section 4.4.1.

#### 4.29.6 IHOURSINST

The internal parameter IHOURSINST(S,T) holds the length of the time segment (S,T) measured in hours. Unit: (none). It is defined as

$$\text{IHOURSINST}(\text{S}, \text{T}) = \text{IDAYSIN\_S}(\text{S}) * \text{IHOURSIN24}(\text{T})$$

For advanced use, it may be defined differently, cf. Section 3.8.8.

#### 4.29.7 IDAYSIN\_S

The time structure within one year of the model is indicated by the division of the year into seasons SSS and the division of the day in any season into time periods TTT, cf. Section 3.2.

The internal parameter IDAYSIN\_S(S) is defined from the weights, Sections 4.3.1 and 4.29.4, as

$$\text{IDAYSIN\_S}(\text{S}) = 365 * \text{WEIGHT\_S}(\text{S}) / \text{IWEIGHSUMS}$$

It indicates the length of each season given as the number of days that are in each season. Unit: (none). As seen, it is assumed that there are 365 days in the year. Observe that the sum is over the set S, not SSS. See Section 4.29.8.

#### 4.29.8 IHOURSIN24

The internal parameter IHOURSIN24(T) is defined from the weights, Sections 4.29.8 and 4.29.5, as

$$\text{IHOURSIN24}(T) = 24 * \text{WEIGHT\_T}(T) / \text{IWEIGHSUMT}$$

It indicates the length of each period of the season given as the number of hours that would be in each time segment, if the length of the season were 24 hours. Unit: (none). Observe that the sum is over the set T, not TTT, similarly to the case in the following parameters.

#### 4.29.9 IDE\_SUMST

The internal PARAMETER IDE\_SUMST holds the annual amount of electricity demand as expressed in the units of the weights and demands used in IDAYSIN\_S, IHOURSIN24 and DE\_VAR\_T,

$$\begin{aligned} \text{IDE\_SUMST}(\text{IR}) &= \text{SUM}(\text{S}, \text{IDAYSIN\_S}(\text{S}) * \\ &\text{SUM}(\text{T}, \text{IHOURSIN24}(\text{T}) * \text{DE\_VAR\_T}(\text{IR}, \text{S}, \text{T}))) \end{aligned}$$

Unit: (none~MWh). See also Section 4.20.1 and Section 4.29.30. The use is described in Section 4.29.30.

#### 4.29.10 IDH\_SUMST

The internal PARAMETER IDH\_SUMST holds the annual amount of heat demand as expressed in the units of the weights and demands used in IDAYSIN\_S, IHOURSIN24 and DH\_VAR\_T,

$$\begin{aligned} \text{IDH\_SUMST}(\text{IA}) &= \text{SUM}(\text{S}, \text{IDAYSIN\_S}(\text{S}) * \\ &\text{SUM}(\text{T}, \text{IHOURSIN24}(\text{T}) * \text{DH\_VAR\_T}(\text{IA}, \text{S}, \text{T}))) \end{aligned}$$

Unit: (none~MWh). See also Section 4.20.1 and Section 4.29.30. The use is described in Section 4.29.31.

#### 4.29.11 IWND\_SUMST

The internal PARAMETER IWND\_SUMST holds the annual amount of wind generated electricity as expressed in the units of the weights and demands used in IDAYSIN\_S, IHOURSIN24 and WND\_VAR\_T,

$$\begin{aligned} \text{IWND\_SUMST}(\text{IA}) &= \text{SUM}(\text{S}, \text{IDAYSIN\_S}(\text{S}) * \\ &\text{SUM}(\text{T}, \text{IHOURSIN24}(\text{T}) * \text{WND\_VAR\_T}(\text{IA}, \text{S}, \text{T}))) \end{aligned}$$

Unit: (none~MWh). See also Section 4.20.1 and Section 4.29.30.

#### 4.29.12 ISOL\_SUMST

The internal PARAMETER ISOL\_SUMST holds the annual amount of solar generated electricity as expressed in the units of the weights and demands used in IDAYSIN\_S, IHOURSIN24 and SOL\_VAR\_T,

$$\begin{aligned} \text{ISOL\_SUMST}(\text{IA}) &= \text{SUM}(\text{S}, \text{IDAYSIN\_S}(\text{S}) * \\ &\text{SUM}(\text{T}, \text{IHOURSIN24}(\text{T}) * \text{SOL\_VAR\_T}(\text{IA}, \text{S}, \text{T}))) \end{aligned}$$

Unit: (none~MWh). See also Section 4.20.1 and Section 4.29.30.

#### 4.29.13 IHYINF\_S

The internal PARAMETER IHYINF\_S holds the seasonal amount of inflow to hydro reservoirs. Unit: (MWh/MW).

It is calculated as

$$\begin{aligned} &(\text{WTRRSFLH}(\text{IARURH}) * \text{WTRRSVAR\_S}(\text{IARURH}, \text{S}) * \text{IDAYSIN\_S}(\text{S})) \\ &/ \text{IWTRRSSUM}(\text{IARURH}); \end{aligned}$$

#### 4.29.14 IWTRRRSUM

The internal PARAMETER IWTRRRSUM holds the annual amount of hydro run-of-river generated electricity, similarly as IWND\_SUMST in Section 4.29.11.

Unit: (none~MWh).

#### 4.29.15 IWTRRSSUM

The internal PARAMETER IWTRRSSUM holds the annual amount of hydro run-of-river generated electricity, similarly as IWND\_SUMST in Section 4.29.11.

Unit: (none~MWh).

#### 4.29.16 IX3FXSUMST

The internal PARAMETER IX3FXSUMST holds the annual amount of electricity exported to third countries as expressed in the units of the weights and demands used in IDAYSIN\_S, IHOURLSIN24 and X3FX\_VAR\_T,

$$\text{ISOL\_SUMST(IR)} = \text{SUM(S, IDAYSIN\_S(S)*} \\ \text{SUM(T, IHOURLSIN24(T)*X3FX\_VAR\_T(IR,S,T))})$$

Unit: (none~MWh). See also Section 4.20.1 and Section 4.29.30. The use is described in Section 4.29.34.

#### 4.29.17 IM\_CO2

The internal parameter IM\_CO2 attaches the CO2 emission coefficient for the fuel to the technology using that fuel. Unit: kg/GJ. See BALMOREL.GMS.

#### 4.29.18 IM\_SO2

The internal parameter IM\_SO2 combines the SO2 emission coefficient for the fuel with the efficiency for technology using that fuel. Unit: kg/GJ. See BALMOREL.GMS.

#### 4.29.19 IGKVACCTOY

The internal PARAMETER IGKVACCTOY holds the internally found generation capacity at the beginning of the currently simulated year. Unit: MW.

The value of IGKVACCTOY is equal to the sum of the generation capacities found endogenously by simulation in the years previous to the currently simulated year. Total capacity at the beginning of the currently simulated year is equal to (IGKVACCTOY+IGKFX\_Y), see Section 4.29.20. Total capacity throughout the currently simulated year is VGKN.L (where VGKN.L is the level (value) that VGKN attains) larger than (IGKVACCTOY+IGKFX\_Y). Compare IXKINLY in Section 4.29.21.

#### 4.29.20 IGKFX\_Y

The internal PARAMETER IGKFX\_Y holds the externally given (parameter GKFX, see Section 4.22.1) generation capacity at the beginning of the currently simulated year. Unit: MW.

Total capacity at the beginning of the currently simulated year and throughout this year are described in Section 4.29.19.

#### **4.29.21 IXKINI\_Y**

The internal PARAMETER IXKINI\_Y holds the electrical transmission capacity at the beginning of the year simulated. Unit: MW.

The capacity throughout the currently simulated year is VXKN.L (where VXKN.L is the level (value) that VXKN attains) larger than IXKINI\_Y. Compare IGKVACCTOY in Section 4.29.19.

#### **4.29.22 IXKN**

The internal PARAMETER IXKN holds the information whether investment will at all be possible or permitted between pairs of regions. Is is derived from information in XINVCOST, Section 4.14.2. Note that only the lower triangle of the matrix will be used.

#### **4.29.23 IFUELP\_Y**

The internal parameter IFUELP\_Y holds the fuel price in the year simulated, transferred from parameter FUELPRICE, Section 4.23.1. Unit: Money/GJ.

#### **4.29.24 ITAX\_CO2\_Y**

The internal PARAMETER ITAX\_CO2\_Y indicates environmental policy parameter for a given year and country. Unit: Money/ton.

During simulation the relevant values in MPOLSET, Section 4.24.1, will be transferred to this internal parameter.

#### **4.29.25 ITAX\_NOX\_Y**

The internal PARAMETER ITAX\_NOX\_Y indicates environmental policy parameter for a given year and country. Unit: Money/kg.

During simulation the relevant values in MPOLSET, Section 4.24.1, will be transferred to this internal parameter.

#### **4.29.26 ITAX\_SO2\_Y**

The internal PARAMETER ITAX\_SO2\_Y indicates environmental policy parameter for a given year and country. Unit: Money/ton.

During simulation the relevant values in MPOLSET, Section 4.24.1, will be transferred to this internal parameter.

#### **4.29.27 ILIM\_CO2\_Y**

The internal PARAMETER ILIM\_CO2\_Y indicates environmental policy parameter for a given year and country. Unit: ton.

During simulation the relevant values in MPOLSET, Section 4.24.1, will be transferred to this internal parameter.

#### **4.29.28 ILIM\_SO2\_Y**

The internal PARAMETER ILIM\_SO2\_Y indicates environmental policy parameter, for a given year and country. Unit: ton.

During simulation the relevant values in MPOLSET, Section 4.24.1, will be transferred to this internal parameter.

#### 4.29.29 ILIM\_NOX\_Y

The internal PARAMETER ILIM\_NOX\_Y indicates environmental policy parameter for a given year and country. Unit: kg.

During simulation the relevant values in MPOLSET, Section 4.24.1, will be transferred to this internal parameter.

#### 4.29.30 IDE\_T\_Y

The internal PARAMETER IDE\_T\_Y holds the nominal electricity demand for each time segment in the current simulation year. Unit: MW.

It is calculated using the input parameters DE\_VAR\_T and DE and the internal parameter IDE\_SUMST as

$$\text{IDE\_T\_Y}(\text{IR},\text{S},\text{T}) = (\text{DE}(\text{Y},\text{IR}) * \text{DE\_VAR\_T}(\text{IR},\text{S},\text{T})) / \text{IDE\_SUMST}(\text{IR});$$

See Section 3.6.

Comment on input data: The calculation of IDE\_T\_Y involves a division. This will be unproblematic if the data entered in DE\_VAR\_T contain no negative values and at least one positive value (which is natural).

Observe that parameters DE\_VAR\_T, DH\_VAR\_T, WND\_VAR\_T, SOL\_VAR\_T, X3FX\_VAR\_T will be handled in similar ways as DE\_VAR\_T (special care should be taken with X3FX\_VAR\_T, see Section 4.20.3).

#### 4.29.31 IDH\_T\_Y

The internal PARAMETER IDH\_T\_Y holds the nominal heat demand for each time segment in the current simulation year. Unit: MW.

It is calculated using the input parameters DH\_VAR\_T and DH and the internal parameter IDH\_SUMST as

$$\text{IDH\_T\_Y}(\text{IA},\text{S},\text{T}) = (\text{DH}(\text{Y},\text{IA}) * \text{DH\_VAR\_T}(\text{IH},\text{S},\text{T})) / \text{IDH\_SUMST}(\text{IA});$$

See Section 3.6.

#### 4.29.32 IDHFP\_T

PARAMETER IDHFP\_T holds the price levels of individual steps in the electricity demand function, transformed to be comparable with generation costs, taxes and distribution costs. Unit: Money/MWh.

Observe that the magnitudes of the quantity measure (MW) of the corresponding steps will be specified as upper bounds on the variables VDHF\_T, cf. Section 8.

#### 4.29.33 IDEFP\_T

PARAMETER IDEFP\_T holds the price levels of individual steps in the electricity demand function, transformed to be comparable with generation costs, taxes and distribution costs. Unit: Money/MWh.

Observe that the magnitudes of the quantity measure (MW) of the corresponding steps will be specified as upper bounds on the variables VDEF\_T, cf. Section 8.

#### 4.29.34 IX3FX\_T\_Y

The internal parameter IX3FX\_T\_Y holds the export to third countries for each time segment. It is calculated using the input parameters X3FX\_VAR\_T and X3FX and the internal parameter IX3FXSUMST as

$$\begin{aligned} \text{IX3FX\_T\_Y}(\text{IR},\text{S},\text{T}) = \\ (\text{X3FX}(\text{Y},\text{IR}) * \text{X3FX\_VAR\_T}(\text{IR},\text{S},\text{T})) / \text{IX3FXSUMST}(\text{IR}) \end{aligned}$$

Hence the sign of  $IX3FX\_T\_Y$  will depend on  $X3FX(Y,IR)$ ,  $X3FX\_VAR\_T(IR,S,T)$  and  $IX3FXSUMST(IR)$ .

Comment on input data: Observe that the calculation will result in an error, if division by zero is attempted. This puts restrictions on  $IX3FXSUMST$  and in turn in  $X3FX\_VAR\_T$  from which it is derived. - If  $IX3FXSUMST(IR)$  is either strictly positive or strictly negative for all  $R$  this is not a problem. However, it could make sense to specify values of  $X3FX\_VAR\_T$  such that there is export in some time segments and import in others, but such that there is a zero net annual export. This situation is not handled in the model.

## 5 Auxiliary parameters for outputs

We have found that it may be convenient to have some internal parameters to hold various results. For this purpose we have defined a number of parameters, called auxiliary parameters. These parameters are only used to hold intermediate results for printing output, in contrast to those internal parameters described in Section 4.29 that are used as proper parts of the model. Such parameters are located in those files that are not proper part of the model (i.e., they are not found in files located in the subdirectory Model, cf. Section 2). The names of such auxiliary entities start with the letter O.

Error and logging are described in Section 11.2, and model output is described in Section 10.2.

## 6 Variables

The following are the main variables (endogenously determined values) of the model.

VOBJ "Objective function value (MMoney)"

VGE\_T(AAA,G,S,T) "Electricity generation (MW), existing units"

VGH\_T(AAA,G,S,T) "Heat generation (MW), existing units"

VX\_T(IRRRE,IRRRI,S,T) "Electricity export from region IRRRE to IRRRI (MW)"

VGEN\_T(AAA,G,S,T) "Electricity generation (MW), new units"

VGHN\_T(AAA,G,S,T) "Heat generation (MW), new units"

VGKN(AAA,G) "New generation capacity (MW)"

VXKN(IRRRE,IRRRI) "New electricity transmission capacity (MW)"

VDEF\_T(RRR,S,T,DEF\_STEPS) "Flexible electricity demands (MW)"

VDHF\_T(AAA,S,T,DHF\_STEPS) "Flexible heat demands (MW)" ;

VGHYPMS\_T(AAA,S,T) 'Contents of pumped hydro storage (MWh)'

VHYRS\_S(AAA,S) 'Hydro energy equivalent at the start of the season (MWh)'

VESTOLOADT(AAA,S,T) 'Loading of electricity storage (MW)'

VHSTOLOADT(AAA,S,T) 'Loading of heat storage (MW)'

VESTOVOLT(AAA,S,T) 'Electricity storage contents at beginning of time segment (MWh)'

VHSTOVOLT(AAA,S,T) 'Heat storage contents at beginning of time segment (MWh)'

VQEEQ(AAA,S,T,IPLUSMINUS) 'Feasibility in electricity equation QEEQ'

VQHEQURBAN(AAA,S,T,IPLUSMINUS) 'Feasibility in heat equation QHEQURBAN'

VQUESTOVOLT(AAA,S,T,IPLUSMINUS) 'Feasibility in electricity storage equation QUESTOVOLT'

VQHSTOVOLT(AAA,S,T,IPLUSMINUS) 'Feasibility in heat storage equation QHSTOVOLT'

VQHYSSEQ(AAA,S,IPLUSMINUS) 'Feasibility of QHYSSEQ'

VGE2LEVEL

In the GAMS language, the variables may be free, positive (i.e., non negative) or negative (i.e.g, non positive). The specification restriction of a variable according to this is done as indicated in the following: to non-negativity is specified by declaring the variables as POSITIVE VARIABLE as the following indicates:

FREE VARIABLE VOBJ;

POSITIVE VARIABLE VGE.T;

POSITIVE VARIABLE VGH.T;

etc.

Most variables are declared to be positive. The exception is VOBJ which cannot be constrained since it expresses the objective function value, which is unknown. In the GAMS language this is indicated by the specification FREE VARIABLE. All other variables are declared as positive.

Lower or upper bounds on the individual variables may be imposed by assignment of .LO and/or .UP, respectively. For certain constructions variables may have their values fixed, this may be done by assignment of .FX (or implicitly by assigning identical values for .LO and .UP).

Also the units in which the variables are measured are specified in the list above. There are only two kinds of units, related to money or power, respectively. The objective function variable VOBJ is in millions of Money terms (e.g., MEuro or MUSD) while all others are in MW terms.

The purpose of the variables with names starting with VQ is to secure feasibility in the equations, even if unfortunate values are entered for some of the energy system input. VQHSTOVOLT corresponds to equation QHSTOVOLT etc. The variables enter the objective function (specified in QOBJ, Section 7) with a large coefficient PENALTY and they will therefore only be positive if there will not otherwise be a feasible solution. If such variables are positive, an error message will be written, cf. Section 11.

The variables with names starting with VQ are declared also on IPLUSMINUS, see Section 3.8.11, i.e. there is one corresponding to 'plus' and 'minus'. These signs refer to sign in front of the variable when it is placed on the right hand side of the relational operator (=L=, =E= or =G=) in the corresponding equation.

To each variable a number of attributes are associated, Section 10.1.

## 7 Equations and constraints

The constraints in the GAMS model may be on the individual variables, cf. Section 6. More general constraints are called equations. This refers to both equality constraints (indicated by =E=) and inequality constraints (indicated by =L= for 'less than or equal' and =G= for 'greater than or equal').

The model contains the following equations:

QOBJ 'Objective function (MMoney)'  
QEEQ(RRR,S,T) 'Electricity generation equals demand'  
QHEQURBAN(AAA,S,T) 'Heat generation equals demand, urban areas'  
QHEQRURAL(AAA,S,T) 'Heat generation equals demand, rural areas'  
QGCBGBPR(AAA,G,S,T) 'CHP generation (back pressure) limited by Cb-line'  
QGCBGEXT(AAA,G,S,T) 'CHP generation (extraction) limited by Cb-line'  
QGCVGEXT(AAA,G,S,T) 'CHP generation (extraction) limited by Cv-line'  
QGGETH(AAA,G,S,T) 'Electric heat generation'  
QGNCBGBPR(AAA,G,S,T) 'CHP generation (back pressure) Cb-line, new'  
QGNCBEXT(AAA,G,S,T) 'CHP generation (extraction) Cb-line, new'  
QGNCVGEXT(AAA,G,S,T) 'CHP generation (extraction) Cv-line, new'  
QGNGETH(AAA,G,S,T) 'Electric heat generation, new'  
QGEKNT(AAA,G,S,T) 'Generation on new electricity cap, limited by cap'  
QGHKNT(AAA,G,S,T) 'Generation on new IGHONLY cap, limited by cap'  
QHNRURPROP(AAA,G,S,T) 'Proportional generation of heat in rural areas, new'  
QGKNHYRR(AAA,G,S,T) 'Generation on new hydro-ror limited by cap and water'  
QGKNWND(RRR,AAA,G,S,T) 'Generation on new windpower limited by cap and wind'  
QGKNSOL(RRR,AAA,G,S,T) 'Generation on new solarpower limited by cap and sun'  
QHYSSEQ(AAA,S) 'Hydropower with reservoir seasonal energy constraint'  
QGKNHYRR  
QHMINRS(AAA,G,S) 'Hydropower reservoir - minimum level'  
QHMAXRS(AAA,G,S) 'Hydropower reservoir - maximum level'  
QHMYING(AAA,G,S,T) 'Hydropower reservoir - minimum generation'  
QESTOVOLT(AAA,S,T) 'Electricity storage dynamic equation (MWh)'  
QESTOLOADT(AAA,S,T) 'Electricity storage loading less than heat production (MW)'  
QHSTOVOLT(AAA,S,T) 'Heat storage dynamic equation (MWh)'

QHSTOLOADT(AAA,S,T) 'Heat storage loading less than heat production (MW)'

QKFUELC(C,FKPOTSETC) 'Total capacity using fuel FFF is limited in country'

QKFUELR(RRR,FKPOTSETR) 'Total capacity using fuel FFF is limited in region'

QKFUELA(AAA,FKPOTSETA) 'Total capacity using fuel FFF is limited in area'

QXK(IRRRE,IRRRI,S,T) 'Transmission capacity constraint'

QLIMCO2(C) 'Limit on annual CO2-emission'

QLIMSO2(C) 'Limit on annual SO2 emission'

QLIMNOX(C) 'Limit on annual NOx emission'

QECOMBGKL(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QHCOMBGKL(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QNECOMBGKL(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QNHCOMBGKL(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QECOMBSLO(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QHCOMBSLO(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QNECOMBSLO(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QNHCOMBSLO(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QECOMBSUP(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QHCOMBSUP(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QNECOMBSUP(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QNHCOMBSUP(AAA,G,S,T): relevant for combination technologies, see Section 3.3.1.

QGE2LEVEL(AAA,G,S,T): relevant for technologies with slow regulation, changing only between workdays and weekend see Section 3.2.3.

The specification of an EQUATION consists of a declaration, as seen above, and a definition which gives the details. The definition starts with the name of the previously declared equation followed by ".." and then the algebra. In equations the relational operators  $\leq$ ,  $=$  and  $\geq$  are specified as =L=, =E= and

=G=, respectively. See the BALMOREL.GMS file for the details, and consult the GAMS User's Guide.

Most of the equations are expressed in MW. The exceptions are noted above.

Lower and upper bounds on the individual variables are described in Section 6.

## 8 Model and solve

In the GAMS language the word MODEL has the specific meaning of a collection of previously declared EQUATIONS. Hence, it is possible to declare more EQUATIONS than what are actually used in a specific model, and to specify several models from previously declared equations.

The specification of a model is done by stating MODEL followed by an identifier (the name of the model), possibly a short descriptive text and then, between "/" and "/", the equations to be included in the model. E.g. a very small model called "TINY", based on Section 7 could be

```
MODEL TINY Only for this example / QOBJ, QEEQ, QHEQURBAN /;
```

It is possible to use ALL if all the declared EQUATIONS are to be used. Thus, the "Balmorel" could be specified as

```
MODEL Balmorel Baltic Model for Regional Energy Liberalisation /ALL/;
```

Observe that in some of the auxiliary parts the name of the model is important, cf. Section 11.2.

To specify the solution of the model the SOLVE statement is used, e.g.

```
SOLVE Balmorel USING LP MINIMIZING VOBJ;
```

In this, VOBJ is the variable that holds the objective function value, cf. Section 6, and it is to be minimised (the alternative is to specify MAXIMIZING). The problem class is specified to be LP (linear programming).

Various further options related to the solution process may be applied. Some may be included in the SOLVE statement, some specified by using the OPTION statement. Useful options may be specified in relation to RESLIM, ITERLIM, HOLDFIXED. See the GAMS User's Guide.

## 9 Calibration

Most of the numerical values in the Balmorel model will be taken directly from data sources. Care should be taken to ensure that they are consistent. In general, this is not easy, but a discussion is outside the scope of the present document.

The model contains a few calibration parameters that may be tuned in an attempt to attain certain consistency between model simulation results and historically observed values.

Basically, there are four calibration parameters: GKDERATE, GEFFDERATE, DEFP\_CALIB and DHFP\_CALIB. The basic information about these parameters is given in their respective sections, 4.21.1, 4.10.4, 4.20.2 and 4.19.5.

The first two are used to attempt consistency between fuel consumption as determined in the model and as specified in energy statistics, respectively. GKDERATE limits the generation of the units, and hence the baseload units (the high merit order units) are not generating at full nominal capacity all 8760 hours of the year. This implies a certain generation on other units (the medium to low merit order units) that would otherwise not generate. Thus, this parameter changes the relative amounts of generation between the units. GEFFDERATE changes the relation between fuel consumption and electricity and heat generation of the individual units. (It may also change the relative merit order of the units.)

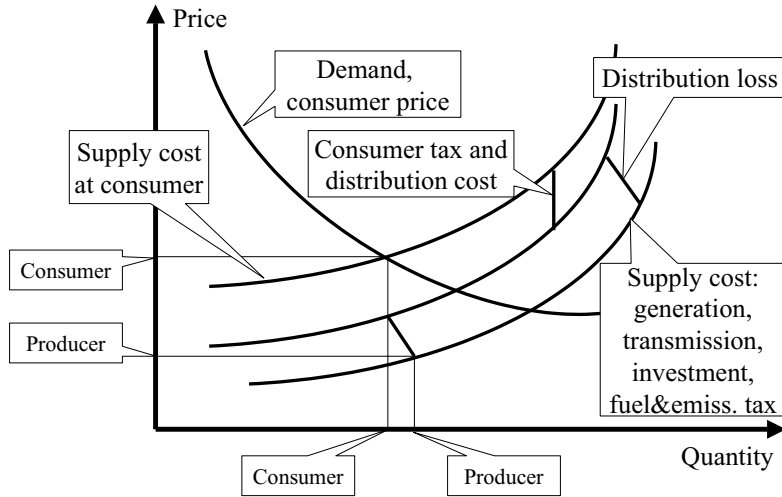


Figure 4: Illustration of elements in the calibration of demand functions

The last two parameters are used to attempt attainment of consistency between the consumption of electricity and heat as determined in the model and as specified in energy statistics, respectively. The point is that the model in principle has two methods to determine or specify prices of electricity and heat. One is to determine them through the marginal values related to cost components of generation (including fuel and emission taxes), distribution cost, correction for losses (in the case of electricity generation, possibly also transmission), and consumers' taxes on electricity and heat, respectively. The other way around the demand functions for electricity and heat, respectively, are specified directly through nominal values, profiles and elasticities, cf. Section 3.6. See Figure 4. Most probably, these two methods will yield prices that are not consistent. The effect of an inconsistency is that when a historical year is simulated (e.g., 1995) then the consumption of electricity and heat, respectively, as found in the model will not be the same as that observed historically. Moreover, the model permits identification of marginal values that differ between the time segments of the year, while historically most consumers have seen a price that has been constant over long time periods.

The parameters `DEFP_CALIB` and `DHFP_CALIB` permit a modification in the demand functions for electricity and heat in order to get such consistency.

The suggested sequence of calibration is first `GKDERATE` then `GEFFDERATE` and finally `DEFP_CALIB` and `DHFP_CALIB`.

## 9.1 Calibration of fuel consumption

### 9.1.1 Calibration of `GKDERATE`

The calibration of `GKDERATE` may be done with departure in a variety of sources. The overall purpose is to ensure a reasonable balance between generation on the various units. Data sources may be any, e.g. statistics over planned and forced outages of generation units. For thermal generation units, typical values for forced outages could be in the range 0.03 to 0.15. Scheduled outage could maybe be 2 to 8 weeks per year. Hence values of `GKDERATE` could typically be found in the range 0.7 to 0.95.

For wind power the apparent efficiency and capacity for a group of turbines will in general be different from that which may be immediately derived from the individual turbines. For instance for an installed capacity of 1000 MW, dispersed over a certain areas, the maximal generation will most probably never reach 1000 MW, due to forced and planned outages, and due to the fact that the wind speed is

not the same all over the area. Such phenomena may be reflected in GKDERATE.

The following explains in more detail the reasoning related to stochastic outages of dispatchable units.

### Modeling of stochastic outages

Consider the problem of modelling stochastic outages in the electricity system, more specifically the expected generation of the individual units.

Thus, assume  $n$  units with capacities  $\bar{x}_i$ , sorted in merit order. Each has a rate of forced outage of  $r_i$ . Consider one time period with demand  $d$ .

We take three models:

1. The "true" stochastic model
2. No consideration of outages
3. Capacity reduction model, i.e., the capacity  $\bar{x}_i$  is substituted by  $\bar{x}_i(1 - r_i)$ , and the problem is then solved deterministically.

### Example

Consider an example where  $\bar{x}_i = 100\text{MW}$  and  $r_i = 0.1$  for all  $i$ . Let  $d = 300\text{MW}$  and consider a time period of one hour.

Model 1.

Unit 1	on	on	on	off	on	off	off	off
Unit 2	on	on	off	on	off	on	off	off
Unit 3	on	off	on	on	off	off	on	off
Prob.:	0.729	0.081	0.081	0.081	0.009	0.009	0.009	0.001

Table 8: Probability of on-off combinations for the first three units

With the specified capacities and load the first three units should always be on. Table 8 gives the probabilities for the on-off combinations of these first three units. As seen, there is a probability of 0.729 that they are all three on, and consequently a probability of 0.271 that at least one will be forced out. The expected generation of the units are then 90MWh, see the Table 9.

Unit:	1	2	3	4	5	6
Prob. of attempted on:	1.0	1.0	1.0	0.271	0.0271	0.00271
Prob. of actually on:	0.9	0.9	0.9	0.2439	0.02439	0.002439
Expected prod., MWh:	90	90	90	24.39	2.439	0.2439

Table 9: Results for Model 1

When at least one of the first three units is unit off, unit 4 will be attempted applied. This happens with a probability of 0.271. Unit 4 will in these situations produce at 100 MW with probability 0.9 and hence its expected energy generation will be 0.2439 times 100MWh, i.e., 24.39MWh.

If unit 4 fails when attempted turned on then unit 5 will be attempted turned on. This attempt will happen with probability 0.0271. With probability 0.9 unit 5 will then turn on, and its expected energy generation will then be 2.439MWh. Continuation of reasoning will lead to the figures given in Table 9.

Model 2:

The similar table for model 2 is shown in Table 10. Observe, that as the model is not actually stochastic the terms "probability" and "expected" are somewhat misleading.

Model 3:

Unit:	1	2	3	4	5	6
Prob. of attempted on:	1.0	1.0	1.0	0.0	0.0	0.0
Prob. of actually on:	1.0	1.0	1.0	0.0	0.0	0.0
Expected generation, MWh:	100	100	100	0	0	0

Table 10: Results for Model 2

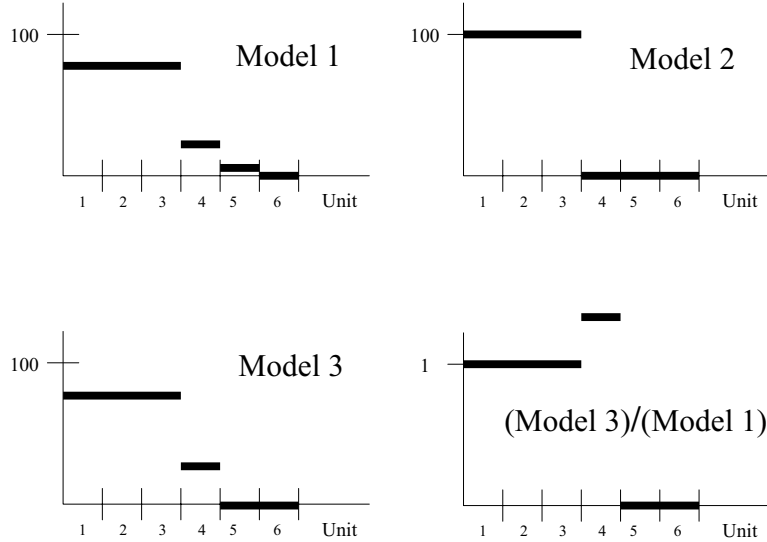


Figure 5: Expected generation (Models 1, 2 and 3) and comparison of results for Model 1 and Model 3

In this model, each of the units has a capacity of 90MW. Hence, the fourth unit will be applied with a generation of 30MW, and the figures are given in Table 11.

Unit:	1	2	3	4	5	6
Prob. of attempted on:	1.0	1.0	1.0	1.0	0.0	0.0
Prob. of actually on:	1.0	1.0	1.0	1.0	0.0	0.0
Expected generation, MWh:	90	90	90	30	0	0

Table 11: Results for Model 3

The graph in Figure 5 shows the expected energy generation for each unit in each of the three models. Taking Model 1 as the "true" model it is seen that Model 2 overestimates the energy generation for the first units (the good ones), and underestimates it for the last units. Model 3 comes closer to Model 1. Thus it has a correct representation of the expected energy generation for the first units, while it overestimates for the next unit and underestimates for the last units.

For Model 3 this is brought out more clearly in the last graph on Figure 5 which for each unit shows the expected energy generation of Model 3 in relation to that of Model 1.

### Generalisations

We may generalise the results as follows. Define indexes  $i_1$  and  $i_2$  such that  $\sum_{i=1}^{i_1} \bar{x}_i \leq d < \sum_{i=1}^{i_1+1} \bar{x}_i$  and  $\sum_{i=1}^{i_2-1} \bar{x}_i(1-r_i) < d \leq \sum_{i=1}^{i_2} \bar{x}_i(1-r_i)$ . As seen, for Model 3 all units with  $i \leq i_1$  will be on with capacity  $\bar{x}_i(1-r_i)$ , and all units with  $i_2 < i$  will be off. We define  $e_i^{M1}$  and  $e_i^{M3}$  to be the expected generation of unit  $i$

under Model 1 and Model 3, respectively. We assume for simplicity that  $0 < r_i < 1$  for all  $i$ , and give presentation of the results with a short argumentation.

Units with  $i \leq i_1$  will be on all time in Model 3 with power  $\bar{x}_i(1 - r_i)$ , while in Model 1 they will be attempted on and therefore have expected power  $\bar{x}_i(1 - r_i)$ . Hence  $e_i^{M1} = e_i^{M3}$  for  $i \leq i_1$ .

For  $i_1 < i < i_2$  the power in Model 3 will be  $\bar{x}_i(1 - r_i)$ . In relation to Model 1 we see that all units with  $i < i_1$  will be attempted run, and since  $1 - r_i > 0$  they will in fact be running some of the time. Hence for units with  $i_1 < i \leq i_2$  their expected power under Model 1 will necessarily be less than  $\bar{x}_i(1 - r_i)$  (which is the expected power when attempted on at full capacity), and therefore  $e_i^{M1} \leq e_i^{M3}$  for  $i_1 < i < i_2$ .

For unit  $i_2$ , which is the "marginal unit" in Model 3, it may be shown that  $e_{i_2}^{M1} < e_{i_2}^{M3}$  (if  $d$  is close to  $\sum_{i=1}^{i_2-1} \bar{x}_i(1 - r_i)$ ),  $e_{i_2}^{M1} = e_{i_2}^{M3}$ , or  $e_{i_2}^{M1} > e_{i_2}^{M3}$  (if  $d$  is close to  $\sum_{i=1}^{i_2} \bar{x}_i(1 - r_i)$ ).

For units  $i_2 < i$ ,  $e_i^{M3} = 0$ . Further,  $e_i^{M1} > 0$  since with positive probability all units with  $i \leq i_2$  will fail when attempted run. Therefore  $e_i^{M3} < e_i^{M1}$  for  $i_2 < i$ .

As seen, Model 3 provides an approximation to Model 1 such that "base load" units have the correct expected generations, "first reserve" units have overestimated generations, "second reserve" units have underestimated generations, while for the "marginal unit" the expected generation may be correct, overestimated or underestimated.

In terms of total costs it may be shown that the cost of Model 3 is less than or equal to that of Model 1.

### 9.1.2 Calibration of GEFDERATE

Once GKDERATE has been given its values, GEFDERATE may be specified. The aim could be that in the calibration year (e.g., 1995) there is, for the observed generation of electricity and heat, consistency between the fuel consumption as determined by the model and the fuel consumption observed historically.

The deviations between the two measures may be due to a variety of reasons. The following description assumes that the need for calibration can be meaningfully ascribed to the generation side, although also e.g. consumption, subdivision of the year into time segments, and unrealistic distribution losses could be responsible.

The reasons for deviations between the two measures may be many, even in relation to generation alone. For thermal units for instance, there will be a certain fuel consumption related to the start up of units; the efficiency for thermal units is not constant, but depends on the load; a certain additional loss may also be accredited to up- and down-regulation, relative to the loss encountered at steady level generation. Hence, the efficiency depends not only on technical factors, but also on the actual use of a unit.

For wind power the apparent efficiency and capacity for a group of turbines will in general be different from that which may be immediately derived from the individual turbines as discussed above. Such phenomena may be reflected in GKDERATE, but note that also for wind power there is inter-dependency with GEFDERATE and GDFE, where the latter may be found in various ways. The specific way chosen to calibrate for wind power will therefore in part depend on the data sources. Similar considerations hold for hydro power.

The following description exemplifies the calibration for some thermal units, assuming that historical data are available at a regional level. The same value of GEFDERATE will be assumed for all units participating in the calibration.

1. Define the set of generation technologies for which the calibration is to be performed. For instance, if backpressure and extration units will be considered, then specify "SET GEFSETCAL(G); GEFSETCAL(G)=NO; GEFSETCAL(IGEXT)=YES; GEFSETCAL(IGBPR)=YES;".

2. Define the set of fuels for which the calibration is to be performed. For instance, "SET FEFFSETCAL(F); FEFFSETCAL(F)=NO; FEFFSETCAL("NGAS")=YES; FEFFSETCAL("COAL")=YES;".
3. Select calibration year (e.g., 1995), and place the significant historical values for the calibration year in the relevant tables; essential are DE, DH, X3FX (and, if the relations between the fuel prices have changed significantly, also FUELP). Here, X3FX should be net electricity export in the calibration year to all other regions, IRRREspective of these being part of the model or not. DE should be that part of electricity consumption that is covered by the fuels and technologies selected above, multiplied by (1-DISLOSS\_E(IR)). Similarly for heat demand.
4. Specify the set Y to contain only the calibration year.
5. Specify FIRSTYEAR to be the calibration year.
6. Exclude the possibility of electricity transmission, see Section 12.5.
7. Exclude the possibility of new investments, see Section 12.4.
8. Specify in SETS.INC the following sets: "SET DEF\_D(DEF) / DEF\_DINF/;", "SET DEF\_U(DEF) / DEF\_UINF/;", " SET DHF\_D(DHF) / DHF\_DINF /;" and "SET DHF\_U(DHF) / DHF\_UINF /;". This ensures inelastic demand, cf. Section 3.6.
9. For the fuels and technologies selected above let GEFFDERATE be 1.
10. Make sure that the files PRINT1.INC, PRINT2.INC, PRT3-\*.INC, and PRT4-\*.INC are included in the model by a \$INCLUDE, and that there is a possibility to print out the fuel consumption for the fuels in question.
11. Run the model.
12. Calculate the quotient between the fuel consumption as found in the model and the historically observed fuel consumption.
13. If the values look reasonable (in particular they should be positive and not too far from 1) then let GEFFDERATE attain the value of the quotient for the generation technologies in question.
14. (The procedure may at this point be checked as follows: Run the model again. Now the fuel consumption in the calibration year should be close to that observed historically.)
15. Observe that the sets defined in Step 1 and Step 2 need not be the same for all countries. Therefore it may be necessary to run the calibration several times, one for each county, with changes between the sets specified in Step 1 and Step 2. Therefore the final table GEFFDERATE may have to be constructed by combining results from the individual runs.
16. Delete the sets constructed in Step 1 and Step 2, and specify the tables and sets that were modified above to have their desired contents, i.e., bring back the model to original status.

Since the values specified in Step 3 may differ between various runs, it may be convenient to keep the data separate. The auxiliary files GEFF\_CAL1.INC and GEFF\_CAL2.INC have been prepared for this purpose, and also in other ways there are deviations; however, the idea is the same. See the instructions in those files.

## 9.2 Calibration of demand functions

### 9.2.1 Calibration of DEFP\_CALIB and DHFP\_CALIB

The calibration of the demand function is only necessary if the demand is elastic. The purpose of the calibration is to get the model's demand to coincide with the observed values. This is done by modifying the base price IDEFP\_T by DEFP\_CALIB and IDHFP\_T by DHFP\_CALIB.

Calibration makes sense only if the geographical entity chosen contains those generation units that are price setting (marginal). Hence, if a region is heavy net exporter or importer of electricity, calibration can not meaningfully be made on this region alone.

In the following the calibration will be explained, assuming that the auxiliary file DFP\_CALIB.INC, located in subdirectory PRINT-INC, is used.

1. Select the geographical entity that will be used for calibration (specify the set C).
2. Select a calibration year (e.g., 1995), and place the significant historical values for the calibration year in the relevant tables; essential are DE, DH, X3FX and FUELP.
3. Specify the set Y to contain only the calibration year.
4. Specify FIRSTYEAR to be the calibration year.
5. Exclude the possibility of new investments, see Section 12.4. Exclude the possibility of transmission, see Section 12.5.
6. Make sure that the files PRINT1.INC, PRINT2.INC, PRT3-\*.INC, and PRT4-\*.INC are included in the model by a \$INCLUDE.
7. Let all the values in DEFP\_CALIB and DHFP\_CALIB be zero (e.g., place the statements "LOOP((IR,S,T), DEFP\_CALIB(IR,S,T)=0);" and "LOOP((IR,S,T), DHFP\_CALIB(IR,S,T)=0);" after DEFP\_CALIB and DHFP\_CALIB, respectively).
8. Include the statement "FILE DFP\_CALIB /..\OUTPUT \DFP\_CALIB.OUT/;" in file PRINT1.INC.
9. Include the statement "\$INCLUDE "DFP\_CALIB.INC";" in file PRT4-\*.INC.
10. Specify in SETS.INC the following sets: "SET DEF\_D(DEF) / DEF\_DINF/;", "SET DEF\_U(DEF) / DEF\_UINF/;", "SET DHF\_D(DHF) / DHF\_DINF /;" and "SET DHF\_U(DHF) / DHF\_UINF /;". This ensures inelastic demand.
11. Run the model.
12. Take the table DEFP\_CALIB in the file DFP\_CALIB.OUT and let it replace the relevant parts of the existing table DEFP\_CALIB. Take the table DHFP\_CALIB in the file DFP\_CALIB.OUT and let it replace the existing table DHFP\_CALIB. (Recall to remove the "LOOP .." statements if they were introduced above.)
13. Modify the sets DEF\_D(DEF), DEF\_U(DEF), DHF\_D(DEF) and DHF\_U(DEF) to include the desired steps in down- and upwards directions.
14. (The procedure may at this point be checked as follows: Run the model again. Now the consumption of electricity and heat in the calibration year should be equal to that specified in DE\_Y and DH\_Y, respectively, i.e. all up- and down- regulation steps should be zero. The values in the tables in the file DFP\_CALIB.OUT should now all be zero.)

15. Specify the tables that were modified in Step 1 to have their desired contents, specify possibilities of investment and transmission as desired (Step 5), delete or comment out the statements specified in Step 8 and Step 9, i.e., bring back the model to original status.

## 10 Output

There are two types of output, that generated automatically by the GAMS system, and that generated by auxiliary parts of the Balmorel model.

### 10.1 Automatically generated GAMS output

GAMS automatically generates two files after each run, the Balmorel.lst file and the Balmorel.log file.

The lst file contains a summary of model statistics and solution, including SOLVER STATUS, MODEL STATUS, OBJECTIVE VALUE. See the GAMS User's Guide for further information.

The lst file also contains an echo of the input with line numbers associated, usefull for identification. Errors detected by GAMS will be identified, see Section 11.1.

The lst file may also contain specific output if wanted by the user. Details may be controlled by various compiler directives in the form of OPTIONS and \$ON / \$OFF statements. For variables this will typically be their values.

Some options are OFFLISTING, OFFSYMXREF, OFFSYMLIST, OFFFUEL-LIST OFFFUELXREF, with the alternatives OFFLISTING, ONSYMXREF, ONSYMLIST, ONUELLIST, ONUELXREF are used to control printing of listing and cross references. ONINLINE makes it possible to comment out parts between /\* and \*/. LIMROW and LIMCOL specify the maximum number of rows and columns used in equations listing and inspection of details. SYSOUT controls the printing of the solved status in the list file. SOLPRINT controls the printing of the solution in the list file.

To each EQUATION in a solved model are associated a level and a marginal value, that may be referenced for printing, for instance for QOBJ as QOBJ.L and QOBJ.M, respectively. See the GAMS User's Guide for further information.

Similarly a number (six) of attributes are specified in relation to a variable, viz., the lower bound (.LO), the upper bound (.UP), a fixed value (.FX), a level (.L), a marginal or dual value (.M), a scale value (.SCALE) and a branching priority value (.PRIOR).

### 10.2 Balmorel auxiliary output

A number of auxiliary files have been designed to facilitate output from the Balmorel model. Four of these files are taken into the Balmorel model by the \$INCLUDE statement, viz., PRINT1.INC, PRINT2.INC, PRT3-\*.INC, PRT4-\*.INC. See Section 2 for location. Prints are generated from these, or from other files that are in turn included in the model by a \$INCLUDE statement in one of the mentioned files. See those files for further details.

Error checking is also reported and a log maintained, see Section 11.2.

Observe that quite a number of auxiliary include files for printing output are available. The user's computer may not be able to handle so many open files, therefore carefully specify those files to be produced in PRT4-\*.INC and comment out the remaining ones.

It is important to note that the information printed by auxiliary parts is not reliable if errors occurred during the execution of the GAMS program!

A spreadsheet environment is provided for assistance in processing the output.

The print files in the Balmorel model contain different results of the model simulation. All output files are located in the folder "printout" and are generated after each simulation with the Balmorel model (please note that the output files overwrite old output files from the previous simulation).

The print files that are to be generated after each simulation are specified in the files "prt4\_bb1.inc" and "prt4\_bb2.inc" in the folder "printinc". Output files that are commented out in "prt4\_bb1.inc" and "prt4\_bb2.inc" are not printed. The exception is "inputout.inc", which should be \$-included into the "balmorel.gms" file.

Contents of print-files

The maximum numbers of characters in the file name are 8 and the structure of the output file names are given by following letters:

- E: Electricity
- H: Heat
- F: Fuels
- M: Emissions (MCO<sub>2</sub>, MSO<sub>2</sub> and MNO<sub>x</sub>)
- G: Generation
- D: Demand
- P: Prices
- K: Capacity
- X: Transmission
- O: Old "existing" plants
- N: New plants
- C: Country
- R: Region
- A: Area
- Y: Year
- S: Season
- T: Time period within season
- Z: Summation

The first letter(s) indicate(s) the subject of the output files. Then there is an underscore followed by letters which indicate the level of detail. C, R or A indicates the geographical level of detail. Y, S or T indicates the level of time segments. The letter G indicates that information for each particular technology is available.

The letter Z is used to summarise over the following letters. Ex. the file "EZGN.RY" contains information about the total electricity generation from all new plants in each region per year.

If there are no letters to identify the geographic level the file contains information for all countries that are simulated in Balmorel. If there is no letter to identify the time segments the file contains information for the whole time span that is simulated in Balmorel.

A list of available print files is given in Table 12.

File	Description	Geographic level	Time structure
inputout	Overview of various input data to the Balmorel model	—	—
bal_1	Energy balance	Country	Year
eg_cy	Electricity generation from all technologies	Country	Year
eg_gat	Electricity generation from all technologies individually	Area	Time period
ego_cy	Electricity generation from old technologies	Country	Year
egn_cy	Electricity generation from new technologies	Country	Year
ezgo_cy	Total electricity generation from all old technologies	Country	Year
ezgn_cy	Total electricity generation from all new technologies	Country	Year
hg_cy	Heat generation from all technologies	Country	Year
hgo_cy	Heat generation from old technologies	Country	Year
hgn_cy	Heat generation from new technologies	Country	Year
ehf_ay	Fuel consumption from all technologies	Area	Year
ehf_ry	Fuel consumption from all technologies	Region	Year
ehf_cy	Fuel consumption from all technologies	Country	Year
ep_ry	Weighted average electricity generation price	Region	Year
ep_rt	Marginal electricity generation price	Region	Time period
ehf2_cy	Fuel consumption distributed on each fuel	Country	Year
exk_ry	Transmission capacities (old plus new) by the end of the year	Region	Year
ex_ry	Net electricity export	Region	Year
mco2_cy	CO2 emissions	Country	Year
mso2_cy	SO2 emissions	Country	Year
mnox_cy	NOx emissions	Country	Year
epnxt_rt	Marginal electricity generation cost of 'the next' unit	Region	Time period
hsto_at	Heat storage	Area	Time period
hsto2_at	Heat storage contents at the beginning of each time segment	Area	Time period

Table 12: Print files

### 10.3 The compare facility

In a number of cases it may be relevant to compare the results of different simulations (here called scenarios or variants). The present section describes a facility and the organization related to this. See also Section 12.3.

The file structure assumes that a base model and a number of scenario models are implemented. They are contained in parallel directories with the names "base" and e.g. "variant", "variant2", "variant3" etc. The purpose is to compare the result of the various scenarios with that of the base case. The simulations in the base case and in the scenarios are performed individually, and the basic idea is that the necessary results for comparison are saved in files that are used as input for the comparison.

The directory "base" contains the standard subdirectories ("model", "print-inc", "printout", "logerror", "compare", cf. Section 2). The directory "compare" may have subdirectories according to the kind of comparisons that are made; here it will be assumed that "demo" is the relevant subdirectory to "compare", and that the base case and "variant" will be compared, using the demonstration files distributed with the Balmorel model.

The following indicates the directory structure within the 'Balmorel' directory:

- base
  - compare
    - demo
      - cmpinc
      - cmpout
    - otherpossibilities
      - cmpinc
      - cmpout
  - logerror
  - model

- printinc
- printout
- variant
  - compare
    - demo
      - cmpinc
      - cmpout
    - otherpossibilities
      - cmpinc
      - cmpout
  - logerror
  - model
  - printinc
  - printout
- variant2
- variant3

The idea in the process of making scenarios or variants is the following. Since only a small part of the input data will differ between the base case and the variant, most of the input should be reused, not copied, to prevent against accidental differences. The invariant input is given in the data files in the `"/base/model/"` directory, and these files are `$-included` both in the base case and in the variant case. The input data that differ will be placed in files in the `"/variant/model/"` directory and then `$-included`. The `"Balmorel.gms"` file is to be found in both the base and the variant model directories.

Thus, for all input files that are the same, use `"$include ../../base/model/<filename>"` in the `"Balmorel.gms"` files. For files that differ, use `"$include ../../base/model/<filename>"` in the base case and `"$include <filename>"` in the variant case.

The following procedure is advocated for handling of changes of data in the 'variant' model, cf. also Section 12.3.

All original data are taken from the model in the 'base' directory. This is handled by the `'$-include ../../base/model/<filename>'` statements, where `<filename>` is a data file, e.g. `sets.inc`, `de.inc`, `trans.inc` etc. This way all original data are entered. In order to insert new data, the old ones must be replaced. This is done by the statements `'$if exist <filename> kill <identifier>'` and `'$if exist <filename> $include <filename>'`. Here the `<filename>` is the name of a file holding the new data and `<identifier>` is the name of the identifier, typically a parameter.

Example: assume that you want to use other cost for electricity transmission. The original data are in the table `XCOST` in the file `'base/model/trans.inc'`. Make a new file called `'xcost.inc'` (i.e., the same name as the parameter) and place it in `'variant/model/'` directory. The file starts with `'TABLE XCOST(IRRRE,IRRRI)'` and the table holds the new data. Place the two statements `'$if exist xcost.inc $kill xcost'` and `'$if exist xcost.inc $include xcost.inc'` in the file `'variant/model/Balmorel.gms'` immediately after `'$include ../../base/model/trans.inc'`. What will happen is that the `'$kill'` dollar control option removes all data in `XCOST` and resets `XCOST`, only the type and dimension are retained. The `'$include'` dollar control option then ensures that the file with new data is read. Observe that in order for the `'$kill'` option to work, the dollar control option `$ONMULTI` must be set, this is best done in the file `balgams.opt`.

The files used for printing the results are found in the `"/base/compare/demo/cmpinc"` directory. The declarations are given in `"initbase.cmp"`, and this file

also provides initialisation of `gams2prm.gms` (see below). Results to be used for comparison are transferred to intermediate parameters in `trnsbase.cmp`. The specific prints from the base simulation are specified in `savebase.cmp`. The result is printed to the file `baseout.cmp` in `/base/compare/demo/cmpout`

Observe that the option `$ONEMPTY` is specified in the printed file because all values may be zero, resulting in an empty parameter definition. When the printed file is `$-included`, the `$ONEMPTY` will become active (and remain so, unless overruled later by an `$OFFEMPTY`).

In the base case (run from base directory), `$-include` the three files into `balbase1.sim` as follows: `initbase.cmp` at the very top, `trnsbase.cmp` immediately after `$INCLUDE ../../base/printinc/prt4-bb1.inc` and `savebase.cmp` at the very end. This ensures that declarations will be kept outside of loops. In the variant case the files specifying the process to make the comparison are found in `variant/compare/demo/cmpinc/`. The names are `initvar.cmp`, `trnsvar.cmp` and `savevar.cmp`.

To proceed with a demonstration in relation to Balmorel do as follows:

- In the base case (run from `/base/model/` directory), `$-include` the three files into `balbase1.sim` as follows: `initbase.cmp` at the very top, `trnsbase.cmp` immediately after `$INCLUDE ../../base/printinc/prt4-bb1.inc` and `savebase.cmp` at the very end. Note that this ensures that declarations will be kept outside of loops.
- Run the Balmorel file in the base scenario.
- Now there should be a new file `baseout.cmp` in `../compare/demo/cmpout/`.
- In the `variant/model/` directory there should be the files `balmorel.gms` and `balbase1.sim`. Make sure that the latter file is `$-included` into the former (using `$include balbase1.sim`, not `$include ../../base/model/balbase1.sim`).
- In the variant case (run from `variant/model/` directory), `$-include` the three files into `balbase1.sim` as follows: `initvar.cmp` at the very top, `trnsvar.cmp` immediately after `$INCLUDE ../../base/printinc/prt4-bb1.inc` and `savevar.cmp` at the very end.
- Run the Balmorel model in the variant scenario.
- Find the results of the comparison in the files `variant.out` in the `variant/compare/demo/cmpout/` directory.
- The expected result is that differences are zero since input data in both simulations are identical. To introduce a difference, copy `de.inc` from `/base/model/` to `variant/model/`; change a number in the latter file for a relevant year and region; replace `$INCLUDE ../../base/model/de.inc` in `variant/model/balmorel.gms` by `$INCLUDE de.inc`; run the variant model. Now there should be differences to be observed in `variant.out`.
- Try to make similar exercise with respect to `balbase2.sim`.

The implementation is based on the files `gams2prm.gms` (could also, with minor modifications, be `gams2txt.gms`). It is necessary that the directory `inclub` (a subdirectory to the GAMS-library) contains these files. The files may be downloaded from `http://debreu.colorado.edu/inclub/gams2txt.htm` (accessed 25.02.2003) (or go through `http://www.gams.com/contrib/contrib.htm` where you choose `GAMS Programming Utilities by Tom Rutherford` (accessed 25.02.2003)), and this site also contains documentation of the files.

See also in `/base/compare/documentation/` the demonstration program `g2p-demo.gms` concerning `gams2prm.gms` and `g2t-demo.gms` concerning `gams2txt.gms`.

## 11 Errors and Log

We distinguish between errors that are detected automatically by the GAMS system and errors that are detected by auxiliary parts of the Balmorel model.

### 11.1 Errors automatically detected by GAMS

If there are errors detected automatically by GAMS they will in the Balmorel.lst file be marked by four stars, hence a convenient way to locate them is to search for the string "\*\*\*\*". If there are errors, then at the end of the Balmorel.lst file there will be a list of errors and a description of the possible cause of each error. User errors are indicated by the statement "\*\*\*\* USER ERROR(S) ENCOUNTERED". Other error types are marked by e.g. "\*\*\*\* EXECUTION ERROR", "\*\*\*\* MATRIX ERROR", or "\*\*\*\* PUT ERROR". See the GAMS User's Guide for further information.

### 11.2 Errors detected by Balmorel auxiliary parts

A number of error checks have been specified in the files ERROR1.INC, ERROR2.INC, ERROR3.INC. See Section 2 for location.

These files are included in the BALMOREL.GMS file by the \$INCLUDE statement. If any of these files are included (i.e., they are not all commented out) the file PRINT1.INC must also be included (Section 10.2).

The error checking mainly concerns the numerical values of the input. The error checking tries to detect if the values specified are "reasonable". For instance, fuel efficiency would for most generation units be expected to take a value between, say, 0.3 and 0.9. On the other hand, it might be that values outside this range were relevant for some applications. In order to catch as many errors as possible, the range should be as small as possible, but in order not to indicate an error where there is none, the range should be large. Thus, a balance has to be achieved.

If an error (which, as just argued, need not be an "error") is detected, a specification is written to the file ERRORS.OUT. To see the exact reason for the identification of the error, see the appropriate ERROR\*.INC file. The number of errors encountered is held in the parameter ERRORS. In any case, a summary is printed in ERRORS.OUT and also in the file LOGFILE.OUT.

(In a few cases the error check is not reported to ERRORS.OUT but rather results in a deliberate computation error. In this case follow the instructions given.)

The balbase1.mss file, see Section 2 for location, will print a summary of the model and solver status to the LOGFILE.OUT file for the BALBASE1 model. Similarly for other models, in particular BALBASE2.

Finally observe that the information in the auxiliary files described in this Section is not valid if there are user error(s) encountered, cf. Section 11.1.

### 11.3 Sequence of log and error observations

The very first step is to observe if the attempts to interpret the input and generate the model were successful. Therefore inspect the Balmorel.lst file to see if it contains the statement "\*\*\*\* USER ERROR(S) ENCOUNTERED", if this is the case then this should be fixed, cf. Section 11.1. The information in the output files described in Section 11.2 is in this case not valid.

After simulation, the user must first observe if the attempt was successful. Again, errors will be documented in the Balmorel.lst file, following "\*\*\*\*". This for instance could be "\*\*\*\* EXECUTION ERROR". Also during printout errors may occur, indicated e.g. by "\*\*\*\* PUT ERROR". See Section 11.1.

If the execution of GAMS was successful, further information may be acquired by using the facilities provided in the auxiliary parts described in Section 11.2.

This is intended to be more expedient, however, it can of course not be guaranteed that the auxiliary parts will be free of errors! If there are errors here, then using the GAMS standard output is the way to detect them. Moreover, some errors are detrimental to the intended functioning of the auxiliary parts, and therefore the information in the auxiliary parts is only reliable if there were no errors detected by the GAMS system. Also observe that if for instance no solution was found (which is also some sort of normal completion!) the information in the auxiliary parts may be unreliable.

If the auxiliary parts are used, the following procedure should be followed. First check the LOGFILE.OUT file, see Section 11.2. For a successful simulation there should be a declaration that there were no errors detected in the input, and that the solution efforts were successful. (Remember to check the date and time, because if there were errors detected by GAMS, the LOGFILE.OUT file may not be updated.)

If errors were detected in the input, then see the output file from the error detection, cf. Section 11.2.

If the solution is not successful then study the error messages in the LOGFILE.OUT and in the Balmorel.lst files. See the GAMS User's Guide for further information.

And finally: there are of course many modeling errors that neither GAMS nor the auxiliary parts can detect, but only the user.

## 12 Model variants

The above description refers to the "standard" version of the Balmorel model. In the following, a number of obvious modifications will be described.

### 12.1 Why variants

In any modeling work choices are made as to what to include in the model and what not. Many objectives are balanced in this process. Therefore, a model that may be suited for one purpose may be less appropriate for another. Moreover, if every possible application, and therefore the most detailed level of representation of the energy sector was attempted, the model would not be appropriate to any application.

To obtain maximum flexibility, the Balmorel model is coded in a high level modeling language (GAMS) and the code itself is available to any user. The user therefore has complete control over the model and therefore also over modifications. This permits a wider range of potential applications.

In the following a number of obvious modifications will be described.

### 12.2 Types of changes

Obviously, some modifications are easy while others are more complicated. The following classification may be suggested, where the first modifications are very simple, and the last one more complicated.

- Limit the scope of the model, while maintaining basic structure. Thus for instance with respect to geography, the model represents a number of countries, as given by the set CCC. It is elementary to delete some of the countries from the model by declaring the set C to be a proper subset of CCC. It is not much more complicated to reduce the number of regions or areas within a country, although some consistency is required, see Section 3.1. Reduction of the number of years simulated is elementary and reduction of the number of time segments is discussed in Section 3.2.2. Reduction in the number of generation technologies is elementary, Section 3.3. Reduction in the number of fuels is described in Section 3.4.

- Change the values of the data entered. It is elementary to change the values of input parameters. Observe that the auxiliary parts involve some checking for "reasonable" values, see Section 11.2, and if therefore unanticipated values are entered, error messages may occur; in this case, the user is advised to revise the data and error checking.
- Enlarge the model with elements very similar to those that are already there. New countries, with their associated regions and areas may easily be introduced. The model contains a number of energy transformation technologies in the set GGG and more - provided they are similar to one of the existing technology types, see Section 3.8.9 - may be added by copying the ideas in the representations already there and then filling in the required parameter values. Additional fuel types may be introduced in the set FFF (and the appropriate pointers introduced in GDFUEL, see Section 3.3). Additional years may be introduced into YYY without difficulties, and the number of time segments may also be increased, see Section 3.2.2 and Section 12.8.
- Change the model structure. The model structure consists of the parameters and variables in the model and the relations between them (see more specifically Section 13). On this issue it is not possible to specify the efforts involved as they depend heavily on the specific requirements. However, really many modifications to the structure can be made by an effort which is considerable smaller than that of acquiring the associated data.

The first items have explicitly or implicitly been covered in the preceding parts. In the sequel the last item is therefore addressed by way of examples. Section 12.3 briefly describes aspects of the organisation of modifications.

### 12.3 Organising modifications

Obviously there must be some internal consistency between the data in the model. Part of this is obtained by maintaining the proper sequence of the statements (cf. Section 1.3).

Observe that there are in this respect the following parts of the model (excluding auxiliary files):

- The first part of the BALMOREL.GMS file, down to but excluding the first \$INCLUDE statement (not counting the auxiliary files)
- The SETS.INC file
- The declaration of internal sets in the BALMOREL.GMS file
- The other \*.inc files (not counting the auxiliary files)
- The following part of the BALMOREL.GMS file

During execution, the model is composed by including the include files into the BALMOREL.GMS file. For this to work properly, the SETS.INC file must be included before any of the other include files.

However, the other include files may come in arbitrary order, since they only contain numerical values, contained in tables (or otherwise) directly specified by the user. (Possibly there may immediately after a table be an assignment modifying or complementing the values given in the TABLE (e.g. to user specified default values, see Section 4.27); in such cases the assignments should always follow immediately after the TABLE.) Hence, any table is independent of any other table, and the sequence does not matter.

All the internal parameters are derived after all the include files have been included (not counting the auxiliary files).

For this reason modifications in input data (i.e., what is contained in the \*.inc files, not counting the auxiliary files) may be given quite flexibly. New static sets should be placed in the file SETS.INC. New tables should be placed in the appropriate include files (cf. Section 2), or they (and any new sets) may be placed in a new file that is taken into the BALMOREL.GMS file by an \$INCLUDE statement; this statement should be placed after the \$INCLUDE SETS.INC and before the handling of the internal sets and parameters (e.g., it may be placed immediately after the \$INCLUDE SETS.INC statement).

See also the description in Section 10.3.

Changes in the model structure are exemplified in the sequel.

Any modifications made should be in a form that is consistent with the other parts of the Balmorel model. Here is a checklist:

- Did you observe the conventions on notation? See Section 1.4 and see 'naming' in the index.
- Did you observe the conventions on location of sets, parameters, etc., Section 2?
- Did you remember to give a description of the sets, parameters introduced (including specification of the units or measurement wherever relevant, Section 4)?
- Did you observe the restriction on the use on GAMS version, Section 1.3? (You may check this by including a "\$USE225" at the top of the Balmorel.gms file (with the \$ in the first column). Unfortunately, this seems not to enforce the restriction of identifiers and labels to have a maximum of ten characters.)

## 12.4 No new investments

The model is intended for analysis of long term development and therefore contains as an integrated feature the possibility to expand generation and electrical transmission capacities according to economic criteria.

User specified expansion and de-commissioning of generation capacity is specified in the parameter GKFX, Section 4.22.1.

Automatically generated expansion of generation capacity will be undertaken for those technologies for which a 1 is specified for GDKVARIABL in GDATA. If investment in new generation capacity should not be allowed this may be implemented by setting a 0 for GDKVARIABL in GDATA.

Another way, that will not delete the information contained in GDKVARIABL in GDATA is the following. Include the line

$$VGKN.FX(IA,G) = 0;$$

in the BALMOREL.GMS annual updating section.

Finally, a possibility is to assign 'AGKN(IA,G)=NO' immediately before the SOLVE statement.

If investment in new electrical transmission capacity should not be allowed this may be implemented as follows. Include the line

$$VXKN.FX(IRE,IRI) = 0;$$

in the BALMOREL.GMS annual updating section.

## 12.5 No electricity transmission

Electricity transmission between regions may be excluded by including the following statement

$$VX\_T.FX(IRE,IRI,S,T) = 0;$$

in the BALMOREL.GMS annual updating section.

Observe that this will not influence transmission to third regions. Also observe that the above modification will prevent transmission within a country that has more than one region. To permit such transmission anyway, the above statement should be refined to the following form:

$$LOOP(C,VX\_T.FX(IRE,IRI,S,T)\$(NOT(CCCRRR(C,IRE) AND CCCRRR(C,IRI)))=0);$$

[This feature is not properly tested.]

## 12.6 Price dependent electricity exchange with third countries

Price dependent electricity exchange with places outside the simulated geographical scope ('third countries') may be used together with the fixed electricity exchange with third countries. The price-quantity relationships are given as a piecewise step function. There are card(X3VSTEP) (Section 12.6) steps applied in simulation, and card(X3VSTEP0) steps may be given in the data. The length (MW) of each import step is X3VIMQ and X3VEXQ (Section 12.6) of each export step. The associated prices are X3VIMP and X3VIMP (Section 12.6), respectively. The prices are given on a yearly basis, the value for the currently simulated year are held in IX3VPIM\_Y, and IX3VPEX\_Y (Section 12.6). The exchange is assumed to be lossless and without transmission cost.

Potential places with which there may be price dependent electricity exchange are given in the set X3VPLACE (Section 12.6). The simulated price dependent electricity exchange transmission connections are specified in the set X3VX (Section 12.6). The set RX3VSUBSTI (Section 12.6) may be used to reduce the risk of user errors.

Internal sets related to price dependent electricity exchange are IX3V\_Y, Section 12.6. Associated variables are VX3VIM\_T and VX3VEX\_T, Section 12.6.

Observe that there is with this construction no relationship with the fixed electricity exchange with third countries (Section 4.11.1), i.e., the two types of exchange exist side by side.

Name	Domain	Type	Unit	Defined in	Page
IX3V_Y	(RRR,X3VPLACE,X3VSTEP0,S,T)	set	-	SETS.INC	77
IX3VPIM_Y	(RRR,X3VPLACE,X3VSTEP0,S,T)	parameter	Money/MWh	BALMOREL.GMS	78
IX3VPEX_Y	(RRR,X3VPLACE,X3VSTEP0,S,T)	parameter	Money/MWh	BALMOREL.GMS	78
RX3VSUBSTI	(RRR,X3VPLACE)	set	-	SETS.INC	77
X3VPEX	(YYY,RRR,X3VPLACE,X3VSTEP0,SSS,TTT)	parameter	Money/MWh	???	77
X3VPIM	(YYY,RRR,X3VPLACE,X3VSTEP0,SSS,TTT)	parameter	Money/MWh	???	77
X3VPLACE	-	set	-	SETS.INC	77
X3VQEX	(RRR,X3VPLACE,X3VSTEP0,SSS,TTT)	parameter	MW	???	77
X3VQIM	(RRR,X3VPLACE,X3VSTEP0,SSS,TTT)	parameter	MW	???	77
X3VSTEP0	-	set	-	SETS.INC	76
X3VSTEP	(X3VSTEP0)	set	-	SETS.INC	77
X3VX	(RRR,X3VPLACE)	set	-	SETS.INC	77
VX3VIM_T	(RRR,X3VPLACE,X3VSTEP0,S,T)	variable	MW	BALMOREL.GMS	78
VX3VEX_T	(RRR,X3VPLACE,X3VSTEP0,S,T)	variable	MW	BALMOREL.GMS	78

### X3VSTEP0

The set X3VSTEP0 holds the steps of the piecewise constant function giving the relationships between quantity and price for the price dependent electricity exchange with third countries. The definitions is like /X3VSTEP01\*X3VSTEP03/ if three steps are used. X3VSTEP0 is used to hold data in the data base, while the subset X3VSTEP (Section 12.6) is used to indicate the steps used in simulation.

### **X3VSTEP**

The set X3VSTEP holds the simulated steps of the piecewise constant function giving the relationships between quantity and price for the price dependent electricity exchange with third countries. The set is a subset of X3VSTEP0 (Section 12.6) and the definition is like SET X3VSTEP(X3VSTEP0) /X3VSTEP01\*X3VSTEP02/ if two steps are used. (If no exchange is wanted, "IX3VSTEP(X3VSTEP)=NO" may be used, however, it is recommended that X3VX is used, Section 12.6.).

### **X3VPLACE**

The set of regions with which there can be price dependent electricity exchange, Section 12.6, is given by SET X3VPLACE, defined e.g. like /X3VFARAWAY, X3VGERMAN, X3VPOLAND/. The set is used for holding data, while the set actually simulated is specified in the set X3VX (Section 12.6).

### **X3VX**

The combinations of RRR and X3VPLACE that are to be simulated for price dependent electricity exchange, Section 12.6, is given by SET X3VX(RRR,X3VPLACE). This set may be interpreted to specify the transmission lines that are assumed to be in operation between regions in the simulated geographical scope (set IR) and third countries (set X3VPLACE). If e.g. the region 'DK\_W' is in IR and 'X3VGERMAN' is in X3VPLACE then X3VX('DK\_W','X3VGERMAN')=YES will specify that a transmission line is assumed to be in operation between the two places, and X3VX('DK\_W','X3VGERMAN')=NO that it is not. Observe that price dependent electricity exchange only will be possible for regions in IR, i.e. regions that are in the set C of simulated countries.

### **RX3VSUBSTI**

The set RX3VSUBSTI is used in relation to the price dependent electricity exchange with third countries, Section 12.6. It indicates (by assigning YES) if elements in X3VPLACE (Section 12.6) is a substitute for a region in RRR. If it is, the price dependent exchange should by assumption only be used if the region is NOT included in a country in set C, i.e. the set RX3VSUBSTI(IR,X3VPLACE) (where IR is a region in C) should be empty. Observe that the only function of the set RX3VSUBSTI is to help the user to avoid errors by printing an error message if relevant.

The declaration is SET RX3VSUBSTI(RRR,X3VPLACE). If there are no substitutes then define RX3VSUBSTI(RRR,X3VPLACE)=NO, otherwise give the real information, if any, e.g. RX3VSUBSTI('DE\_R','X3VGERMAN')=YES;

### **IX3V\_Y**

The internal set IX3V\_Y(RRR,X3VPLACE,X3VSTEP0,S,T) is used to hold the combinations (RRR,X3VPLACE,X3VSTEP0,S,T) for which price dependent electricity exchange with third countries (Section 12.6) are relevant during the currently simulated year.

### **X3VQIM, X3VQEX, X3VPIM, X3VPEX**

The parameters X3VQIM and X3VPIM hold the quantity-price relationship for import in relation to price dependent electricity exchange, Section 12.6, and the parameters X3VQEX and X3VPEX hold the quantity-price relationship for export in relation to price dependent electricity exchange. Unit: Money/MWh for X3VPIM and X3VPEX, MW for X3VQIM and X3VQEX. The declarations are:  
X3VPIM(YYY,RRR,X3VPLACE,X3VSTEP0,SSS,TTT)  
X3VQIM(RRR,X3VPLACE,X3VSTEP0,SSS,TTT)

X3VPEX(YYY,RRR,X3VPLACE,X3VSTEP0,SSS,TTT)  
X3VQEX(RRR,X3VPLACE,X3VSTEP0,SSS,TTT)

X3VQIM holds the limit (upper bound, step length) on import and X3VQEX on export for each particular step corresponding to the price X3VPIM and X3VPEX, respectively.

Comment on input data: It will be assumed that prices should be positive. For import the prices should be increasing with ord(X3VSTEP0), for export the prices should be decreasing with ord(X3VSTEP0).

### IX3VPIM\_Y, IX3VPEX\_Y

The internal parameters IX3VPIM\_Y(RRR,X3VPLACE,X3VSTEP0,SSS,TTT) and IX3VPEX\_Y(RRR,X3VPLACE,X3VSTEP0,SSS,TTT) hold the prices for price dependent electricity exchange with third countries, Section 12.6, the currently simulated year.

### Variables VX3VIM\_T, VX3VEX\_T

VX3VIM\_T(RRR,X3VPLACE,X3VSTEP0,S,T) "Imported third country price dependent electricity (MW)"

VX3VEX\_T(RRR,X3VPLACE,X3VSTEP0,S,T) "Exported third country price dependent electricity (MW)"

## 12.7 Reserve generation capacity

[This feature is not properly tested.]

It is common to model an electricity system with a constraint expressing that a certain generation capacity must be available. One version of this may be achieved as follows. It is assumed that the requirement is that in every region the available capacity in each year must exceed the maximum over (S,T) of nominal electricity demand DE by a certain percentage.

1. Make a SET GKRESSET(G) holding those generation technologies that may count as providing reserve. E.g., it could be identical to the already defined set IGDISPATCH(G).
2. Declare a PARAMETER GKRES(RRR) to hold the desired capacities.
3. Assign the appropriate values to GKRES. Thus, if e.g. 20% reserve capacity is desired in all regions, the following statement may be made:

$$\text{GKRES}(\text{IR}) = \text{DE}(\text{Y}, \text{IR}) * (\text{SMAX}((\text{S}, \text{T}), \text{DE\_VAR\_T}(\text{IR}, \text{S}, \text{T})) / (\text{IDE\_SUMST}(\text{IR}))) * 1.2;$$

4. Declare an EQUATION QGKRES(RRR).

5. Define the EQUATION as e.g.

QGKRES(IR)..

$$\text{SUM}(\text{IA}\$(\text{RRRAAA}(\text{IR}, \text{IA})), \text{SUM}(\text{GKRESSET}, \text{IGKFX\_Y}(\text{GKRESSET}, \text{IA}) + \text{GKVACCCO\_Y}(\text{GKRESSET}, \text{IA}) + \text{VGKN}(\text{GKRESSET}, \text{IA})) = \text{G} = \text{GKRES}(\text{IR});$$

(An alternative version could multiply the capacities by GKDERATE.)

6. Include QGKRES in the list of equations specifying the MODEL, see Section 8.

## 12.8 Finer subdivision of the year

The subdivision of time within the year is given by the sets SSS, S, TTT and T. A number of parameters depend on this subdivision, see Section 4.19 and Section 4.20. All these parameters are found in the file VAR.INC, cf. Section 2.

From a given subdivision it is easy to aggregate such that only one time segment per year is used, cf. Section 3.2.2.

If another subdivision is desired (with more than one segment per year), then the mentioned sets and all the parameter values in Section 4.19 and Section 4.20 must be changed accordingly.

As a consequence of such revised subdivision it should be expected that also the calibration must be repeated, cf. Section 9.

A version for use with hourly values over one year is due to be made available in 2004.

## 12.9 Making more parameters depend on the year

Some of the parameters have been made dependent on the year, e.g., demands (parameters DE and DH) and fuel prices (parameter FUELPRICE). It might for certain analyses be desirable to have more parameters depending on the year, e.g. distribution costs and losses, generating units' efficiencies, etc.

This may be done by copying the ideas from those parameters that presently do depend on the year, e.g. DE (see Section 4.29.30).

## 12.10 Making more parameters depend on geography

Description to be entered.

## 12.11 Market power

A version dealing with incomplete competition and market power in the electricity sector is due to be made available in 2004.

## 12.12 Markets for emission, renewable energy and JI

Markets for tradable CO<sub>2</sub> emission permits (TEP), markets for tradable green certificates, and joint implementation are relevant issues for modelling using Balmorel. See "Co-existence of electricity, TEP and TGC markets in the Baltic Sea Region" at the Balmorel home page for an example.

## 12.13 Investment costs depend on technical life time

[This feature is not properly tested.]

Investment decisions related to generation technology depend among other things on the product of the investments cost, given in GDATA(G,'GDINVCOST'), and ANNUITYC. This choice of representation is motivated in part by the expectation that the economical life time of the generation units is not longer than the technical life time, and therefore the technical life time need not be represented. However, in some studies this may be inappropriate. The following describes the introduction of this dependency.

1. Declare in the file GEOGR.INC the PARAMETER ANNUITYGC(GGG,CCC) and enter the appropriate values in a TABLE, e.g. as

```
TABLE ANNUITYGC(GGG,CCC)
      Denmark Estonia Finland
CC-Con00-G 0.1627 0.1993 0.1627
GHydro-res INF 0.0806 0.0651 ;
```

ANNUITYGC(G,C) $\$(ANNUITYGC(G,C) EQ 0)=0.1315;$

(As seen, also a default value of 0.1315 has been entered (corresponding to a 10% interest rate with 15 years of economic life time, cf. Table 6 and Section 4.5.1).)

2. In the file BALMOREL.GMS all instances of ANNUITYC(C) should be replaced by ANNUITYGC(G,C), except where it is multiplied by XINVCOST.

In the above modification the investment on transmission capacity will be evaluated using the values in ANNUITYC.

If the modification desired is not directed towards differentiation of the life time within the set of generation technologies but rather towards the differentiation between life times for (all) generation technologies and transmission, then the following modification could be used.

1. Declare in the file GEOGR.INC the PARAMETER ANNUITYXC(CCC) and enter the appropriate values.
2. In the file BALMOREL.GMS all instances of ANNUITYC(C) that are multiplied by XINVCOST should be replaced by ANNUITYXC(C).

It is possible to introduce the two types of modifications simultaneously.

## 12.14 Version numbering and referencing

The Balmorel model exists in various versions. We shall here clarify the naming of these.

A distinction will be made between model structure and data (cf. also Sections 1.2 and 13). By model structure is mainly meant identifiers (i.e., the names) of the SCALARS, PARAMETERS, VARIABLES, SETS and EQUATIONS in the model, plus additional information like limitations on variables (declarations as POSITIVE or FREE, specifications of bounds (.UP, .LO, or .FX)), and the structure related to the dynamics. By the data is meant the actual labels (i.e., members) in the SETS and the actual numerical values assigned to SCALARS and PARAMETERS. Thus, the present document deals with model structure and not with data.

The identification of different versions should distinguish between model structure versions and data versions.

If therefore an analysis is performed where the model used consists of e.g. a model structure called Balmorel version 2.17, modified to exclude transmission, and using data that mostly consisted of data called Balmorel version 2.10, this may be referred to as " ... the analysis used the Balmorel model structure version 2.17, modified to exclude transmission. The data used in the analysis was based on Balmorel data set version 2.10, modified as follows: .... ".

## 13 Overview of model structure components

The model structure consists of the sets, parameters and variables in the model and the relations between them, as described in the preceding pages. Here an overview of the components will be given.

The table identifies in alphabetical order all sets, obligatory set members, scalars, parameters, variables, and equations in the Balmorel model, with specification of the units in which they are given (where relevant, see also page 38), in which file the component is declared and at which page in this document the component is described.

Another way to get an overview over the model components is the use the compiler directives \$ONSYMREF, \$ONSYMLIST, \$ONUPELLIST and \$ONUELXREF (the \$ in the first position of the line) which produce maps in the LST file.

Not identified in the table are the following aspects:

- Upper bounds and lower bounds on variables
- The internal working of the linking between technology and fuel use, cf. Section 4.8.1.
- The sequence of the statements. A particular case of this is the annual updating parts (linking the individual years).
- The constants 8760, 365, 24 and 3.6.

Name	Domain	Type	Unit	Defined in	Page
1995, 1996,..	-	obl. set member	(none)	SETS.INC	23
AAA	-	set	-	SETS.INC	22
AAARURH	(AAA)	set	-	SETS.INC	22
AAAURBH	(AAA)	set	-	SETS.INC	22
AGKN	(AAA,GGG)	set	-	SETS.INC	30
ANNUITYC	(CCC)	parameter	(none)	GEOGR.INC	40
C	(CCC)	set	-	SETS.INC	21
CCC	-	set	-	SETS.INC	21
CCRRR	-	set	-	SETS.INC	22
DAYTYPE	-	set	-	SETS.INC	25
DE	(YYY,RRR)	parameter	MWh	DE.INC	43
DE_VAR_T	(RRR,SSS,TTT)	parameter	(none~MW)	VAR.INC	47
DEF	-	set	-	SETS.INC	31
DEF_D1	-	set	-	SETS.INC	32
DEF_D2	-	set	-	SETS.INC	32
DEF_STEPS	(RRR,SSS,TTT,.. ...,DF_QP,DEF)	parameter	(none), Money/MWh	GEOGR.INC	48
DEF_U1	-	set	-	SETS.INC	32
DEF_U2	-	set	-	SETS.INC	32
DEFP_BASE	(RRR)	parameter	Money/MWh	GEOGR.INC	41
DEFP_CALIB	(RRR,SSS,TTT)	parameter	Money/MWh	GEOGR.INC	47
DF_QP	-	set	-	SETS.INC	31
DF_PRICE	-	obl. set member	Money/MWh	GEOGR.INC	31
DF_QUANT	-	obl. set member	MW	GEOGR.INC	31
DH	(YYY,AAA)	parameter	MWh	DH.INC	43
DH_VAR_T	(AAA,SSS,TTT)	parameter	(none~MW)	VAR.INC	46
DHF	-	set	-	SETS.INC	32
DHF_STEPS	(AAA,SSS,TTT,.. ...,DF_QP,DEF)	parameter	(none), Money/MWh	GEOGR.INC	49
DHF_D1	-	set	-	SETS.INC	32
DHF_D2	-	set	-	SETS.INC	32
DHF_U1	-	set	-	SETS.INC	32
DHF_U2	-	set	-	SETS.INC	32
DHFP_BASE	(AAA)	parameter	Money/MWh	GEOGR.INC	41
DHFP_CALIB	(AAA,SSS,TTT)	parameter	Money/MWh	GEOGR.INC	46

Name	Domain	Type	Unit	Defined in	Page
DISCOST_E	(RRR)	parameter	Money/MWh	GEOGR.INC	40
DISCOST_H	(AAA)	parameter	Money/MWh	GEOGR.INC	41
DISLOSS_E	(RRR)	parameter	(none)	GEOGR.INC	40
DISLOSS_H	(AAA)	parameter	(none)	GEOGR.INC	41
FFF	-	set	-	SETS.INC	29
FDCO2	-	obl. set member	kg/GJ	FUELS.INC	30
FDATASET	-	set	-	SETS.INC	30
FDATA	(FFF,FDATASET)	set	-	SETS.INC	41
FDNB	-	obl. set member	(none)	FUELS.INC	30
FKPOTA	(FKPOTSETA,AAA)	parameter	MW	GEOGR.INC	45
FKPOTC	(FKPOTSETC,CCC)	parameter	MW	GEOGR.INC	46
FKPOTR	(FKPOTSETR,RRR)	parameter	MW	GEOGR.INC	45
FKPOTSETA	(FFF)	set	-	SETS.INC	30
FKPOTSETC	(FFF)	set	-	SETS.INC	30
FKPOTSETR	(FFF)	set	-	SETS.INC	30
FDSO2	-	obl. set member	kg/GJ	FUELS.INC	30
FUELPRICE	(YYY,AAA,FFF)	parameter	Money/GJ	FUELP.INC	48
G	(GGG)	set	-	SETS.INC	26
GGCOMB	(GGG,IGGGALIAS)	set	-	SETS.INC	28
GGG	-	set	-	SETS.INC	26
GDCB	-	obl. set member	-	SETS.INC	43
GDCV	-	obl. set member	-	SETS.INC	44
GDATASET	-	set	-	SETS.INC	26
GDES02	-	obl. set member	-	SETS.INC	44
GEFFDERATE	(GGG,AAA)	parameter	(none)	GEOGR.INC	42
GDATA	(GGG,GDATASET)	parameter	-	SETS.INC	43
GDFE	-	obl. set member	-	SETS.INC	44
GDFROMYEAR	-	obl. set member	-	SETS.INC	44
GDFUEL	-	obl. set member	-	SETS.INC	43
GDINVCOST0	-	obl. set member	-	SETS.INC	44
GDINVCOST	(GGG,AAA)	parameter	MMoney/MWh	GEOGR.INC	42
GDKVARIABL	-	obl. set member	-	SETS.INC	44
GDN0X	-	obl. set member	-	SETS.INC	44
GDOMFCOST0	-	obl. set member	-	SETS.INC	44
GDOMVCOST0	-	obl. set member	-	SETS.INC	44
GDOMVCOST	(GGG,AAA)	parameter	Money/MWh	GEOGR.INC	42
GDOMFCOST	(GGG,AAA)	parameter	MMoney/MW	GEOGR.INC	42
GDAUXIL	-	obl. set member	-	SETS.INC	44
GDTYPE	-	obl. set member	-	SETS.INC	43
GKDERATE	(GGG,AAA,SSS)	parameter	(none)	GEOGR.INC	48
GKFX	(YYY,AAA,GGG)	parameter	MW	GKFX.INC	48
HYP PROFILS	(AAA,SSS)	parameter	Money/MWh	VAR.INC	46
IA	(AAA)	int. set	-	BALMOREL.GMS	33
IAGKN	(AAA,G)	int. set	-	BALMOREL.GMS	36
IANYSET	-	int. set	-	BALMOREL.GMS	50
ICA	(XYZ)	int. set	-	BALMOREL.GMS	33
IARURH	(AAA)	int. set	-	BALMOREL.GMS	33
IAURBH	(AAA)	int. set	-	BALMOREL.GMS	33
IBALVERSN	-	int. scalar	-	BALMOREL.GMS	50
IDAYSIN_S	(S)	int. parameter	(none)	BALMOREL.GMS	51
IDE.SUMST	(RRR)	int. parameter	(none~MWh)	BALMOREL.GMS	52
IDE.T_Y	-	int. parameter	MW	BALMOREL.GMS	55
IDEFP_T	-	int. parameter	Money/MWh	BALMOREL.GMS	55
IDH.SUMST	(AAA)	int. parameter	(none~MWh)	BALMOREL.GMS	52
IDH.T_Y	-	int. parameter	MW	BALMOREL.GMS	55
IDHFP_T	-	int. parameter	Money/MWh	BALMOREL.GMS	55

Name	Domain	Type	Unit	Defined in	Page
IFUELP_Y	(AAA,FFF)	int. parameter	Money/GJ	BALMOREL.GMS	54
IG2LEVEL	(G)	int. set	-	BALMOREL.GMS	34
IGBPR	(G)	int. set	-	BALMOREL.GMS	34
IGCND	(G)	int. set	-	BALMOREL.GMS	34
IGDISPATCH	(G)	int. set	-	BALMOREL.GMS	35
IGETOH	(G)	int. set	-	BALMOREL.GMS	34
IGEOREH	(G)	int. set	-	BALMOREL.GMS	36
IGEXT	(G)	int. set	-	BALMOREL.GMS	34
IGGGALIAS	alias (GGG)	int. set	-	BALMOREL.GMS	36
IGHOB	(G)	int. set	-	BALMOREL.GMS	34
IGHORHERUR	(G)	int. set	-	BALMOREL.GMS	36
IGHYRS	(G)	int. set	-	BALMOREL.GMS	34
IGKFX_Y	(GGG,AAA)	int. parameter	MW	BALMOREL.GMS	53
IGKE	(G)	int. set	-	BALMOREL.GMS	35
IGKH	(G)	int. set	-	BALMOREL.GMS	35
IGKVACCTOY	(G,AAA)	int. parameter	MW	BALMOREL.GMS	53
IGNOTETOH	(G)	int. set	-	BALMOREL.GMS	35
IGNUC	(G)	int. set	-	BALMOREL.GMS	34
IGSOL	(G)	int. set	-	BALMOREL.GMS	34
IGWND	(G)	int. set	-	BALMOREL.GMS	34
IHOURLIN24	(T)	int. parameter	(none)	BALMOREL.GMS	52
IHOURLINST	(S,T)	int. parameter	(none)	BALMOREL.GMS	51
ILIM_CO2_Y	(C)	int. parameter	t	BALMOREL.GMS	54
ILIM_NOX_Y	(C)	int. parameter	kg	BALMOREL.GMS	55
ILIM_SO2_Y	(C)	int. parameter	t	BALMOREL.GMS	54
IM_CO2	(G)	int. parameter	kg/GJ	BALMOREL.GMS	53
IM_SO2	(G)	int. parameter	kg/GJ	BALMOREL.GMS	53
IOFxyz	-	int. scalar	-	BALMOREL.GMS	50
IPLUSMINUS	-	int. set	-	BALMOREL.GMS	36
IR	(RRR)	int. set	-	BALMOREL.GMS	33
ISALIAS	alias (S)	int. set	-	BALMOREL.GMS	33
ISCALAR1	-	int. scalar	-	BALMOREL.GMS	50
ISOL_SUMST	(AAA)	int. parameter	(none~MWh)	BALMOREL.GMS	52
IST	(S,T)	int. set	-	BALMOREL.GMS	34
ISTS	(S)	int. set	-	BALMOREL.GMS	34
ISTT	(T)	int. set	-	BALMOREL.GMS	34
ITALIAS	alias (T)	int. set	-	BALMOREL.GMS	33
ITAX_CO2_Y	(YYY,CCC)	int. parameter	Money/t	BALMOREL.GMS	54
ITAX_NOX_Y	(YYY,CCC)	int. parameter	Money/kg	BALMOREL.GMS	54
ITAX_SO2_Y	(YYY,CCC)	int. parameter	Money/t	BALMOREL.GMS	54
IWEIGHTSUMS	(S)	int. parameter	(none)	BALMOREL.GMS	51
IWEIGHTSUMT	(T)	int. parameter	(none)	BALMOREL.GMS	51
IWIND_SUMST	(AAA)	int. parameter	(none~MWh)	BALMOREL.GMS	52
IWTRRRSUM	(AAA)	int. parameter	(none~MWh)	BALMOREL.GMS	53
IWTRRSSUM	(AAA)	int. parameter	(none~MWh)	BALMOREL.GMS	53
IXKINLY	(IRRRE,IRRRR)	int. parameter	MW	BALMOREL.GMS	54
IXKN	(IRRRE,IRRRR)	int. set	-	BALMOREL.GMS	54
IX3FX_T_Y	(RRR,S,T)	int. parameter	MW	BALMOREL.GMS	55
IX3FXSUMST	(RRR)	int. parameter	(none~MWh)	BALMOREL.GMS	53
LIM_CO2	(YYY,CCC)	obl. set member	t	MPOL.INC	32
LIM_NOX	(YYY,CCC)	obl. set member	kg	MPOL.INC	32
LIM_SO2	(YYY,CCC)	obl. set member	t	MPOL.INC	32
MPOLSET	-	set	-	SETS.INC	32
PENALTY	-	scalar	-	SETS.GMS	39

Name	Domain	Type	Unit	Defined in	Page
QECOMBGKL	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QECOMBSLO	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QECOMBSUP	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QHCOMBGKL	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QHCOMBSLO	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QHCOMBSUP	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QNECOMBGKL	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QNECOMBSLO	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QNECOMBSUP	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QNHCOMBGKL	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QNHCOMBSLO	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QNHCOMBSUP	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	29
QEEQ	(RRR,S,T)	equation	MW	BALMOREL.GMS	58
QESTOVOLT	(AAA,S,T)	equation	MW	BALMOREL.GMS	58
QESTOLOADT	(AAA,S,T)	equation	MW	BALMOREL.GMS	58
QGCGBPR	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QGCBGEXT	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QGCVGEXT	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QGGETOH	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QGNCBGBPR	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QGNCBGEXT	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QGNCVGEXT	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QNGETOH	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QGEKNT	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QGE2LEVEL	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	59
QGHKNT	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QKKNWND	(RRR,AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QGKNSOL	(RRR,AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QGKNHYRR	(AAA,G,S,T)	equation	MMoney	BALMOREL.GMS	58
QHSTOVOLT	(AAA,S,T)	equation	MW	BALMOREL.GMS	58
QHSTOLOADT	(AAA,S,T)	equation	MW	BALMOREL.GMS	59
QHYSSEQ	(AAA,S)	equation	MMoney	BALMOREL.GMS	58
QHEQURBAN	(AAA,S,T)	equation	MW	BALMOREL.GMS	58
QHEQRURAL	(AAA,S,T)	equation	MW	BALMOREL.GMS	58
QHNURPROP	(AAA,G,S,T)	equation	MW	BALMOREL.GMS	58
QKFUELC	(C,FKPOTSETC)	equation	MW	BALMOREL.GMS	59
QKFUELR	(RRR,FKPOTSETR)	equation	MW	BALMOREL.GMS	59
QKFUELA	(AAA,FKPOTSETA)	equation	MW	BALMOREL.GMS	59
QLIMCO2	(C)	equation	ton	BALMOREL.GMS	59
QLIMSO2	(C)	equation	ton	BALMOREL.GMS	59
QLIMNOX	(C)	equation	kg	BALMOREL.GMS	59
QOBJ		equation	MMoney	BALMOREL.GMS	58
QXK	(IRRRE,IRRRI,S,T)	equation	MW	BALMOREL.GMS	59

Name	Domain	Type	Unit	Defined in	Page
RRR	-	set	-	SETS.INC	21
RRRAAA	-	set	-	SETS.INC	22
S	(SSS)	set	-	SETS.INC	24
SOLFLH	(AAA)	parameter	hours	GEOGR.INC	41
SOL_VAR_T	(AAA,SSS,TTT)	parameter	(none~MW)	VAR.INC	46
SSS	-	set	-	SETS.INC	24
T	(TTT)	set	-	SETS.INC	24
TAX_CO2	-	obl. set member	Money/t	MPOL.INC	32
TAX_DE	(CCC)	parameter	Money/MWh	GEOGR.INC	40
TAX_F	(FFF,CCC)	parameter	Money/MWh	GEOGR.INC	42
TAX_DH	(CCC)	parameter	Money/MWh	GEOGR.INC	40
TAX_NOX	-	obl. set member	Money/kg	MPOL.INC	32
TAX_SO2	-	obl. set member	Money/t	MPOL.INC	32
TTT	-	set	-	SETS.INC	24
TWEEKEND	-	set	-	SETS.INC	25
TWORKDAY	-	set	-	SETS.INC	25
VDEF_T	(RRR,S,T,DET_STEPS)	variable	MW	BALMOREL.GMS	56
VDHF_T	(AAA,S,T,DHFSTEPS)	variable	MW	BALMOREL.GMS	56
VGE2LEVEL	(AAA,G,S,DAYTYPE)	variable	MW	BALMOREL.GMS	57
VESTOLOADT	(AAA,S,T)	variable	MW	BALMOREL.GMS	56
VESTOVOLT	(AAA,S,T)	variable	MWh	BALMOREL.GMS	56
VGKN	(AAA,G)	variable	MW	BALMOREL.GMS	56
VGE_T	(AAA,G,S,T)	variable	MW	BALMOREL.GMS	56
VGEN_T	(AAA,G,S,T)	variable	MW	BALMOREL.GMS	56
VGH_T	(AAA,G,S,T)	variable	MW	BALMOREL.GMS	56
VGHN_T	(AAA,G,S,T)	variable	MW	BALMOREL.GMS	56
VHSTOLOADT	(AAA,S,T)	variable	MW	BALMOREL.GMS	56
VHSTOVOLT	(AAA,S,T)	variable	MWh	BALMOREL.GMS	57
VOBJ	-	variable	MMoney	BALMOREL.GMS	56
VQEEQ	(RRR,S,T,IPLUSMINUS)	variable	MW	BALMOREL.GMS	57
VQUESTOVOLT	(AAA,S,T,IPLUSMINUS)	variable	MWh	BALMOREL.GMS	57
VQHEQURBAN	(AAA,S,T,IPLUSMINUS)	variable	MW	BALMOREL.GMS	57
VQHSTOVOLT	(AAA,S,T,IPLUSMINUS)	variable	MWh	BALMOREL.GMS	57
VQHYSSEQ	(AAA,S)	variable	MW	BALMOREL.GMS	57
VXKN	(IRRRE,IRRRI)	variable	MW	BALMOREL.GMS	56
VX_T	(IRRRE,IRRRI,S,T)	variable	MW	BALMOREL.GMS	56
WEIGHT_S	(SSS)	parameter	(none)	VAR.INC	39
WEIGHT_T	(TTT)	parameter	(none)	VAR.INC	39
WND_VAR_T	(AAA,SSS,TTT)	parameter	(none~MW)	VAR.INC	46
WNDFLH	(AAA)	parameter	hours	GEOGR.INC	41
WTRRSVARS	(AAA,SSS)	parameter	(none~MW)	VAR.INC	46
WTRRRVAR_T	(AAA,SSS,TTT)	parameter	(none~MW)	VAR.INC	46
WTRRRFLH	(AAA)	parameter	hours	GEOGR.INC	41
WTRRSFLH	(AAA)	parameter	hours	GEOGR.INC	41
X3FX	(YYY,RRR)	parameter	MWh	X3FX.INC	42
X3FX_VAR_T	(RRR,SSS,TTT)	parameter	(none~MW)	VAR.INC	47
XCOST	(IRRRE,IRRRI)	parameter	Money/MWh	TRANS.INC	45
XINVCOST	(IRRRE,IRRRI)	parameter	Money/MWh	TRANS.INC	45
XKINI	(IRRRE,IRRRI)	parameter	MW	TRANS.INC	44
XLOSS	(IRRRE,IRRRI)	parameter	(none)	TRANS.INC	45
Y	(YYY)	set	-	SETS.INC	23
YVALUE	(YYY)	parameter	(none)	SETS.INC	39
YYY	-	set	-	SETS.INC	23

## Index

- ' (quotes), 10
- (none), 38
- \*\*\*\*, 72
- \*, comment, 12
- \*, multiplication, 11
- \*, set intersection, 33
- \*, with labels, 10
- +, ++, next, 26
- +, addition, 11
- +, set union, 33
- +, table continuation, 12
- , set difference, 33
- , subtraction, 11
- . (dot), 22
- .., delimiter with equations, 59
- /\*\*/, comment, 12
- /, division, 11
- /, slash, delimiter, 10
- /, slash, in path names, 9
- =, 11, 12
- =E=, 11, 60
- =G=, 11, 60
- =L=, 11, 60
- \$USE225, 9, 75
- 1995,...,2030, 23
- 3.6, 38
- 365, 366, 365.24, 39
  
- 24, 38, 52
- 365, 24, 38, 39, 51
- 8760, 24, 38, 39
- 8784, 39
  
- AAA, 19, 22
- AAARURH, 22
- AAAURBH, 22
- AGKN, 30
- ALIAS, 10, 33
- ALL, 60
- AND, 12
- annual updating section, 75
- ANNUITYC, 40
- ascii, 15
- assignment, 10–12
- assignment, sets, 33
- asterisk notation, 10
- attribute, 57, 67
- auxiliary, 18, 50, 56, 74
  
- back pressure unit, 34
- BALBASE1, 18, 72
- balbase1, 16, 72
- balbase2, 16
- BALMOREL.GMS, 16
  
- base load, 60
- BSR, Baltic Sea Region, 8
  
- C, 19, 21
- CAL, 14
- calibration, 60
- capacity (production), 35, 48
- capacity (transmission), 44
- CARD, 26
- cartesian product, 10
- case sensitive, 11
- CCC, 19, 21
- chp, 48
- chronology, 24, 26, 39
- city, 22
- cmp (file extension), 14
- co-generation, 48
- COMB, 14
- combination technology, 27
- comment out, 12, 18
- comments, 12
- commissioning, 75
- compare facility, 69
- compiler directive, 67, 81
- complement (set), 33
- condensing unit, 34
- conditional expression, 12
- constraint, 58
- country, 21
  
- data, 80
- data entry, 12
- data structure, 8
- Data-pre-inc subdirectory, 17
- day, 24
- DAYTYPE, 25
- DE, 43
- DE.INC, 16
- DE-VAR-T, 47
- declaration, 10, 12
- DEF, 31
- DEF\_D1, 32
- DEF\_D2, 32
- DEF\_STEPS, 48
- DEF\_U1, 32
- DEF\_U2, 32
- default, 12, 38, 42
- default (user specified), 38, 49
- definition, 10
- DEFP\_BASE, 41
- DEFP\_CALIB, 47
- demand, 30
- DF\_PRICE, 31
- DF\_QP, 31

DF\_QUANT, 31  
 DFP\_CALIB.INC, 66  
 DH, 43  
 DH.INC, 16  
 DH\_VAR\_T, 46  
 DHF, 32  
 DHF\_D1, 32  
 DHF\_D2, 32  
 DHF\_STEPS, 49  
 DHF\_U1, 32  
 DHF\_U2, 32  
 DHFP\_BASE, 41  
 DHFP\_CALIB, 46  
 difference (set), 33  
 dimension (sets), 10  
 DIS, 14  
 DISCOST\_E, 40  
 DISCOST\_H, 41  
 DISLOSS\_E, 40  
 DISLOSS\_H, 41  
 dispatch, 22, 28, 35  
 DISPLAY, 10  
 Documentation subdirectory, 19  
 dollar include, 13  
 dollar operator, 12  
 dot (.), 22  
 duration, 40  
 dynamic set, 10, 33  
 dynamics, 80  
  
 E, =E=, 11, 60  
 economic dispatch, 22, 28  
 elastic demand, 13, 31  
 electric heating, 34  
 electricity storage, 34  
 element in set, 10, 19, 36  
 ELSEIF, 12  
 emission policy, 32  
 EMPTY, 71  
 endogenous, 10, 11, 23, 56  
 entry order, 10, 26  
 EPS, 12  
 EQ, equal to, 11  
 EQUATION, 10, 11, 58  
 ERROR.INC, 72  
 errors, 72  
 ERRORS.OUT, 72  
 Euro, 38  
 exceptions, 12  
 exogenous, 10, 23, 38  
 extended arithmetic, 11  
 extraction unit, 34  
  
 FDATA, 41  
 FDATASET, 30  
 FDCO2, 30  
 FDN2O, 15, 30  
  
 FDNB, 30  
 FDSO2, 30  
 FFF, 29  
 file name, 15  
 files, 15  
 FKPOTA, 45  
 FKPOTC, 46  
 FKPOTR, 45  
 FKPOTSETA, 30  
 FKPOTSETC, 30  
 FKPOTSETR, 30  
 flexible demand, 13  
 FLH, 14  
 FOR, 9, 12  
 FOR-DOWNT0, 9, 12  
 FOR-TO, 9, 12  
 FREE, 11, 57  
 FREE variable, 57  
 fuel, 28, 29  
 FUEL.INC, 16  
 FUELP.INC, 16  
 FUELPRICE, 48  
 full load hours, 14  
 FX, 11, 14, 57, 67, 80  
  
 G, 26  
 G, =G=, 11, 60  
 GAMS, 9  
 GAMS homepage, 9  
 GAMS User's Guide, 9  
 gams2prm, 71  
 gams2txt, 71  
 GCOMB, 44  
 GDATA, 43  
 GDATASET, 26  
 GDAUXIL, 26, 44  
 GDCB, 26, 43  
 GDCH4, 15, 26  
 GDCOMB, 26, 28  
 GDCOMBSK, 26, 28, 44  
 GDCOMBSLO, 26, 28, 44  
 GDCOMBSUP, 26, 28, 44  
 GDCV, 26, 44  
 GDES02, 26, 44  
 GDFE, 26, 44  
 GDFROMYEAR, 26  
 GDFROMYEAR , 44  
 GDFUEL, 26, 43  
 GDINVCOST, 42  
 GDINVCOST0, 26, 44  
 GDKVARIABLE, 26, 44  
 GDLIFETIME, 15, 26  
 GDNOX, 26, 44  
 GDOMFCOST, 42  
 GDOMFCOST0, 26, 44  
 GDOMVCOST, 42  
 GDOMVCOST0, 26, 44

GDTYPE, 26, 43  
 GE, greater or equal, 11  
 GEFF\_CAL1.INC, 65  
 GEFF\_CAL2.INC, 65  
 GEFFDERATE, 42  
 generation technology, 26  
 GEOGR.INC, 16  
 geography, 19  
 GGCOMB, 28  
 GGG, 26  
 Gigajoule, 38  
 GJ, 38  
 GKDERATE, 48  
 GKFX, 48  
 GKFX.INC, 16  
 gms (file extension), 14  
 GMT, Greenwich Mean Time, 25  
 GT, greater than, 11

heat only, 34  
 heat storage, 15, 34  
 heatpump, 34  
 HOLDFIXED, 60  
 homepage, GAMS, 9  
 homepage, Balmorel, 8  
 HY, 14  
 hydro power, 26, 34  
 hydro power storage, 15  
 hydro run-of-river, 34  
 HYPPROFILS, 46

IA, 33  
 IAGKN, 36  
 IANYSET, 50  
 IARURH, 33  
 IAURBH, 33  
 IBALVERSN, 50  
 ICA, 33  
 IDAYSIN\_S, 51  
 IDE\_SUMST, 52  
 IDE\_T\_Y, 55  
 IDEFP\_T, 55  
 identifier, 10, 11, 60, 80  
 IDH\_SUMST, 52  
 IDH\_T\_Y, 55  
 IDHFP\_T, 55  
 IF-ELSE, 12  
 IFUELP\_Y, 54  
 IG2LEVEL, 34  
 IGBPR, 34  
 IGCND, 34  
 IGCMB1, 29, 34  
 IGCMB2, 29, 34  
 IGDISPATCH, 28, 35  
 IGE, 35  
 IGEE, 35  
 IGREENOSTO, 35

IGEH, 35  
 IGEOREH, 36  
 IGESTO, 34  
 IGETOH, 34  
 IGEXT, 34  
 IGGGALIAS, 36  
 IGH, 35  
 IGHH, 35  
 IGHHNOSTO, 35  
 IGHOB, 34  
 IGHORHERUR, 36  
 IGHSTO, 34  
 IGHYRR, 34  
 IGHYRS, 34  
 IGKE, 35, 48  
 IGKENOSTO, 35  
 IGKFINN, 36  
 IGKFX\_Y, 53  
 IGKH, 35, 48  
 IGKHNOSTO, 35  
 IGKKNOWN, 36  
 IGKVACCTOY, 53  
 IGNOTETOH, 35  
 IGNUC, 34  
 IGSOL, 34  
 IGWND, 34  
 IHOURSIN24, 52  
 IHOURSINST, 51  
 IHYINF\_S, 52  
 ILIM.CO2\_Y, 54  
 ILIM.NOX\_Y, 55  
 ILIM.SO2\_Y, 54  
 IM.CO2, 53  
 IM.SO2, 53  
 imperfect competition, 79  
 inc (file extension), 14  
 INCLUDE, 13  
 include file, 13  
 inelastic demand, 32  
 INF, 11, 12  
 INI, 14  
 initbase.cmp, 71  
 initvar.cmp, 71  
 INLINE, 12  
 input parameter, 38  
 input set, 19, 32  
 internal parameter, 38, 50  
 internal set, 19, 32  
 intersection (set), 33  
 INV, 14  
 investment, 30  
 IOF, 50  
 IPLUSMINUS, 36, 57  
 IR, 33  
 IRE, 33  
 IRI, 33  
 IRRRE, 33

IRRRI, 33  
 ISALIAS, 33  
 ISCALAR1, 50  
 ISOL\_SUMST, 52  
 IST, 15, 34  
 ISTS, 15, 34  
 ISTT, 15, 34  
 ITALIAS, 33  
 ITAX\_CO2\_Y, 54  
 ITAX\_NOX\_Y, 54  
 ITAX\_SO2\_Y, 54  
 ITERLIM, 60  
 IWEIGHSUMS, 51  
 IWEIGHSUMT, 51  
 IWND\_SUMST, 52  
 IWTRRRSUM, 53  
 IWTRRSSUM, 53  
 IX3FX\_T\_Y, 55  
 IX3FXSUMST, 53  
 IX3V\_Y, 77  
 IX3VPEX\_Y, 78  
 IX3VPIM\_Y, 78  
 IXKINL\_Y, 54  
 IXKN, 54

JI, joint implementation, 79  
 joint implementation, JI, 79

k, kg, kilogram, 38  
 key words, 11  
 KILL, 70  
 kilogram, 38

L, 67  
 L, =L=, 11, 60  
 L, level, 11, 67  
 label, 11, 19, 36, 38, 80  
 LE, less or equal, 11  
 level, 67  
 LIM, 14  
 LIM\_CO2, 32  
 LIM\_NOx, 32  
 LIM\_SO2, 32  
 LIMCOL, 67  
 LIMROW, 67  
 linear programming, 11, 60  
 Linux, 8, 9, 15  
 list, 38  
 LISTING, 67  
 LO, 11, 57, 67, 80  
 load duration, 40  
 LOG file, 17, 67  
 LogError subdirectory, 15, 18  
 LOGFILE.OUT, 72  
 logical expression, 12  
 LOOP, 10, 12  
 loss, el. distribution, 40  
 loss, el. transmission, 45  
 loss, heat distribution, 41  
 lower case letter, 9  
 LP, 60  
 LP, linear programming, 11  
 LST, 67  
 LST file, 17, 67  
 LT, less than, 11

m (milli), 38  
 M (million), 38  
 M, MARGINAL, 11, 67  
 M\_POL, 48  
 mapping, 22  
 marginal unit, 66  
 marginal value, 67  
 market power, 79  
 MAX, 11  
 MAXIMIZING, 60  
 med (file extension), 14  
 medium load, 60  
 megawatt, 38  
 member of set, 10, 19, 36  
 merit order, 60  
 milli, 38  
 MIN, 11  
 MINIMIZING, 60  
 MODEL, 10, 60  
 model structure, 80  
 Model subdirectory, 15, 16  
 modelled, 8  
 Money, 38  
 MPOL.INC, 16  
 MPOLSET, 32  
 mss, 18, 72  
 MULTI, 70  
 multi fuel, 28  
 MW, 38  
 MWh, 38

NA, 12  
 naming, 13, 23, 24, 26, 30  
 NE, not equal to, 11  
 new generation tech., 30  
 NO, 33  
 nominal, 20, 30, 32, 43, 55, 60, 78  
 normal completion, 73  
 NOT, 12  
 NOT, set complement, 33

OBJECTIVE VALUE, 67  
 obligatory set member, 38  
 obligatory value, 44, 50  
 OFF: see next letter, 86  
 OM, 14  
 ON-/OFF-: see next letter, 86  
 ON: see next letter, 86

ONEMPTY, 32  
 opt (file extension), 14  
 OPTION, 60, 67  
 OR, 12  
 ORD, 26  
 ordered set, 10, 25  
 out (file extension), 14  
 outage, 62  
 output, 56, 67  
 Output subdirectory, 18  
 overwrite, 12  
  
 PARAMETER, 10, 12  
 parameter, 10, 38, 50  
 path name, 15  
 PC-Windows, 8, 9  
 PENALTY, 39, 57  
 perfect competition, 79  
 POL, 14  
 POSITIVE, 11  
 POSITIVE variable, 57  
 price setting, 66  
 Print-inc subdirectory, 17  
 PRINT.INC, 67  
 PrintInc subdirectory, 15  
 PrintOut subdirectory, 15  
 PRIOR, 67  
 PROD, 11  
  
 QECOMBGKL, 29, 59  
 QECOMBSLO, 29, 59  
 QECOMBSUP, 29, 59  
 QEEQ, 58  
 QESTOLOADT, 58  
 QESTOVOLT, 58  
 QGCBGBPR, 58  
 QGCBGEXT, 58  
 QGCVGEXT, 58  
 QGE2LEVEL, 59  
 QGEKNT, 58  
 QGGETOH, 58  
 QGHKNT, 58  
 QGKNHYRR, 58  
 QGKNSOL, 58  
 QGKNWND, 58  
 QGNCBGBPR, 58  
 QGNCBGEXT, 58  
 QGNCVGEXT, 58  
 QGNGETOH, 58  
 QHCOMBGKL, 29, 59  
 QHCOMBSLO, 29, 59  
 QHCOMBSUP, 29, 59  
 QHEQRURAL, 58  
 QHEQURBAN, 58  
 QHNRURPROP, 58  
 QHSTOLOADT, 59  
 QHSTOVOLT, 58  
  
 QHYMAXRS, 58  
 QHYMING, 58  
 QHYMINRS, 58  
 QHYRSSEQ, 58  
 QKFUELA, 59  
 QKFUELC, 59  
 QKFUELR, 59  
 QLIMCO2, 59  
 QLIMNOX, 59  
 QLIMSO2, 59  
 QNECOMBGKL, 29, 59  
 QNECOMBSLO, 29, 59  
 QNECOMBSUP, 29, 59  
 QNHCOMBGKL, 29, 59  
 QNHCOMBSLO, 29, 59  
 QNHCOMBSUP, 29, 59  
 QOBJ, 58  
 quotes, 10, 13  
 QXK, 59  
  
 region, 21  
 reserved words, 11  
 reservoir, 26, 34, 39  
 RESLIM, 60  
 RRR, 19, 21  
 RRRAAA, 22  
 run-of-river, 34  
 rural area, 22  
 RX3VSUBSTI, 77  
  
 S, 24  
 savebase.cmp, 71  
 savevar.cmp, 71  
 SCALAR, 10, 12  
 scalar, 10, 38  
 SCALE, 67  
 scenario, 69  
 scope, 73  
 season, 24  
 segment, 24  
 sequence of statements, 12, 74  
 SET, 10, 32  
 set intersection, 33  
 set operations, 33  
 set product, 10  
 set, (un)ordered, 10, 25  
 set, dynamic, 10, 33  
 set, static, 10, 25, 33  
 SETS.INC, 16  
 sim (file extension), 14, 16  
 simulated, 8  
 slash, 9  
 SMAX, 11, 78  
 SMIN, 11  
 SOL, 14  
 SOL-VAR-T, 46  
 solar power, 34

SOLFLH, 41  
 SOLPRINT, 67  
 SOLVE, 60  
 solver, 13  
 spreadsheet, 8, 15, 18, 67  
 SSS, 24  
 static set, 10, 25, 33  
 STATUS, 67  
 stochastic outage, 62  
 storage, 26, 34, 39  
 sub period, 24  
 subdirectory, 15  
 suffix, 14  
 SUM, 11  
 SYMLIST, 67, 81  
 SYMXREF, 67, 81  
 SYSOUT, 67

T, 24  
 t (ton), 38  
 TABLE, 10–12  
 tabulator, 9  
 TAX\_CO2, 32  
 TAX\_DE, 40  
 TAX\_DH, 40  
 TAX\_F, 42  
 TAX\_NOx, 32  
 TAX\_SO2, 32  
 TECH.INC, 16  
 technology, 26  
 TEP, tradable emission permits, 79  
 TEXT, 12  
 TGC, tradable green certificats, 79  
 third country, 42, 47, 53, 56, 65, 66,  
     76–78  
 time, 23  
 time period, 24  
 time segment, 24  
 time zones, 25  
 ton, 38  
 tradable emission permits, TEP, 79  
 tradable green certificats, TGC, 79  
 TRANS.INC, 16  
 trnsbase.cmp, 71  
 trnsvar.cmp, 71  
 TTT, 24  
 TWEEKEND, 25  
 TWORNDAY, 25

UELLIST, 67, 81  
 UELXREF, 67, 81  
 UNDF, 12  
 union (set), 33  
 unit (data), 38  
 Unix, 8, 9, 15  
 unordered set, 10, 25  
 UP, 11, 57, 67, 80

urban area, 22  
 USD, 38  
 USE225, 9  
 user interface, 15  
 User's Guide, 9  
 USING, 60

VAR, 14  
 VAR.INC, 16  
 VARIABLE, 10, 11, 56  
 variant, 69  
 VDEF.T, 56  
 VDHF.T, 56  
 version, 80  
 version number, 8  
 VESTOLOADT, 56  
 VESTOVOLT, 56  
 VGE2LEVEL, 57  
 VGE.T, 56  
 VGEN.T, 56  
 VGH.T, 56  
 VGHN.T, 56  
 VGHPMS.T, 56  
 VGKN, 56  
 VHSTOLOADT, 56  
 VHSTOVOLT, 57  
 VHYRS.S, 56  
 VOBJ, 56  
 VQ, 57  
 VQEEQ, 57  
 VQESTOVOLT, 57  
 VQHEQURBAN, 57  
 VQHSTOVOLT, 57  
 VQHYSSEQ, 57  
 VX3VEX.T, 78  
 VX3VIM.T, 78  
 VX.T, 56  
 VXKN, 56

water, 26  
 WEIGHT.S, 39  
 WEIGHT.T, 39  
 WHILE, 9, 12  
 wind power, 34  
 Windows, 8, 9  
 within the season, 24  
 within the year, 24  
 WND, 14  
 WND\_VAR.T, 46  
 WNDFLH, 41  
 WTR, 14  
 WTRRRFLH, 41  
 WTRRRVAR.T, 46  
 WTRRSFLH, 41  
 WTRRSVARS, 46

X3.INC, 16

X3FX, 42  
X3FX.VAR.T, 47  
X3VPEX, 77  
X3VPIM, 77  
X3VPLACE, 77  
X3VQEX, 77  
X3VQIM, 77  
X3VSTEP, 77  
X3VSTEP0, 76  
X3VX, 77  
XCOST, 45  
XINVCOST, 45  
XKINI, 44  
XLOSS, 45  
XOR, 12

Y, 23  
year, 23  
YES, 33  
YVALUE, 39  
YYY, 23